Report No.: Test Time:


Luminaire Property

Luminaire Manufacturer:
Voltage: 119.62V Current: 0.830A
Power: 98.46 W


Photometric Results

CIE Class: Semi-Direct Total Rated Lamp Lumens: 12464.5 lm
Measurement Flux: 12464.5 lm Efficiency: 100%
Downward Ratio: 80% Upward Ratio: 20%
Horizontal Diffuse Angle(10%,50%): H153.7,H92.2
Vertical Diffuse Angle(10%,50%): V161,V98.9
Luminaire Efficacy Rating (LER): 126.64 Central Intensity: 4251.43 cd
Max. Intensity: 4252.9 cd Pos of Max. Intensity: H0 V1
S/MH(C0/C180): 1.13 S/MH(C90/C270): 1.16

Picture Of Luminaire





Luminous Intensity Distribution Curve

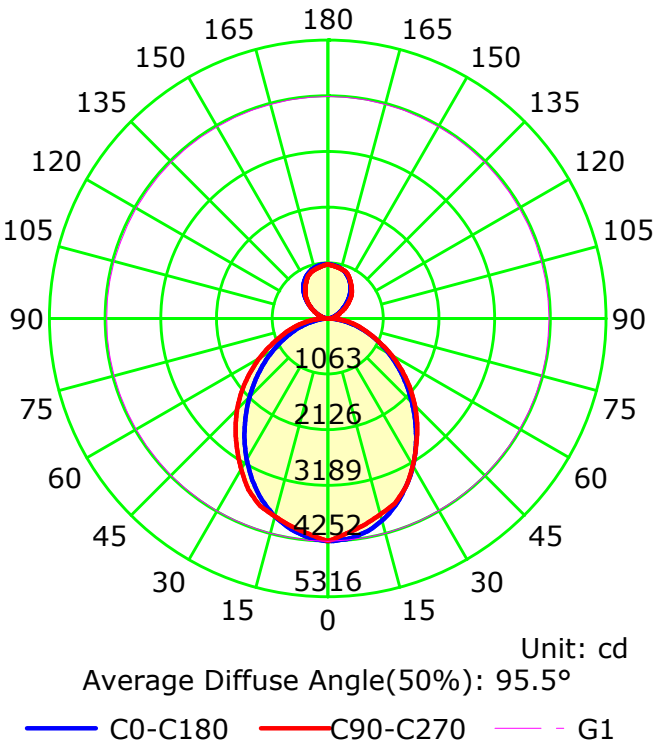

C Plane (°):0.0-360.0: 5.0 Gamma Plane (°):0.0-180.0:0.5
Test Lab: Test Device:
Test Type: TYPE C Distance:
Temperature: Humidity:
Operator: Inspector:

Luminous Intensity Distribution Curve

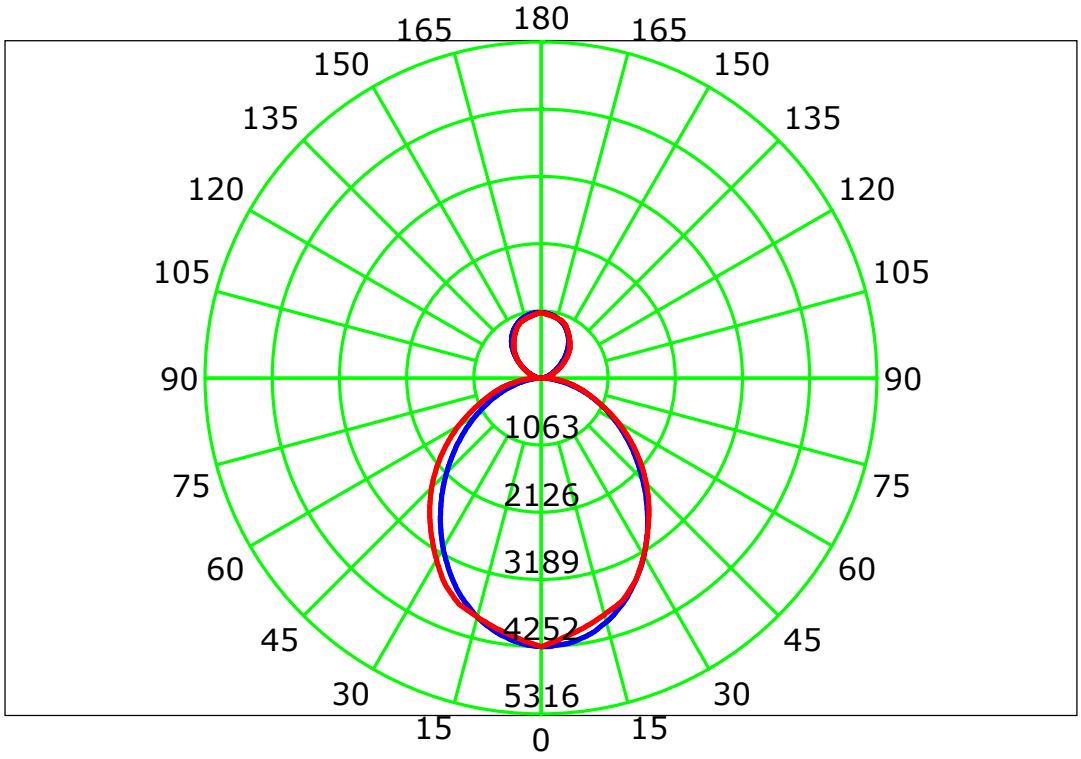


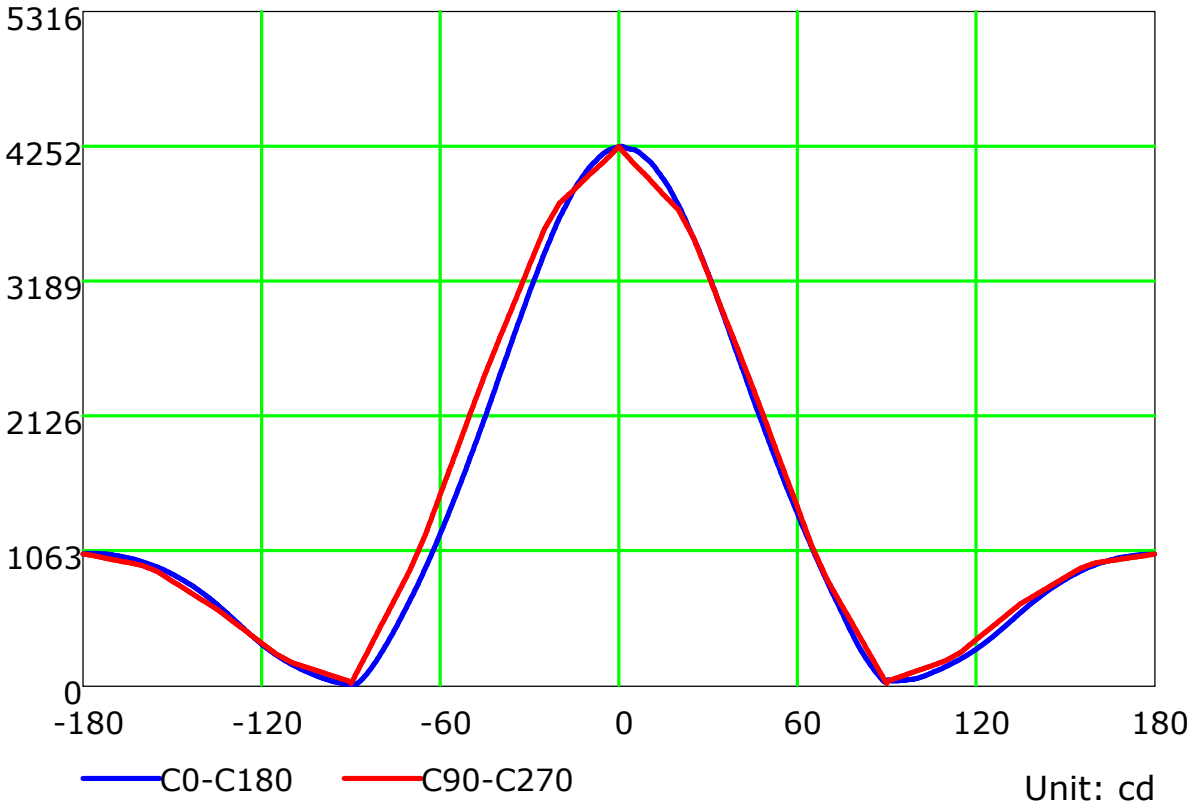

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

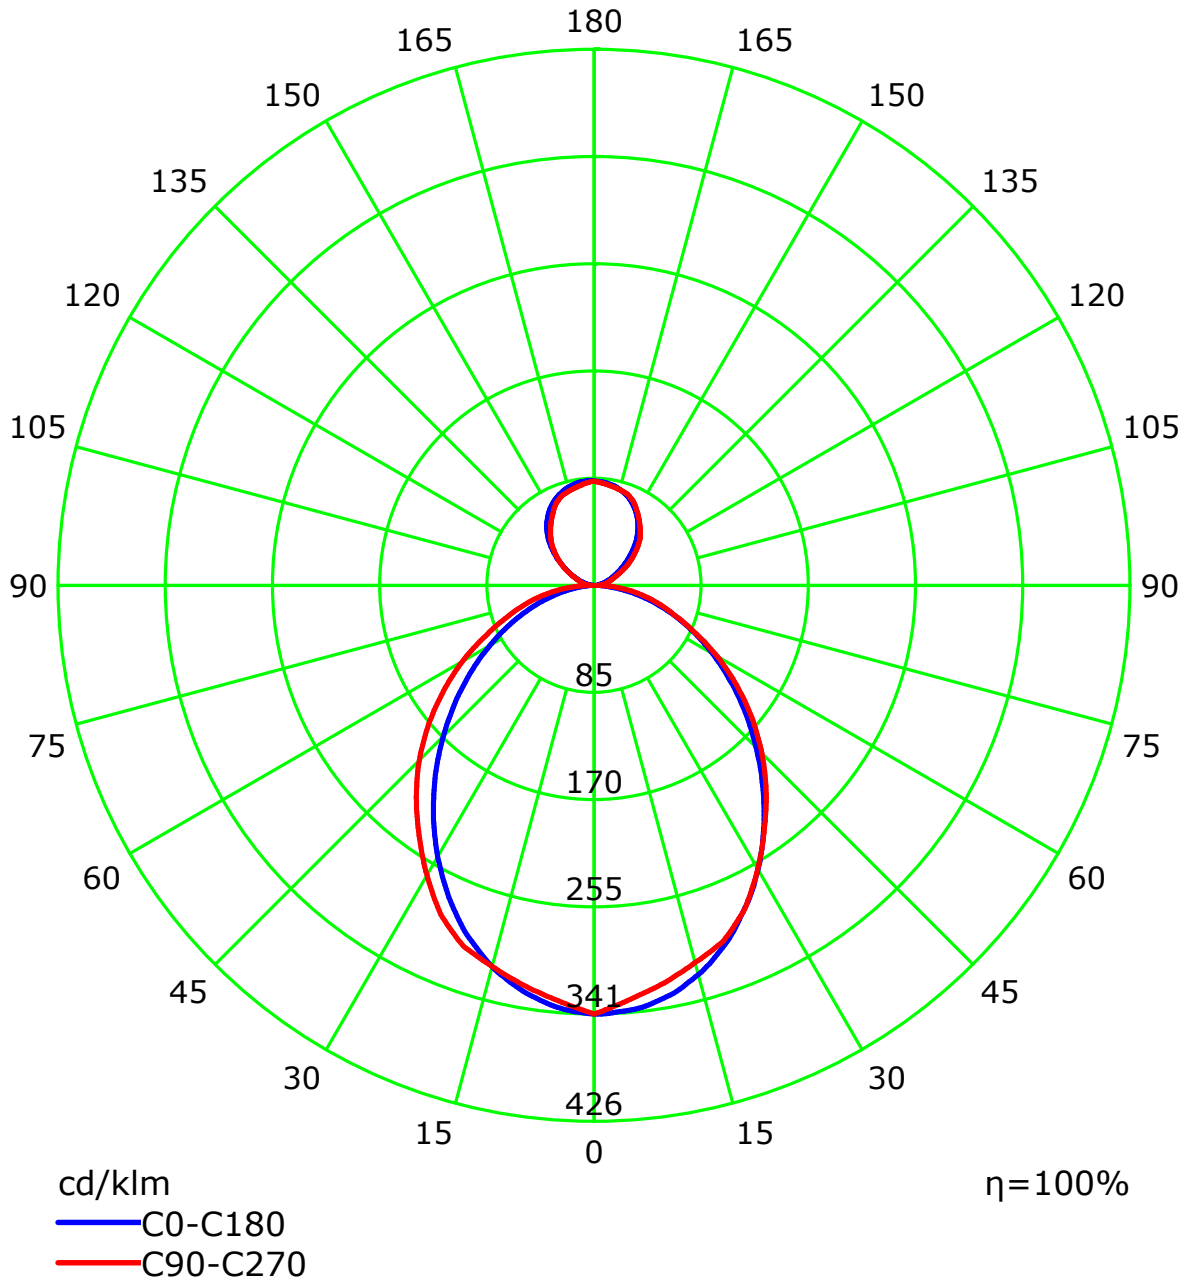

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:


Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	114	114	114	114	109	109	109	109	100	100	100	92	92	92	84	84	84	80
1	105	100	96	92	100	96	92	89	88	85	83	81	79	77	74	73	71	68
2	95	88	81	76	91	84	78	74	77	73	69	71	68	64	66	63	60	57
3	87	77	70	64	83	74	67	62	69	63	58	63	59	55	58	55	51	49
4	80	69	61	54	76	66	59	53	61	55	50	57	51	47	52	48	45	42
5	74	62	53	47	70	59	52	46	55	49	44	51	46	41	47	43	39	37
6	68	56	47	41	65	54	46	40	50	43	38	46	41	36	43	38	35	32
7	63	50	42	36	60	49	41	36	45	39	34	42	37	32	39	35	31	29
8	59	46	38	32	56	45	37	32	42	35	30	39	33	29	36	31	28	26
9	55	42	35	29	53	41	34	29	38	32	27	36	30	26	34	29	25	23
10	52	39	32	26	49	38	31	26	36	29	25	33	28	24	31	26	23	21

Spacing Criteria (0-180): 1.13
Spacing Criteria (90-270): 1.16
Spacing Criteria (Diagonal): 1.24


Curves of Luminaires vs Lighting Area

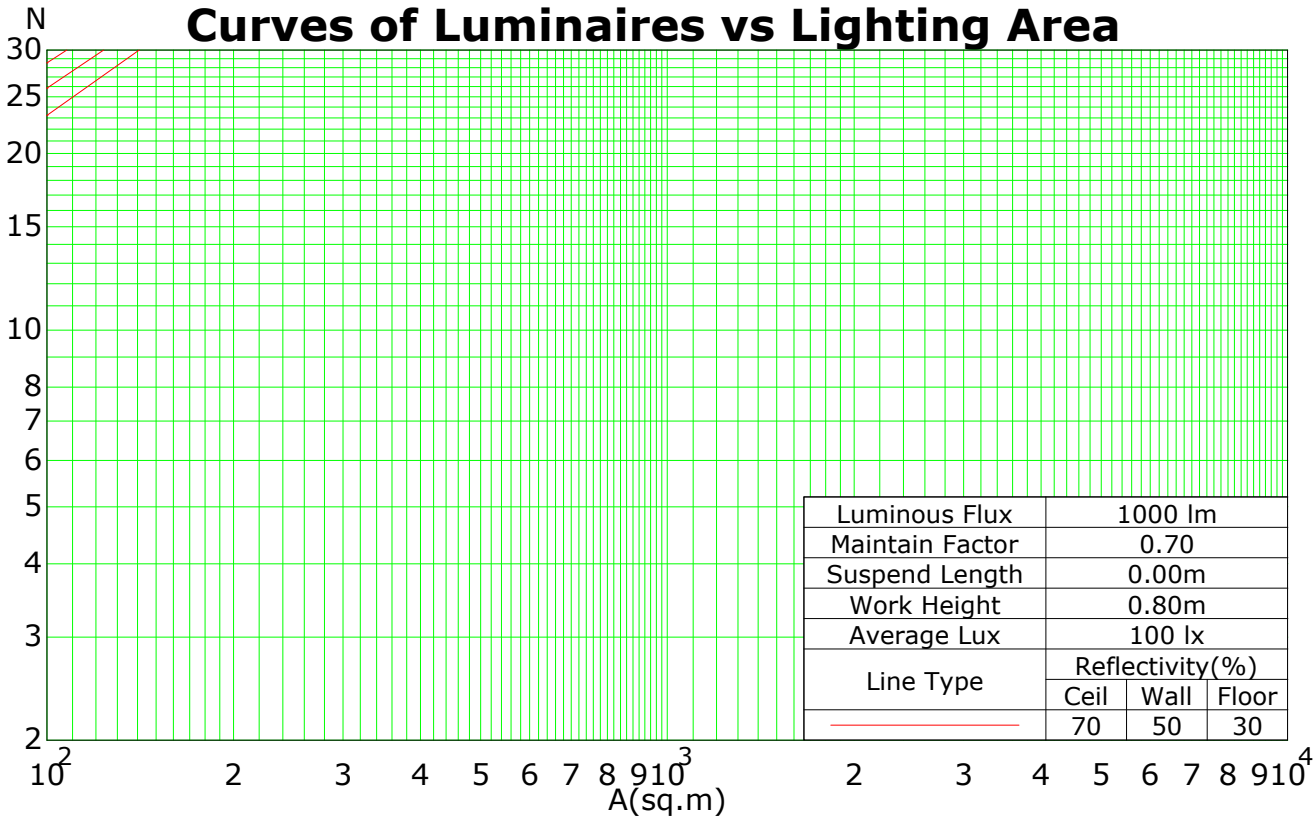

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Isocandela (rectangle)

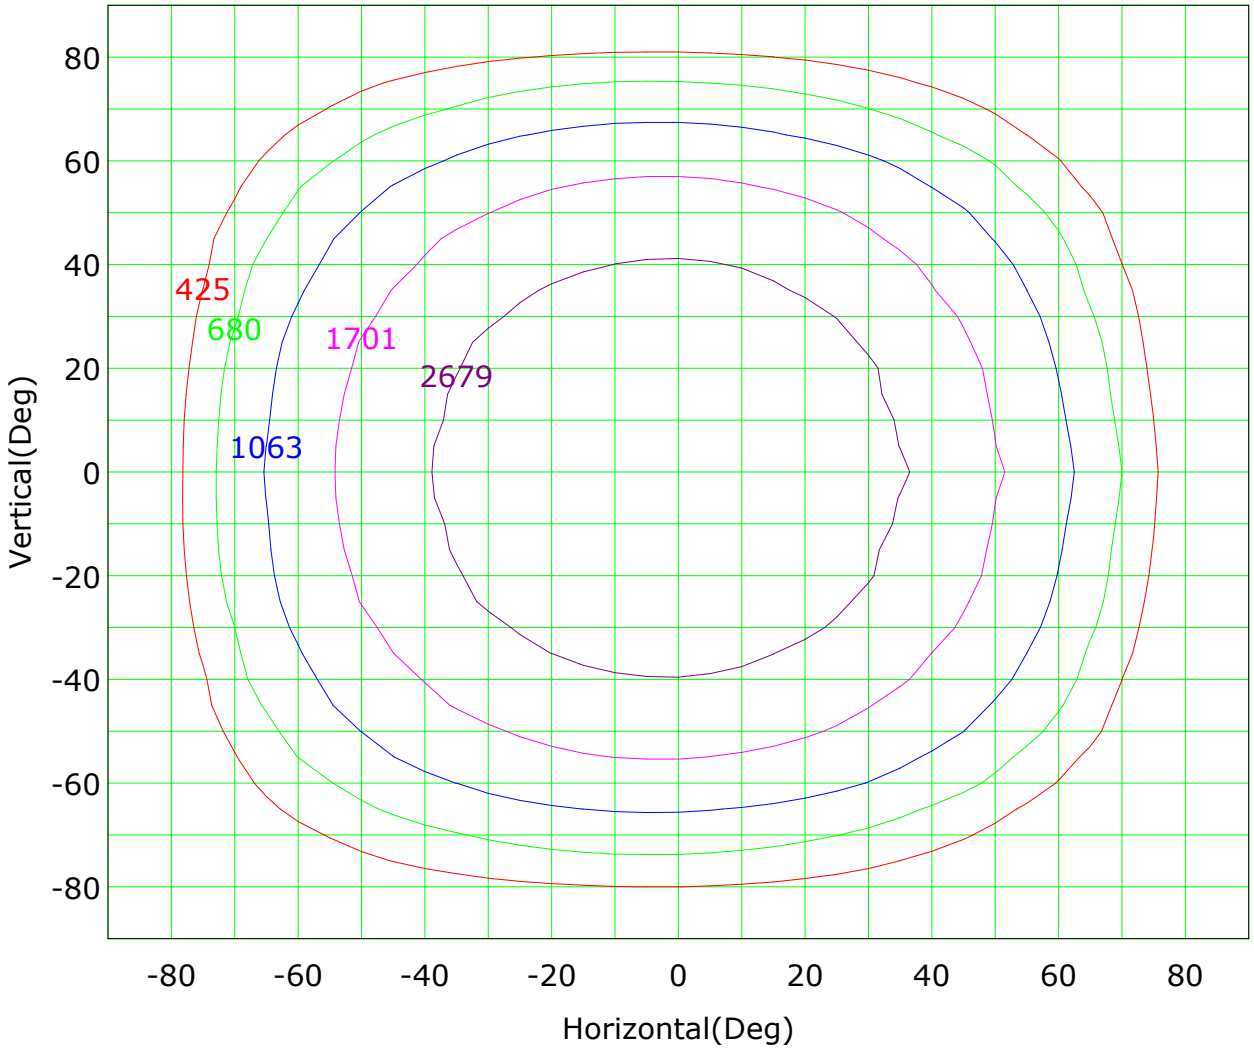


Imax (100%): 4253 cd

(10%): 425 cd
(16%): 680 cd
(25%): 1063 cd
(40%): 1701 cd
(63%): 2679 cd
(100%): 4253 cd

C Plane (°):0.0-360.0: 5.0
Gamma Plane (°):0.0-180.0:0.5
Test Lab:
Test Device:
Test Type: TYPE C
Distance:
Temperature:
Humidity:
Operator:
Inspector:

Isocandela (sphere)

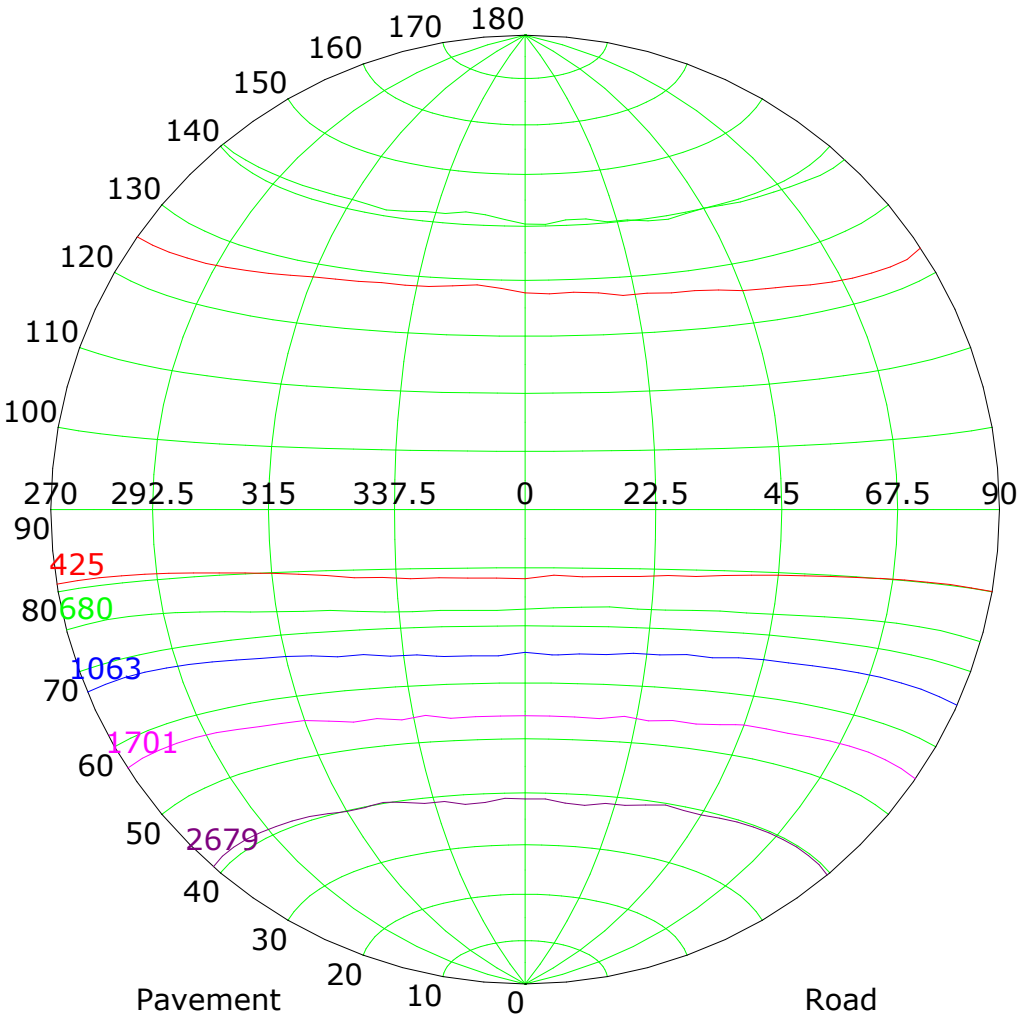


Imax (100%): 4253 cd

(10%): 425 cd
(16%): 680 cd
(25%): 1063 cd
(40%): 1701 cd
(63%): 2679 cd
(100%): 4253 cd

C Plane (°):0.0-360.0: 5.0
Gamma Plane (°):0.0-180.0:0.5
Test Lab:
Test Device:
Test Type: TYPE C
Distance:
Temperature:
Humidity:
Operator:
Inspector:

IsoLux Plot

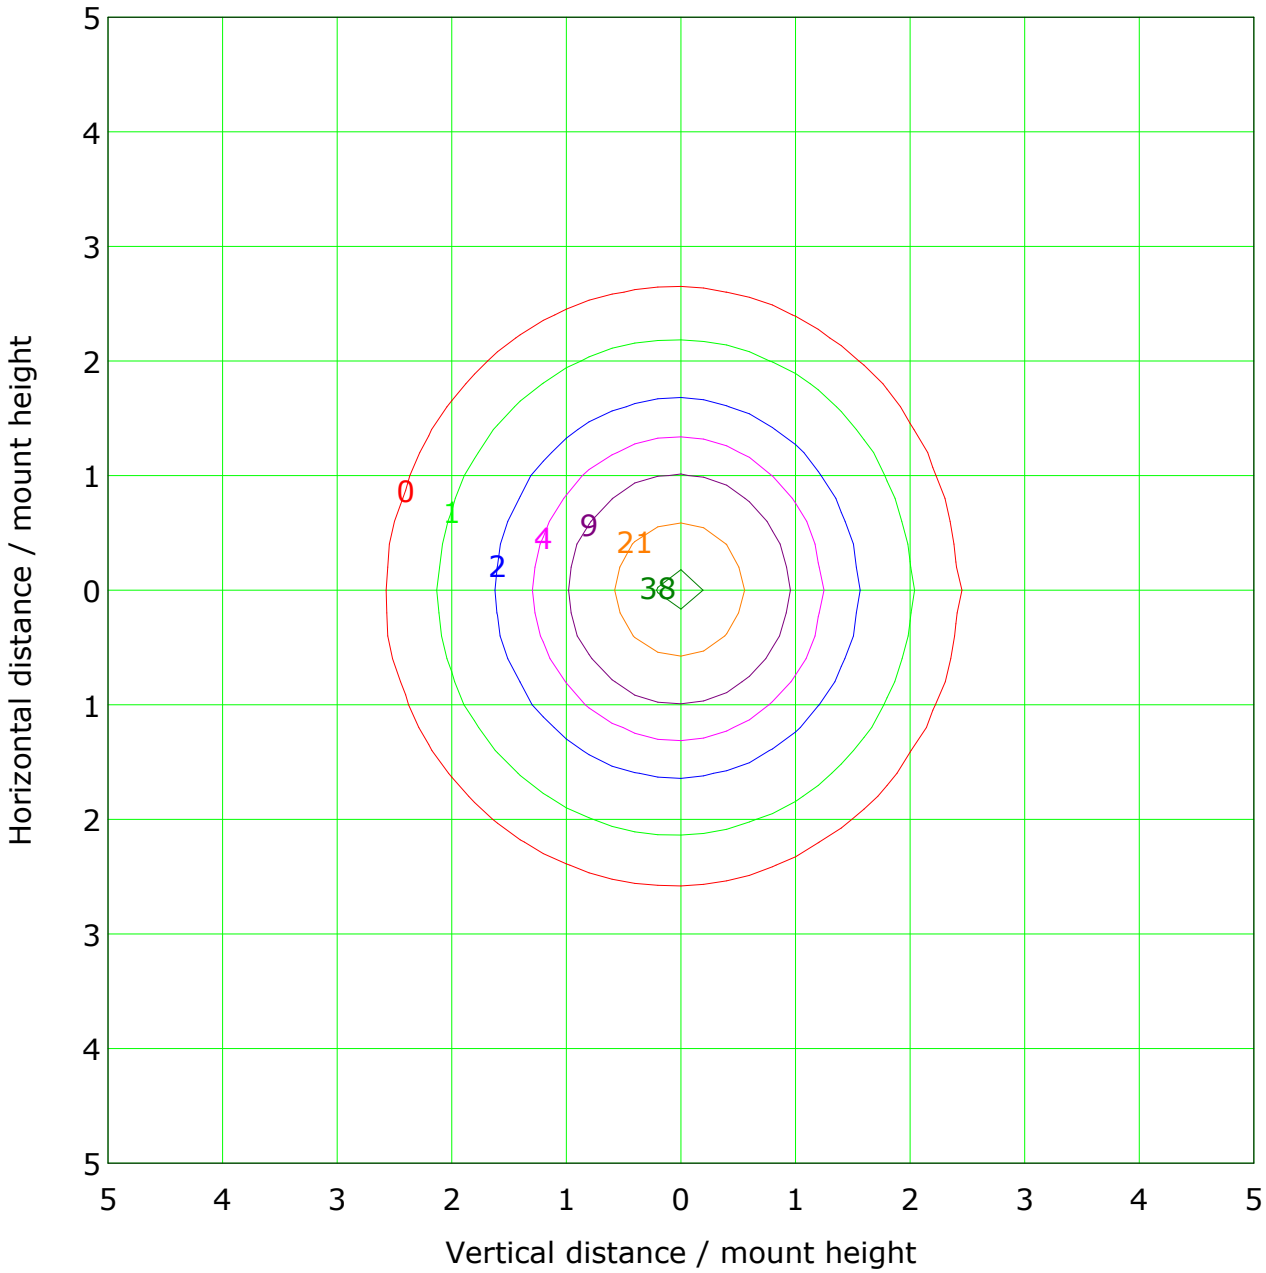


Mounting Height: 10.0m Max Lux(100%): 42.5 lx

(1%): 0.4 lx	(2%): 0.9 lx
(5%): 2.1 lx	(10%): 4.3 lx
(20%): 8.5 lx	(50%): 21.3 lx
(90%): 38.3 lx	(100%): 42.5 lx

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Roadway CU Curve

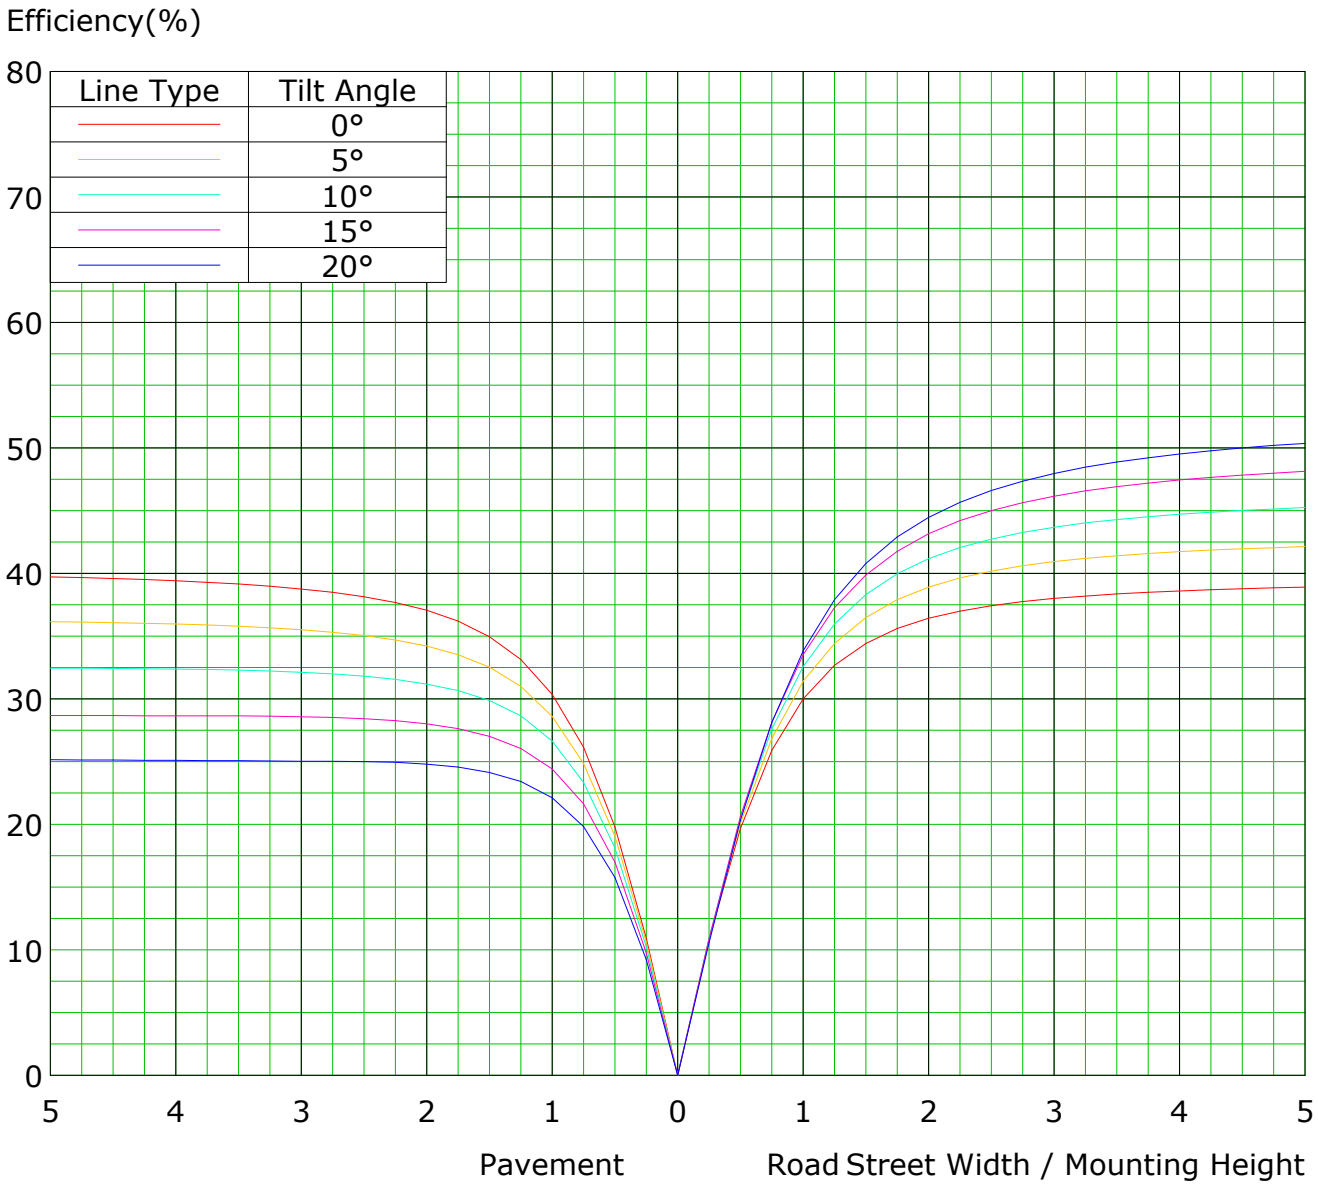



C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
		a	b	c	d	e	f	g	h

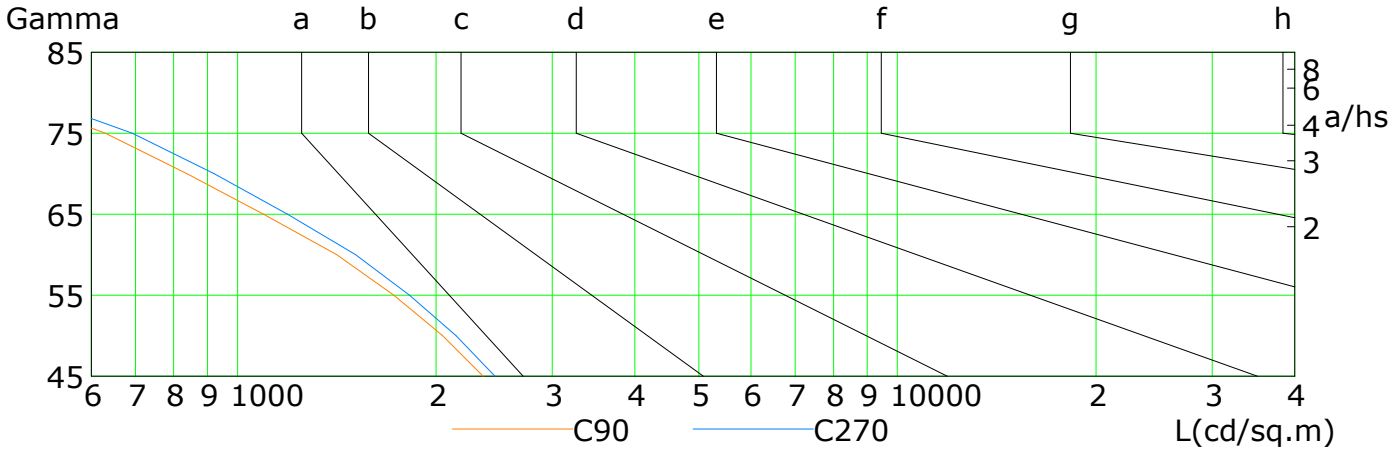

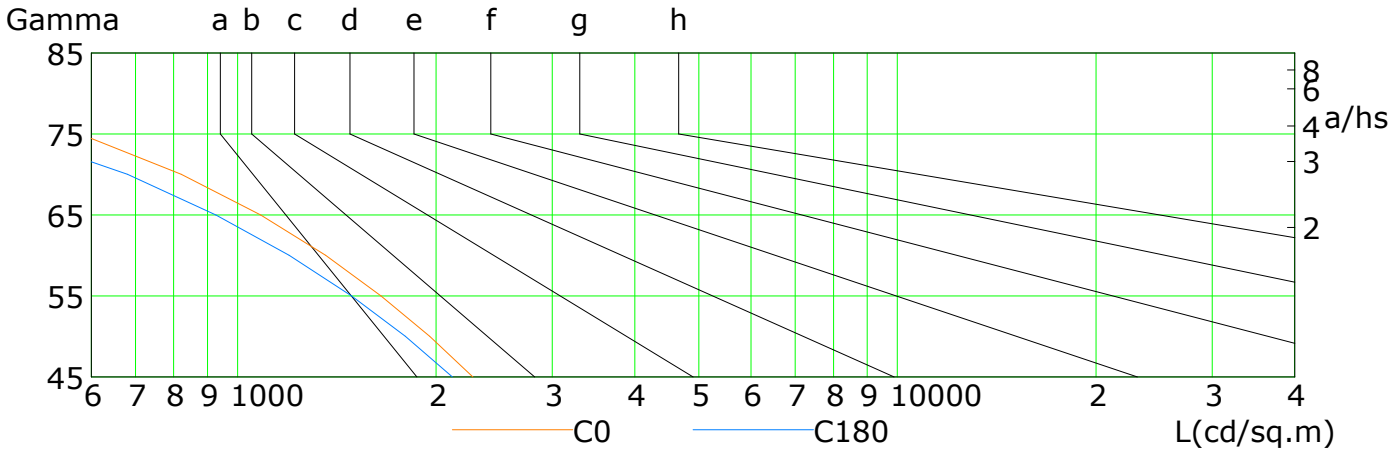


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	2273	1956	1650	1360	1084	822	577	336	149
C90	2355	2044	1725	1413	1095	837	630	426	220
C180	2116	1796	1489	1198	927	681	454	251	83
C270	2455	2142	1823	1509	1191	921	693	468	240

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:


Illuminance at a Distance(Beam Angle)

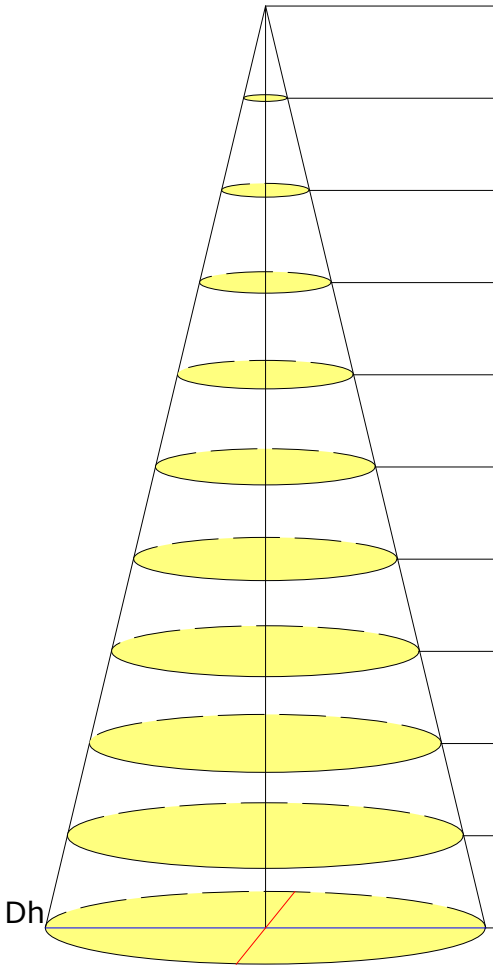

Dist(m)	Enadir(lx)	Dh/Dv_B(m)	S_B(sq.m)	Eav_B(lx)
1.0	4251.43	2.08/2.34	3.7	1371.18
2.0	1062.86	4.15/4.68	14.9	342.80
3.0	472.38	6.23/7.02	33.5	152.35
4.0	265.71	8.31/9.36	59.5	85.70
5.0	170.06	10.38/11.70	93.0	54.85
6.0	118.10	12.46/14.03	134.0	38.09
7.0	86.76	14.54/16.37	182.3	27.98
8.0	66.43	16.61/18.71	238.2	21.42
9.0	52.49	18.69/21.05	301.4	16.93
10.0	42.51	20.77/23.39	372.1	13.71

Beam Angle(B): H92.2 V98.9 Field Angle(F): H360.0 V360.0

Illuminance at a Distance(Field Angle)

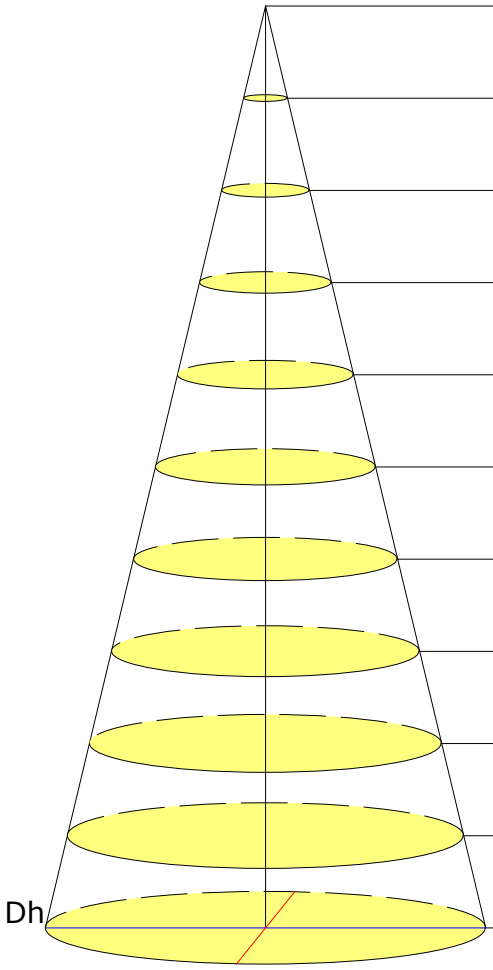


Dist(m)	Enadir(lx)	Dh/Dv_F(m)	S_F(sq.m)	Eav_F(lx)
1.0	4251.43	NA/NA	NA	NA
2.0	1062.86	NA/NA	NA	NA
3.0	472.38	NA/NA	NA	NA
4.0	265.71	NA/NA	NA	NA
5.0	170.06	NA/NA	NA	NA
6.0	118.10	NA/NA	NA	NA
7.0	86.76	NA/NA	NA	NA
8.0	66.43	NA/NA	NA	NA
9.0	52.49	NA/NA	NA	NA
10.0	42.51	NA/NA	NA	NA

Beam Angle(B): H92.2 V98.9 Field Angle(F): H360.0 V360.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Vertical IsoLux Plot

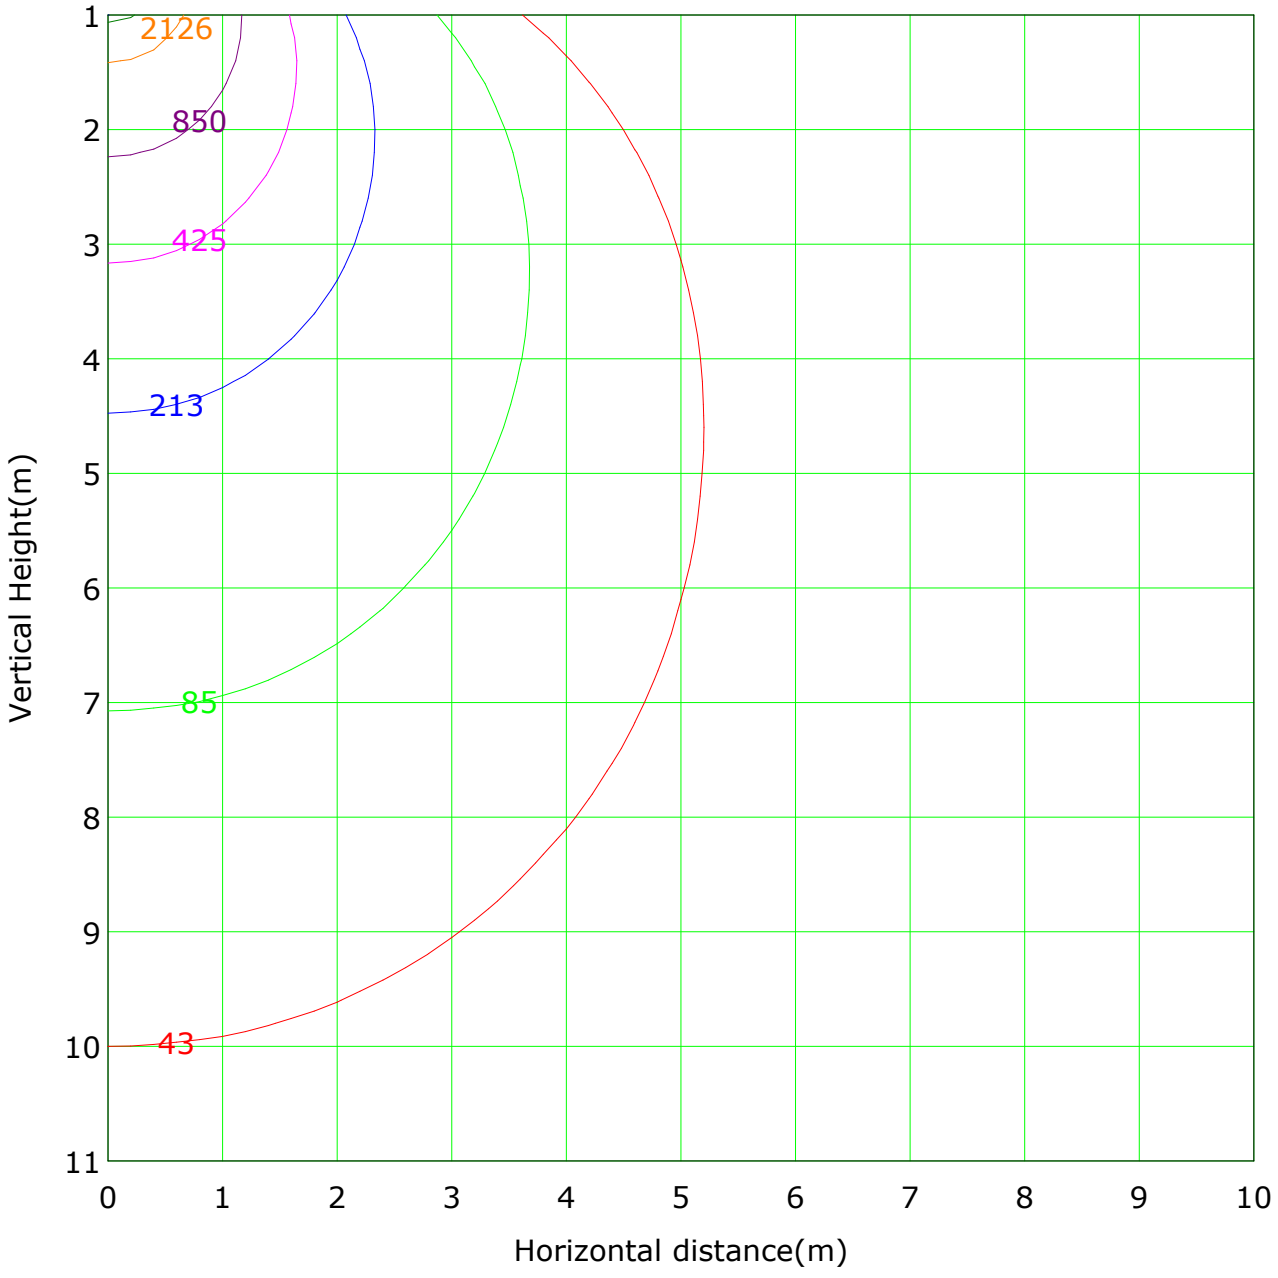

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 4251.4 lx

(1%): 42.5 lx	(2%): 85.0 lx
(5%): 212.6 lx	(10%): 425.1 lx
(20%): 850.3 lx	(50%):2125.7 lx
(90%):3826.3 lx	(100%):4251.4 lx

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Area Flux Table

Unit: lm

Vertical plane	-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80	90	Flux(T)	Flux(E)
-90	0.0	0.2	0.7	1.5	2.6	3.9	5.2	6.3	7.1	7.4	7.0	6.1	4.9	3.5	2.2	1.1	0.4	0.1	60.1	3.4	
-80	0.0	0.5	1.9	4.4	7.6	11.5	15.3	18.6	20.6	21.0	19.7	16.9	13.3	9.4	5.8	3.0	1.0	0.2	170.8	138.1	
-70	0.1	0.9	3.4	7.6	13.3	19.9	26.7	32.3	35.8	36.4	33.9	28.9	22.5	15.8	9.7	4.9	1.7	0.2	293.9	280.8	
-60	0.1	1.5	5.2	11.5	20.0	30.1	40.4	49.1	54.4	55.1	51.1	43.3	33.3	23.0	13.9	6.9	2.4	0.3	441.6	434.2	
-50	0.2	2.1	7.1	15.4	26.8	40.3	54.2	66.0	73.1	73.9	68.3	57.6	44.0	30.2	18.1	8.9	3.0	0.4	589.7	584.5	
-40	0.2	2.5	8.6	18.7	32.7	49.4	66.8	81.5	90.4	91.4	84.3	70.7	53.8	36.6	21.9	10.7	3.6	0.5	724.3	720.5	
-30	0.3	3.0	10.0	21.7	38.1	58.0	78.6	96.2	106.8	107.9	99.4	83.2	62.9	42.7	25.3	12.3	4.1	0.5	851.0	847.9	
-20	0.3	3.3	11.0	23.7	41.6	63.2	85.9	105.1	116.7	117.9	108.5	90.7	68.5	46.3	27.5	13.3	4.5	0.5	928.7	926.1	
-10	0.4	3.7	11.8	25.2	44.0	66.9	90.8	111.1	123.4	124.6	114.6	95.8	72.2	48.7	28.8	13.9	4.7	0.6	981.1	978.7	
0	0.4	3.7	11.9	25.2	43.9	66.7	90.5	110.8	123.0	124.2	114.3	95.5	72.0	48.6	28.8	14.0	4.8	0.6	978.8	976.5	
10	0.3	3.4	11.1	23.7	41.4	62.7	85.0	104.0	115.6	116.9	107.6	90.0	68.0	46.0	27.6	13.4	4.7	0.5	921.7	919.3	
20	0.3	3.0	10.1	21.8	37.8	57.0	77.2	94.4	105.0	106.2	97.9	82.0	62.1	42.3	25.4	12.5	4.3	0.5	839.7	837.0	
30	0.2	2.5	8.7	18.6	32.2	48.3	64.9	79.2	87.9	89.0	82.2	69.1	52.8	36.2	22.0	10.9	3.8	0.4	709.0	705.5	
40	0.1	1.9	7.1	15.2	26.2	39.0	52.0	63.2	70.1	71.1	65.8	55.6	42.9	29.8	18.3	9.2	3.1	0.3	570.9	566.3	
50	0.1	1.3	5.1	11.2	19.4	28.8	38.3	46.4	51.4	52.2	48.5	41.3	32.2	22.6	14.0	7.1	2.3	0.3	422.6	415.6	
60	0.1	0.8	3.1	7.1	12.5	18.7	24.8	29.8	33.0	33.6	31.5	27.2	21.5	15.4	9.7	5.0	1.5	0.2	275.6	262.2	
70	0.0	0.4	1.7	4.1	7.2	10.7	14.1	17.0	18.7	19.1	18.0	15.7	12.6	9.2	5.9	3.1	1.0	0.2	158.8	121.3	
80	0.0	0.2	0.7	1.5	2.6	3.8	5.0	5.9	6.6	6.7	6.4	5.7	4.6	3.4	2.3	1.3	0.5	0.1	57.5	0.0	
90																					
Flux(T)	3.1	34.8	119.3	258.1	450.0	678.8	915.7	1117.0	1239.7	1254.6	1159.1	975.2	744.0	509.9	307.2	151.6	51.3	6.3	9976		
Flux(E)	0.0	13.8	101.2	239.7	432.8	662.6	901.4	1103.5	1227.2	1241.9	1146.5	961.9	730.3	495.7	291.7	135.8	31.9	0.0		9718	


Horizontal plane

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

The Average Illuminance Effective Figure

Flux Out: 5979.31lm

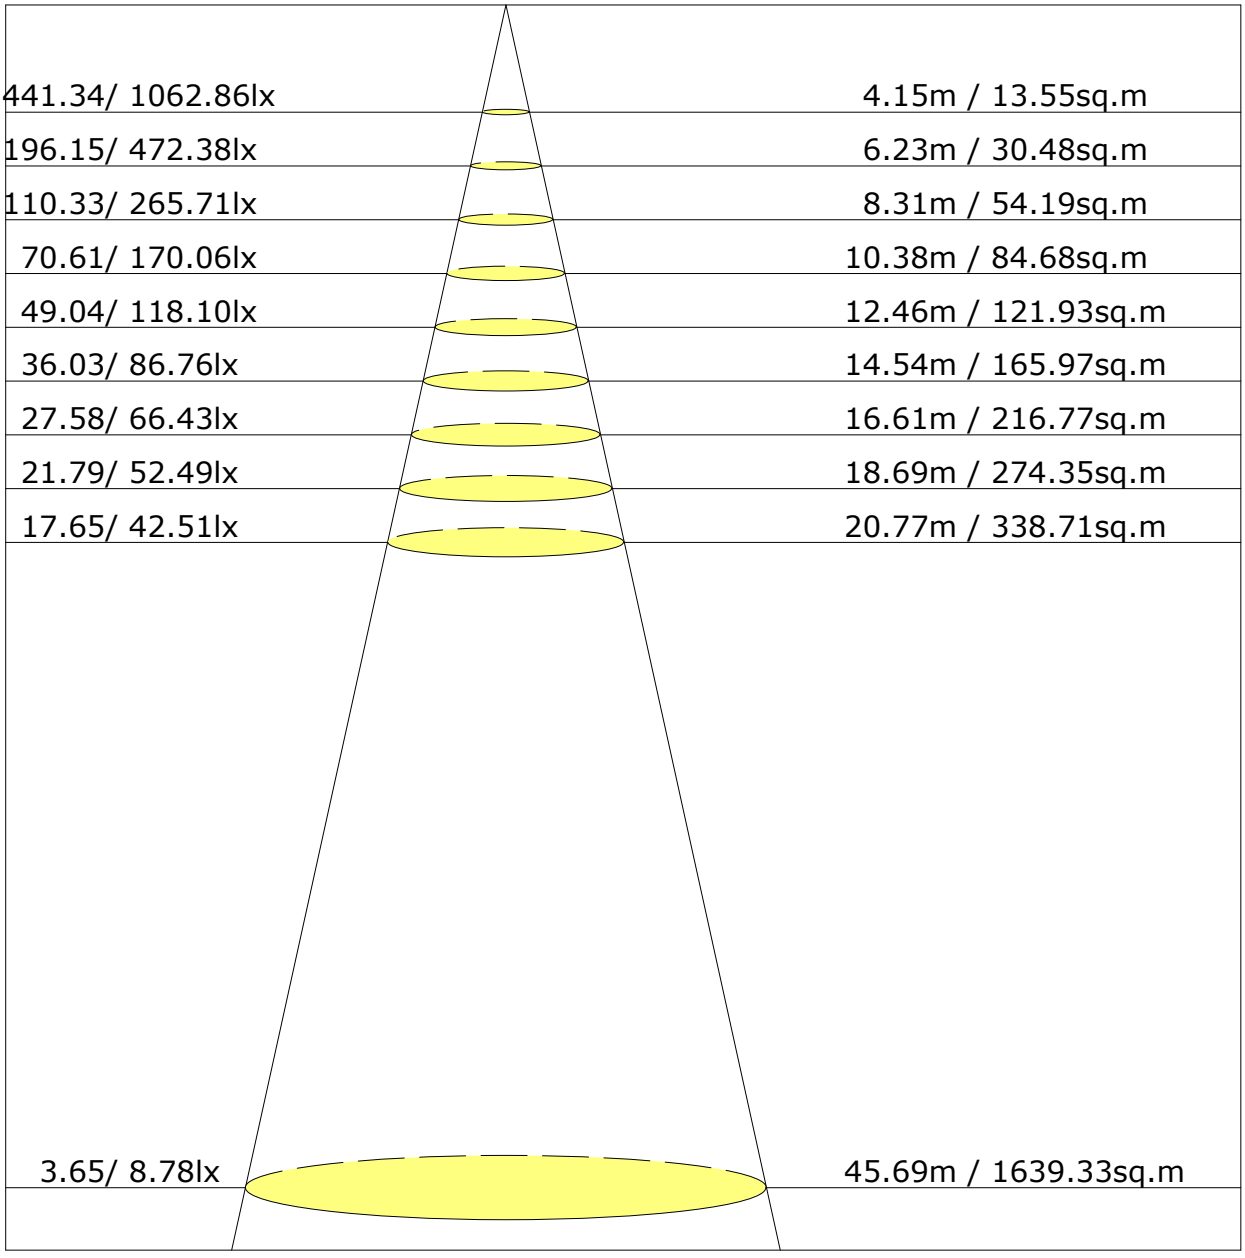

Height	Avg./Nadir. E	Beam Angle:92.2°	Diameter / Area
2.0m	441.34/ 1062.86lx		4.15m / 13.55sq.m
3.0m	196.15/ 472.38lx		6.23m / 30.48sq.m
4.0m	110.33/ 265.71lx		8.31m / 54.19sq.m
5.0m	70.61/ 170.06lx		10.38m / 84.68sq.m
6.0m	49.04/ 118.10lx		12.46m / 121.93sq.m
7.0m	36.03/ 86.76lx		14.54m / 165.97sq.m
8.0m	27.58/ 66.43lx		16.61m / 216.77sq.m
9.0m	21.79/ 52.49lx		18.69m / 274.35sq.m
10.0m	17.65/ 42.51lx		20.77m / 338.71sq.m
22.0m	3.65/ 8.78lx		45.69m / 1639.33sq.m

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
3H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
4H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
6H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
8H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
12H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
X=4H Y=2H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
3H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
4H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
6H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
8H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
12H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
X=8H Y=4H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
6H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
8H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
12H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
X=12H Y=4H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
6H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
8H	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$	-1.$
Variations with the observer position at spacings:										
S=1.0H	-1.$/-1.$					-1.$/-1.$				
S=1.5H	-1.$/-1.$					-1.$/-1.$				
S=2.0H	-1.$/-1.$					-1.$/-1.$				

Calculate in accordance with CIE Pub.117. The table is revised with 12464lm (8log(F/F0) = 8.8).

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

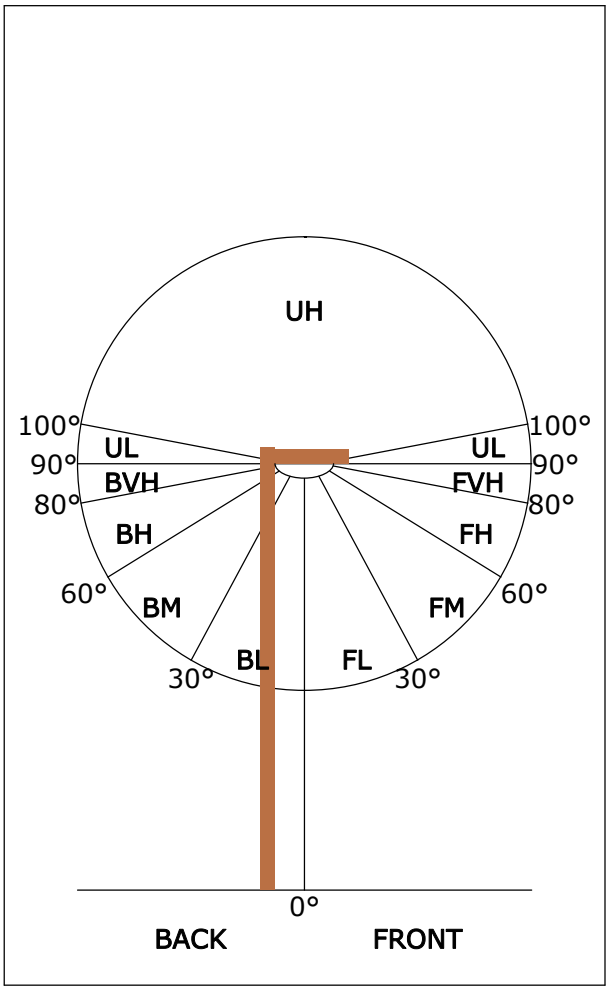


ZONE	LUMENS	% LAMP LUMENS
FORWARD LIGHT	4935	39.6
FL (0°-30°)	1535	12.3
FM (30°-60°)	2488	20.0
FH (60°-80°)	814	6.5
FVH (80°-90°)	97	0.8
BACK LIGHT	5041	40.4
BL (0°-30°)	1548	12.4
BM (30°-60°)	2545	20.4
BH (60°-80°)	846	6.8
BVH (80°-90°)	102	0.8
UP LIGHT	2488	20.0
UL (90°-100°)	60	0.5
UH (100°-180°)	2428	19.5
TRAPPED LIGHT	NA	NA

BUG(**B**acklight,**U**plight,**G**lare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U5 G2
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U5 G1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

LCS Graph

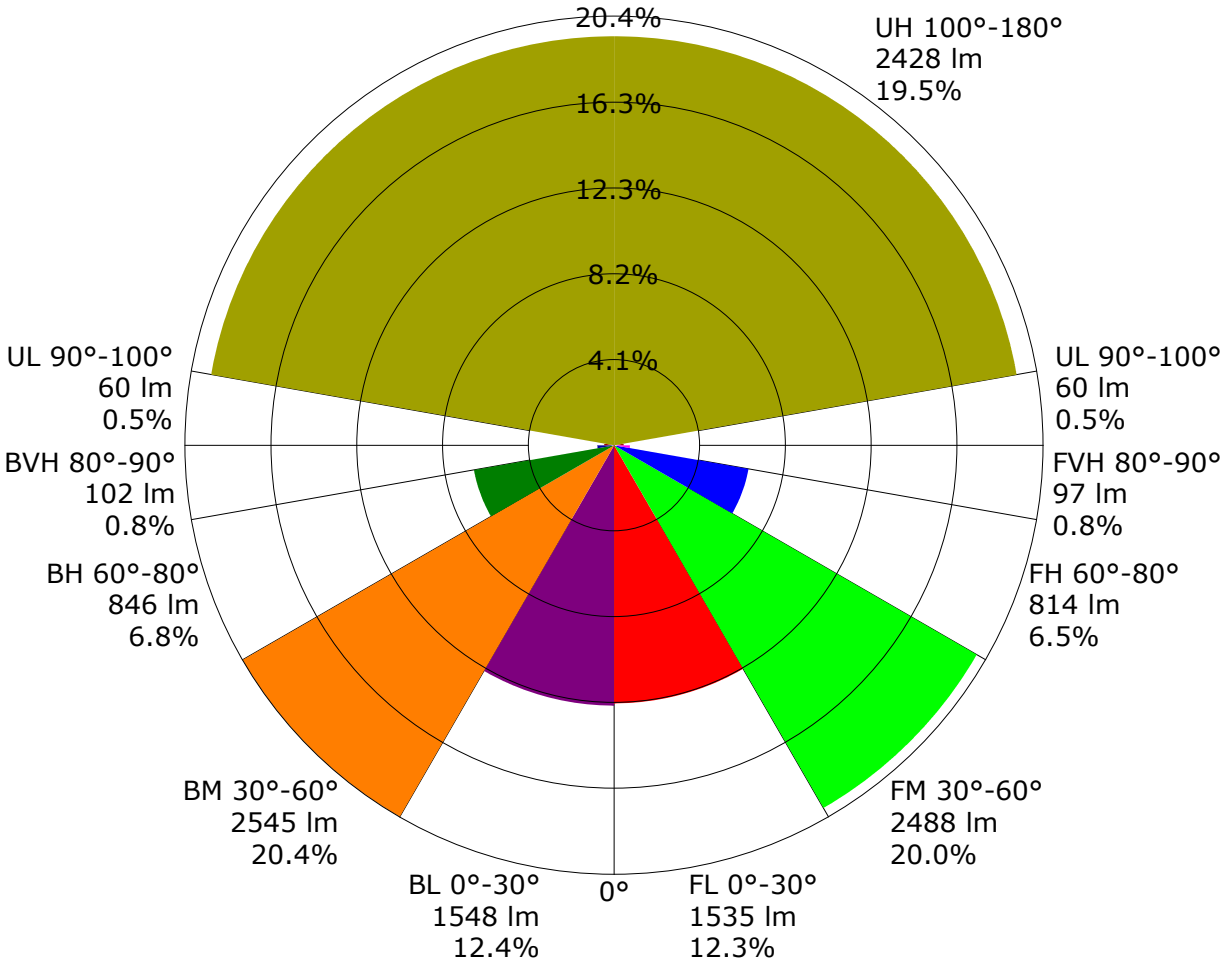

Scale= MAX LCS%

Trapped Light:NA,NA

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.55	0.64	0.71	0.76	0.83	0.87	0.91	0.95	0.97
	0.30		0.48	0.57	0.64	0.69	0.77	0.82	0.86	0.91	0.94
	0.20		0.42	0.52	0.59	0.64	0.72	0.78	0.82	0.87	0.91
0.50	0.50	0.20	0.51	0.60	0.66	0.71	0.77	0.81	0.83	0.87	0.90
	0.30		0.45	0.54	0.60	0.65	0.72	0.77	0.80	0.84	0.87
	0.20		0.41	0.50	0.56	0.61	0.68	0.73	0.77	0.82	0.85
0.30	0.50	0.20	0.48	0.56	0.62	0.66	0.71	0.74	0.77	0.80	0.82
	0.30		0.43	0.51	0.57	0.61	0.67	0.71	0.74	0.78	0.80
	0.20		0.39	0.47	0.53	0.58	0.64	0.68	0.72	0.76	0.79
0.00	0.00	0.00	0.35	0.43	0.48	0.52	0.57	0.61	0.64	0.67	0.70

Rating:98W Photometrically tested without ceiling board.

Multiply UF values by service correction factors

Calculate in accordance with CIBSE Technical Memorandum NO.5 1980

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.92	0.76	0.65	0.56	0.45	0.37	0.32	0.25	0.20
	0.30		0.77	0.65	0.56	0.50	0.41	0.34	0.30	0.23	0.19
	0.20		0.66	0.57	0.50	0.45	0.37	0.32	0.28	0.22	0.18
0.50	0.50	0.20	0.84	0.69	0.59	0.51	0.41	0.37	0.29	0.22	0.18
	0.30		0.71	0.60	0.52	0.46	0.37	0.31	0.27	0.21	0.18
	0.20		0.62	0.53	0.47	0.42	0.34	0.29	0.25	0.20	0.17
0.30	0.50	0.20	0.78	0.63	0.54	0.47	0.37	0.31	0.26	0.20	0.17
	0.30		0.66	0.56	0.48	0.42	0.34	0.29	0.25	0.19	0.16
	0.20		0.58	0.50	0.43	0.39	0.32	0.27	0.23	0.19	0.15
0.00	0.00	0.00	0.45	0.38	0.32	0.28	0.23	0.19	0.17	0.13	0.11

Rating:98W Photometrically tested without ceiling board.

Multiply UF values by service correction factors

Calculate in accordance with CIBSE Technical Memorandum NO.5 1980

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.35	0.36	0.37	0.38	0.39	0.39	0.40	0.40	0.41
	0.30		0.29	0.30	0.32	0.33	0.34	0.35	0.36	0.37	0.38
	0.20		0.24	0.26	0.27	0.29	0.31	0.32	0.33	0.35	0.36
0.50	0.50	0.20	0.34	0.35	0.36	0.36	0.37	0.38	0.38	0.39	0.39
	0.30		0.28	0.30	0.31	0.32	0.33	0.34	0.35	0.36	0.37
	0.20		0.24	0.26	0.27	0.28	0.30	0.31	0.32	0.34	0.35
0.30	0.50	0.20	0.33	0.34	0.35	0.35	0.36	0.36	0.37	0.37	0.37
	0.30		0.28	0.29	0.30	0.31	0.32	0.33	0.34	0.35	0.35
	0.20		0.24	0.25	0.27	0.28	0.29	0.31	0.31	0.33	0.34
0.00	0.00	0.00	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20

Rating:98W Photometrically tested without ceiling board.

Multiply UF values by service correction factors

Calculate in accordance with CIBSE Technical Memorandum NO.5 1980

Zonal Lumen

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-0.5	4247.0	1.0	1.0	0.01	0.01
0.5-1.0	4238.2	3.0	4.1	0.02	0.03
1.0-1.5	4229.1	5.1	9.1	0.04	0.07
1.5-2.0	4219.6	7.1	16.2	0.06	0.13
2.0-2.5	4209.9	9.1	25.2	0.07	0.20
2.5-3.0	4200.0	11.0	36.3	0.09	0.29
3.0-3.5	4190.0	13.0	49.3	0.10	0.40
3.5-4.0	4179.8	15.0	64.3	0.12	0.52
4.0-4.5	4169.4	16.9	81.2	0.14	0.65
4.5-5.0	4158.8	18.9	100.1	0.15	0.80
5.0-5.5	4147.9	20.8	120.9	0.17	0.97
5.5-6.0	4136.7	22.7	143.7	0.18	1.15
6.0-6.5	4125.2	24.6	168.3	0.20	1.35
6.5-7.0	4113.3	26.5	194.8	0.21	1.56
7.0-7.5	4101.1	28.4	223.2	0.23	1.79
7.5-8.0	4088.8	30.2	253.4	0.24	2.03
8.0-8.5	4076.3	32.1	285.5	0.26	2.29
8.5-9.0	4063.6	33.9	319.4	0.27	2.56
9.0-9.5	4050.7	35.7	355.1	0.29	2.85
9.5-10.0	4037.5	37.5	392.6	0.30	3.15
10.0-10.5	4023.9	39.3	431.8	0.31	3.46
10.5-11.0	4009.9	41.0	472.8	0.33	3.79
11.0-11.5	3995.5	42.7	515.6	0.34	4.14
11.5-12.0	3980.7	44.4	560.0	0.36	4.49
12.0-12.5	3965.7	46.1	606.2	0.37	4.86
12.5-13.0	3950.2	47.8	654.0	0.38	5.25
13.0-13.5	3934.6	49.4	703.4	0.40	5.64
13.5-14.0	3918.9	51.1	754.5	0.41	6.05
14.0-14.5	3902.8	52.7	807.2	0.42	6.48
14.5-15.0	3886.4	54.3	861.4	0.44	6.91
15.0-15.5	3869.6	55.8	917.2	0.45	7.36
15.5-16.0	3852.6	57.3	974.6	0.46	7.82
16.0-16.5	3835.3	58.8	1033.4	0.47	8.29
16.5-17.0	3817.9	60.3	1093.7	0.48	8.77
17.0-17.5	3800.3	61.8	1155.5	0.50	9.27
17.5-18.0	3782.6	63.2	1218.8	0.51	9.78

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
18.0-18.5	3764.8	64.6	1283.4	0.52	10.30
18.5-19.0	3746.7	66.0	1349.4	0.53	10.83
19.0-19.5	3728.5	67.4	1416.8	0.54	11.37
19.5-20.0	3710.1	68.7	1485.6	0.55	11.92
20.0-20.5	3690.9	70.0	1555.6	0.56	12.48
20.5-21.0	3670.6	71.3	1626.9	0.57	13.05
21.0-21.5	3649.5	72.5	1699.5	0.58	13.63
21.5-22.0	3627.8	73.7	1773.2	0.59	14.23
22.0-22.5	3605.5	74.9	1848.0	0.60	14.83
22.5-23.0	3582.8	76.0	1924.0	0.61	15.44
23.0-23.5	3559.7	77.0	2001.0	0.62	16.05
23.5-24.0	3536.2	78.1	2079.1	0.63	16.68
24.0-24.5	3512.4	79.1	2158.2	0.63	17.32
24.5-25.0	3488.1	80.1	2238.3	0.64	17.96
25.0-25.5	3463.3	81.0	2319.3	0.65	18.61
25.5-26.0	3437.6	81.9	2401.2	0.66	19.26
26.0-26.5	3411.3	82.7	2483.9	0.66	19.93
26.5-27.0	3384.5	83.5	2567.5	0.67	20.60
27.0-27.5	3357.3	84.3	2651.7	0.68	21.27
27.5-28.0	3329.6	85.0	2736.7	0.68	21.96
28.0-28.5	3301.5	85.7	2822.4	0.69	22.64
28.5-29.0	3273.1	86.3	2908.8	0.69	23.34
29.0-29.5	3244.5	86.9	2995.7	0.70	24.03
29.5-30.0	3215.5	87.5	3083.2	0.70	24.74
30.0-30.5	3186.1	88.0	3171.2	0.71	25.44
30.5-31.0	3156.4	88.5	3259.7	0.71	26.15
31.0-31.5	3126.7	88.9	3348.6	0.71	26.87
31.5-32.0	3096.6	89.3	3437.9	0.72	27.58
32.0-32.5	3066.3	89.7	3527.7	0.72	28.30
32.5-33.0	3035.9	90.0	3617.7	0.72	29.02
33.0-33.5	3005.2	90.3	3708.1	0.72	29.75
33.5-34.0	2974.2	90.6	3798.7	0.73	30.48
34.0-34.5	2943.1	90.8	3889.5	0.73	31.20
34.5-35.0	2912.0	91.0	3980.5	0.73	31.93
35.0-35.5	2880.9	91.2	4071.7	0.73	32.67
35.5-36.0	2849.8	91.3	4163.0	0.73	33.40

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-36.5	2818.5	91.4	4254.3	0.73	34.13
36.5-37.0	2787.0	91.4	4345.8	0.73	34.87
37.0-37.5	2755.4	91.4	4437.2	0.73	35.60
37.5-38.0	2723.9	91.4	4528.7	0.73	36.33
38.0-38.5	2692.5	91.4	4620.1	0.73	37.07
38.5-39.0	2661.2	91.3	4711.4	0.73	37.80
39.0-39.5	2629.8	91.2	4802.6	0.73	38.53
39.5-40.0	2598.4	91.1	4893.7	0.73	39.26
40.0-40.5	2567.0	90.9	4984.7	0.73	39.99
40.5-41.0	2535.5	90.8	5075.4	0.73	40.72
41.0-41.5	2504.0	90.5	5165.9	0.73	41.45
41.5-42.0	2472.4	90.3	5256.2	0.72	42.17
42.0-42.5	2441.0	90.0	5346.2	0.72	42.89
42.5-43.0	2409.5	89.7	5435.9	0.72	43.61
43.0-43.5	2378.1	89.3	5525.2	0.72	44.33
43.5-44.0	2346.5	89.0	5614.2	0.71	45.04
44.0-44.5	2315.1	88.6	5702.8	0.71	45.75
44.5-45.0	2283.7	88.2	5790.9	0.71	46.46
45.0-45.5	2252.4	87.7	5878.6	0.70	47.16
45.5-46.0	2221.0	87.2	5965.9	0.70	47.86
46.0-46.5	2189.7	86.7	6052.6	0.70	48.56
46.5-47.0	2158.4	86.2	6138.8	0.69	49.25
47.0-47.5	2127.1	85.6	6224.4	0.69	49.94
47.5-48.0	2095.7	85.1	6309.5	0.68	50.62
48.0-48.5	2064.3	84.4	6393.9	0.68	51.30
48.5-49.0	2033.0	83.8	6477.7	0.67	51.97
49.0-49.5	2001.7	83.1	6560.9	0.67	52.64
49.5-50.0	1970.5	82.5	6643.4	0.66	53.30
50.0-50.5	1939.4	81.8	6725.1	0.66	53.95
50.5-51.0	1908.4	81.0	6806.2	0.65	54.60
51.0-51.5	1877.4	80.3	6886.4	0.64	55.25
51.5-52.0	1846.4	79.5	6965.9	0.64	55.89
52.0-52.5	1815.6	78.7	7044.7	0.63	56.52
52.5-53.0	1784.9	77.9	7122.6	0.62	57.14
53.0-53.5	1754.2	77.1	7199.6	0.62	57.76
53.5-54.0	1723.7	76.2	7275.8	0.61	58.37

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
54.0-54.5	1693.2	75.3	7351.2	0.60	58.98
54.5-55.0	1662.7	74.5	7425.6	0.60	59.57
55.0-55.5	1632.2	73.5	7499.2	0.59	60.16
55.5-56.0	1601.8	72.6	7571.8	0.58	60.75
56.0-56.5	1571.5	71.6	7643.4	0.57	61.32
56.5-57.0	1541.5	70.7	7714.1	0.57	61.89
57.0-57.5	1511.5	69.7	7783.8	0.56	62.45
57.5-58.0	1481.7	68.7	7852.5	0.55	63.00
58.0-58.5	1452.0	67.7	7920.2	0.54	63.54
58.5-59.0	1422.4	66.7	7986.9	0.53	64.08
59.0-59.5	1393.0	65.6	8052.5	0.53	64.60
59.5-60.0	1363.7	64.6	8117.1	0.52	65.12
60.0-60.5	1334.5	63.5	8180.7	0.51	65.63
60.5-61.0	1305.3	62.4	8243.1	0.50	66.13
61.0-61.5	1276.2	61.3	8304.4	0.49	66.62
61.5-62.0	1247.1	60.2	8364.7	0.48	67.11
62.0-62.5	1218.2	59.1	8423.8	0.47	67.58
62.5-63.0	1189.4	58.0	8481.8	0.47	68.05
63.0-63.5	1160.8	56.8	8538.6	0.46	68.50
63.5-64.0	1132.2	55.7	8594.3	0.45	68.95
64.0-64.5	1103.6	54.5	8648.8	0.44	69.39
64.5-65.0	1075.2	53.3	8702.1	0.43	69.82
65.0-65.5	1047.1	52.1	8754.3	0.42	70.23
65.5-66.0	1019.6	51.0	8805.2	0.41	70.64
66.0-66.5	992.6	49.8	8855.0	0.40	71.04
66.5-67.0	965.9	48.7	8903.7	0.39	71.43
67.0-67.5	939.5	47.5	8951.2	0.38	71.81
67.5-68.0	913.3	46.3	8997.6	0.37	72.19
68.0-68.5	887.4	45.2	9042.8	0.36	72.55
68.5-69.0	861.8	44.0	9086.8	0.35	72.90
69.0-69.5	836.4	42.9	9129.7	0.34	73.25
69.5-70.0	811.3	41.7	9171.4	0.33	73.58
70.0-70.5	786.5	40.6	9212.0	0.33	73.91
70.5-71.0	762.3	39.5	9251.5	0.32	74.22
71.0-71.5	738.6	38.3	9289.8	0.31	74.53
71.5-72.0	715.2	37.2	9327.1	0.30	74.83

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-72.5	692.1	36.1	9363.2	0.29	75.12
72.5-73.0	669.3	35.0	9398.2	0.28	75.40
73.0-73.5	646.8	34.0	9432.2	0.27	75.67
73.5-74.0	624.6	32.9	9465.1	0.26	75.94
74.0-74.5	602.7	31.8	9496.9	0.26	76.19
74.5-75.0	580.9	30.7	9527.6	0.25	76.44
75.0-75.5	559.5	29.7	9557.3	0.24	76.68
75.5-76.0	538.2	28.6	9585.9	0.23	76.91
76.0-76.5	517.1	27.5	9613.4	0.22	77.13
76.5-77.0	496.1	26.5	9639.9	0.21	77.34
77.0-77.5	475.3	25.4	9665.3	0.20	77.54
77.5-78.0	454.8	24.4	9689.7	0.20	77.74
78.0-78.5	434.3	23.3	9713.0	0.19	77.93
78.5-79.0	414.2	22.3	9735.3	0.18	78.10
79.0-79.5	394.2	21.2	9756.5	0.17	78.27
79.5-80.0	374.5	20.2	9776.7	0.16	78.44
80.0-80.5	354.8	19.2	9795.9	0.15	78.59
80.5-81.0	335.2	18.1	9814.0	0.15	78.74
81.0-81.5	315.8	17.1	9831.1	0.14	78.87
81.5-82.0	296.7	16.1	9847.2	0.13	79.00
82.0-82.5	278.0	15.1	9862.3	0.12	79.12
82.5-83.0	259.6	14.1	9876.5	0.11	79.24
83.0-83.5	241.3	13.1	9889.6	0.11	79.34
83.5-84.0	223.3	12.2	9901.8	0.10	79.44
84.0-84.5	205.6	11.2	9913.0	0.09	79.53
84.5-85.0	188.2	10.3	9923.3	0.08	79.61
85.0-85.5	171.1	9.4	9932.6	0.08	79.69
85.5-86.0	154.1	8.4	9941.1	0.07	79.76
86.0-86.5	137.3	7.5	9948.6	0.06	79.82
86.5-87.0	120.7	6.6	9955.2	0.05	79.87
87.0-87.5	104.3	5.7	9960.9	0.05	79.91
87.5-88.0	88.0	4.8	9965.7	0.04	79.95
88.0-88.5	71.9	3.9	9969.7	0.03	79.98
88.5-89.0	56.1	3.1	9972.7	0.02	80.01
89.0-89.5	40.2	2.2	9974.9	0.02	80.03
89.5-90.0	25.4	1.4	9976.3	0.01	80.04

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 5)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
90.0-90.5	26.9	1.5	9977.8	0.01	80.05
90.5-91.0	36.3	2.0	9979.8	0.02	80.07
91.0-91.5	38.1	2.1	9981.9	0.02	80.08
91.5-92.0	40.0	2.2	9984.1	0.02	80.10
92.0-92.5	41.9	2.3	9986.4	0.02	80.12
92.5-93.0	44.1	2.4	9988.8	0.02	80.14
93.0-93.5	46.3	2.5	9991.3	0.02	80.16
93.5-94.0	48.5	2.7	9994.0	0.02	80.18
94.0-94.5	50.8	2.8	9996.7	0.02	80.20
94.5-95.0	53.2	2.9	9999.7	0.02	80.23
95.0-95.5	55.7	3.0	10002.7	0.02	80.25
95.5-96.0	58.3	3.2	10005.9	0.03	80.28
96.0-96.5	61.0	3.3	10009.2	0.03	80.30
96.5-97.0	63.7	3.5	10012.7	0.03	80.33
97.0-97.5	66.5	3.6	10016.3	0.03	80.36
97.5-98.0	69.4	3.8	10020.0	0.03	80.39
98.0-98.5	72.3	3.9	10024.0	0.03	80.42
98.5-99.0	75.3	4.1	10028.1	0.03	80.45
99.0-99.5	78.4	4.2	10032.3	0.03	80.49
99.5-100.0	81.6	4.4	10036.7	0.04	80.52
100.0-100.5	84.9	4.6	10041.3	0.04	80.56
100.5-101.0	88.2	4.8	10046.0	0.04	80.60
101.0-101.5	91.6	4.9	10051.0	0.04	80.64
101.5-102.0	95.1	5.1	10056.1	0.04	80.68
102.0-102.5	98.7	5.3	10061.4	0.04	80.72
102.5-103.0	102.4	5.5	10066.8	0.04	80.76
103.0-103.5	106.2	5.7	10072.5	0.05	80.81
103.5-104.0	110.1	5.9	10078.4	0.05	80.86
104.0-104.5	114.1	6.1	10084.4	0.05	80.91
104.5-105.0	118.1	6.3	10090.7	0.05	80.96
105.0-105.5	122.3	6.5	10097.2	0.05	81.01
105.5-106.0	126.5	6.7	10103.8	0.05	81.06
106.0-106.5	130.9	6.9	10110.7	0.06	81.12
106.5-107.0	135.3	7.1	10117.8	0.06	81.17
107.0-107.5	140.0	7.3	10125.2	0.06	81.23
107.5-108.0	144.7	7.6	10132.7	0.06	81.29

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 6)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-108.5	149.6	7.8	10140.5	0.06	81.36
108.5-109.0	154.7	8.0	10148.5	0.06	81.42
109.0-109.5	160.0	8.3	10156.8	0.07	81.49
109.5-110.0	165.5	8.5	10165.4	0.07	81.55
110.0-110.5	171.3	8.8	10174.2	0.07	81.63
110.5-111.0	177.4	9.1	10183.3	0.07	81.70
111.0-111.5	183.5	9.4	10192.6	0.08	81.77
111.5-112.0	189.8	9.7	10202.3	0.08	81.85
112.0-112.5	196.1	10.0	10212.3	0.08	81.93
112.5-113.0	202.7	10.2	10222.5	0.08	82.01
113.0-113.5	209.4	10.5	10233.1	0.08	82.10
113.5-114.0	216.2	10.8	10243.9	0.09	82.18
114.0-114.5	223.2	11.2	10255.1	0.09	82.27
114.5-115.0	230.4	11.5	10266.5	0.09	82.37
115.0-115.5	237.9	11.8	10278.3	0.09	82.46
115.5-116.0	245.6	12.1	10290.5	0.10	82.56
116.0-116.5	253.3	12.5	10302.9	0.10	82.66
116.5-117.0	261.1	12.8	10315.7	0.10	82.76
117.0-117.5	269.1	13.1	10328.8	0.11	82.87
117.5-118.0	277.1	13.4	10342.3	0.11	82.97
118.0-118.5	285.2	13.8	10356.0	0.11	83.08
118.5-119.0	293.3	14.1	10370.1	0.11	83.20
119.0-119.5	301.6	14.4	10384.6	0.12	83.31
119.5-120.0	309.9	14.8	10399.3	0.12	83.43
120.0-120.5	318.4	15.1	10414.4	0.12	83.55
120.5-121.0	327.0	15.4	10429.8	0.12	83.68
121.0-121.5	335.6	15.7	10445.6	0.13	83.80
121.5-122.0	344.4	16.1	10461.6	0.13	83.93
122.0-122.5	353.2	16.4	10478.0	0.13	84.06
122.5-123.0	362.1	16.7	10494.7	0.13	84.20
123.0-123.5	371.2	17.0	10511.7	0.14	84.33
123.5-124.0	380.3	17.3	10529.0	0.14	84.47
124.0-124.5	389.4	17.7	10546.7	0.14	84.61
124.5-125.0	398.7	18.0	10564.7	0.14	84.76
125.0-125.5	408.0	18.3	10582.9	0.15	84.90
125.5-126.0	417.4	18.6	10601.5	0.15	85.05

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 7)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
126.0-126.5	426.8	18.9	10620.4	0.15	85.21
126.5-127.0	436.3	19.2	10639.5	0.15	85.36
127.0-127.5	445.8	19.5	10659.0	0.16	85.51
127.5-128.0	455.4	19.7	10678.7	0.16	85.67
128.0-128.5	465.0	20.0	10698.8	0.16	85.83
128.5-129.0	474.6	20.3	10719.1	0.16	86.00
129.0-129.5	484.2	20.6	10739.6	0.16	86.16
129.5-130.0	493.8	20.8	10760.4	0.17	86.33
130.0-130.5	503.5	21.1	10781.5	0.17	86.50
130.5-131.0	513.1	21.3	10802.8	0.17	86.67
131.0-131.5	522.7	21.5	10824.4	0.17	86.84
131.5-132.0	532.3	21.8	10846.1	0.17	87.02
132.0-132.5	541.8	22.0	10868.1	0.18	87.19
132.5-133.0	551.3	22.2	10890.3	0.18	87.37
133.0-133.5	560.7	22.4	10912.7	0.18	87.55
133.5-134.0	570.0	22.6	10935.3	0.18	87.73
134.0-134.5	579.2	22.7	10958.0	0.18	87.91
134.5-135.0	588.3	22.9	10980.9	0.18	88.10
135.0-135.5	597.2	23.1	11004.0	0.18	88.28
135.5-136.0	606.1	23.2	11027.2	0.19	88.47
136.0-136.5	614.9	23.3	11050.5	0.19	88.66
136.5-137.0	623.8	23.4	11073.9	0.19	88.84
137.0-137.5	632.6	23.5	11097.5	0.19	89.03
137.5-138.0	641.3	23.6	11121.1	0.19	89.22
138.0-138.5	650.0	23.7	11144.9	0.19	89.41
138.5-139.0	658.7	23.8	11168.7	0.19	89.60
139.0-139.5	667.3	23.9	11192.6	0.19	89.80
139.5-140.0	675.9	23.9	11216.5	0.19	89.99
140.0-140.5	684.3	24.0	11240.5	0.19	90.18
140.5-141.0	692.6	24.0	11264.5	0.19	90.37
141.0-141.5	700.8	24.1	11288.6	0.19	90.57
141.5-142.0	708.9	24.1	11312.6	0.19	90.76
142.0-142.5	716.8	24.1	11336.7	0.19	90.95
142.5-143.0	724.7	24.1	11360.7	0.19	91.14
143.0-143.5	732.4	24.0	11384.8	0.19	91.34
143.5-144.0	740.1	24.0	11408.8	0.19	91.53

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 8)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-144.5	747.5	23.9	11432.7	0.19	91.72
144.5-145.0	754.8	23.9	11456.6	0.19	91.91
145.0-145.5	761.9	23.8	11480.4	0.19	92.11
145.5-146.0	769.0	23.7	11504.1	0.19	92.30
146.0-146.5	775.9	23.6	11527.8	0.19	92.49
146.5-147.0	782.8	23.5	11551.3	0.19	92.67
147.0-147.5	789.5	23.4	11574.7	0.19	92.86
147.5-148.0	796.1	23.3	11598.0	0.19	93.05
148.0-148.5	802.7	23.2	11621.2	0.19	93.23
148.5-149.0	809.2	23.0	11644.2	0.18	93.42
149.0-149.5	815.8	22.9	11667.1	0.18	93.60
149.5-150.0	822.5	22.7	11689.8	0.18	93.78
150.0-150.5	829.2	22.6	11712.4	0.18	93.97
150.5-151.0	836.0	22.4	11734.8	0.18	94.15
151.0-151.5	842.7	22.2	11757.0	0.18	94.32
151.5-152.0	849.4	22.0	11779.0	0.18	94.50
152.0-152.5	856.1	21.9	11800.9	0.18	94.68
152.5-153.0	862.7	21.7	11822.5	0.17	94.85
153.0-153.5	869.1	21.4	11844.0	0.17	95.02
153.5-154.0	875.4	21.2	11865.2	0.17	95.19
154.0-154.5	881.4	21.0	11886.2	0.17	95.36
154.5-155.0	887.1	20.7	11907.0	0.17	95.53
155.0-155.5	892.3	20.5	11927.4	0.16	95.69
155.5-156.0	897.2	20.2	11947.6	0.16	95.85
156.0-156.5	901.7	19.9	11967.6	0.16	96.01
156.5-157.0	906.0	19.6	11987.2	0.16	96.17
157.0-157.5	910.0	19.3	12006.5	0.15	96.33
157.5-158.0	913.8	19.0	12025.4	0.15	96.48
158.0-158.5	917.4	18.6	12044.1	0.15	96.63
158.5-159.0	920.7	18.3	12062.4	0.15	96.77
159.0-159.5	923.9	17.9	12080.3	0.14	96.92
159.5-160.0	926.9	17.6	12097.9	0.14	97.06
160.0-160.5	929.5	17.2	12115.1	0.14	97.20
160.5-161.0	932.1	16.8	12132.0	0.14	97.33
161.0-161.5	934.5	16.5	12148.5	0.13	97.46
161.5-162.0	937.0	16.1	12164.5	0.13	97.59

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Zonal Lumen (Continue 9)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
162.0-162.5	939.4	15.7	12180.2	0.13	97.72
162.5-163.0	941.9	15.3	12195.6	0.12	97.84
163.0-163.5	944.5	14.9	12210.5	0.12	97.96
163.5-164.0	947.3	14.5	12225.0	0.12	98.08
164.0-164.5	950.2	14.1	12239.2	0.11	98.19
164.5-165.0	953.3	13.7	12252.9	0.11	98.30
165.0-165.5	956.5	13.4	12266.3	0.11	98.41
165.5-166.0	959.8	13.0	12279.2	0.10	98.51
166.0-166.5	963.1	12.6	12291.8	0.10	98.61
166.5-167.0	966.4	12.1	12303.9	0.10	98.71
167.0-167.5	969.8	11.7	12315.7	0.09	98.81
167.5-168.0	973.1	11.3	12327.0	0.09	98.90
168.0-168.5	976.4	10.9	12337.9	0.09	98.98
168.5-169.0	979.6	10.5	12348.4	0.08	99.07
169.0-169.5	983.0	10.1	12358.4	0.08	99.15
169.5-170.0	986.4	9.6	12368.0	0.08	99.23
170.0-170.5	990.0	9.2	12377.2	0.07	99.30
170.5-171.0	993.8	8.8	12386.0	0.07	99.37
171.0-171.5	997.7	8.3	12394.3	0.07	99.44
171.5-172.0	1001.6	7.9	12402.2	0.06	99.50
172.0-172.5	1005.5	7.4	12409.6	0.06	99.56
172.5-173.0	1009.2	7.0	12416.6	0.06	99.62
173.0-173.5	1012.6	6.5	12423.1	0.05	99.67
173.5-174.0	1015.7	6.1	12429.2	0.05	99.72
174.0-174.5	1018.4	5.6	12434.8	0.04	99.76
174.5-175.0	1020.8	5.1	12439.9	0.04	99.80
175.0-175.5	1023.0	4.6	12444.6	0.04	99.84
175.5-176.0	1025.0	4.2	12448.7	0.03	99.87
176.0-176.5	1026.8	3.7	12452.4	0.03	99.90
176.5-177.0	1028.5	3.2	12455.6	0.03	99.93
177.0-177.5	1030.1	2.7	12458.3	0.02	99.95
177.5-178.0	1031.5	2.2	12460.5	0.02	99.97
178.0-178.5	1032.9	1.7	12462.3	0.01	99.98
178.5-179.0	1034.2	1.2	12463.5	0.01	99.99
179.0-179.5	1035.4	0.7	12464.2	0.01	100.00
179.5-180.0	1035.9	0.2	12464.5	0.00	100.00

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4252.2	4251.1	4250.0	4248.9	4247.8	4246.7	4245.6	4244.5	4243.8	4242.7
G1.0	4252.9	4250.7	4248.5	4246.3	4244.1	4241.9	4240.1	4237.9	4236.1	4234.6
G1.5	4249.6	4246.7	4243.4	4240.5	4237.9	4235.0	4232.4	4230.2	4228.0	4225.9
G2.0	4246.7	4242.7	4238.6	4235.0	4231.3	4227.7	4224.4	4221.1	4218.5	4215.6
G2.5	4242.3	4237.2	4232.4	4228.0	4223.7	4219.6	4216.0	4212.7	4209.0	4205.8
G3.0	4237.5	4232.1	4226.2	4221.1	4216.0	4211.2	4206.9	4202.8	4199.2	4195.9
G3.5	4235.0	4228.0	4221.5	4214.9	4209.0	4203.2	4198.1	4193.3	4188.9	4185.3
G4.0	4232.4	4224.4	4216.7	4209.0	4202.1	4195.5	4189.3	4183.8	4179.1	4174.7
G4.5	4229.9	4220.7	4212.0	4203.6	4195.5	4187.8	4180.9	4174.7	4169.2	4164.5
G5.0	4227.7	4217.4	4207.6	4198.1	4188.9	4180.5	4172.5	4165.2	4159.0	4153.9
G5.5	4222.9	4212.3	4201.7	4191.9	4182.0	4173.2	4164.5	4156.4	4149.1	4142.9
G6.0	4218.5	4206.9	4195.5	4184.9	4174.7	4165.2	4156.1	4147.3	4139.3	4132.3
G6.5	4211.2	4198.8	4187.5	4176.9	4166.7	4157.2	4147.3	4138.2	4129.8	4122.1
G7.0	4203.6	4190.8	4179.1	4167.8	4157.5	4147.7	4138.5	4129.0	4120.3	4111.8
G7.5	4193.7	4180.5	4168.5	4157.5	4148.0	4137.8	4128.3	4119.9	4110.8	4100.9
G8.0	4183.8	4170.3	4157.9	4146.6	4136.3	4127.2	4118.8	4109.3	4100.5	4089.9
G8.5	4173.6	4159.3	4146.2	4134.9	4125.0	4115.5	4107.1	4099.4	4088.5	4078.6
G9.0	4163.4	4148.4	4134.9	4122.8	4112.2	4103.4	4095.4	4086.6	4076.0	4065.8
G9.5	4153.9	4137.8	4123.2	4110.4	4099.8	4090.7	4083.0	4072.7	4062.2	4053.0
G10.0	4144.0	4127.2	4111.8	4098.3	4086.6	4077.5	4069.5	4057.8	4047.5	4039.1
G10.5	4133.4	4115.9	4099.8	4085.9	4073.8	4064.0	4053.7	4041.7	4032.6	4023.8
G11.0	4122.8	4104.5	4088.1	4073.5	4060.7	4050.1	4037.7	4025.6	4015.7	4008.4
G11.5	4108.6	4090.7	4074.6	4060.7	4047.9	4036.9	4022.0	4009.2	3999.3	3992.4
G12.0	4094.7	4076.4	4060.7	4046.8	4034.7	4022.7	4006.2	3992.7	3982.1	3975.2
G12.5	4077.1	4059.6	4044.6	4032.6	4020.9	4007.3	3990.5	3976.3	3965.3	3957.6
G13.0	4059.6	4042.1	4027.8	4016.1	4006.2	3991.6	3974.1	3959.8	3948.5	3940.5
G13.5	4043.9	4025.6	4010.6	3999.7	3990.5	3974.5	3957.3	3943.4	3931.7	3923.7
G14.0	4028.2	4009.2	3993.8	3982.1	3974.1	3955.8	3939.4	3925.5	3914.9	3906.5
G14.5	4012.5	3992.7	3976.6	3964.2	3955.5	3936.5	3920.0	3907.6	3897.7	3892.2
G15.0	3996.4	3976.3	3959.8	3947.4	3935.7	3916.0	3900.6	3888.2	3879.1	3878.0
G15.5	3978.8	3958.7	3942.7	3930.2	3916.0	3895.5	3879.8	3868.1	3860.8	3863.4
G16.0	3961.3	3940.8	3924.8	3912.7	3896.6	3875.4	3859.4	3847.7	3844.7	3848.4
G16.5	3942.3	3922.2	3906.5	3895.2	3876.5	3855.0	3838.5	3826.8	3827.9	3833.0
G17.0	3923.7	3903.2	3887.5	3876.5	3856.1	3834.1	3817.7	3806.0	3811.1	3818.1
G17.5	3902.1	3882.4	3867.8	3857.5	3834.5	3812.9	3796.5	3788.1	3794.7	3802.4
G18.0	3880.5	3861.2	3847.3	3837.8	3812.9	3790.7	3774.6	3770.6	3778.2	3786.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G18.5	3858.3	3838.9	3826.1	3818.1	3789.9	3768.0	3752.3	3753.0	3761.8	3771.3
G19.0	3836.0	3816.6	3803.8	3795.4	3766.9	3745.0	3729.3	3734.8	3745.0	3755.6
G19.5	3814.4	3794.7	3781.5	3770.9	3742.4	3720.5	3706.3	3716.5	3728.2	3739.9
G20.0	3793.2	3772.8	3759.2	3746.4	3717.2	3695.7	3686.2	3697.8	3711.0	3724.5
G20.5	3770.6	3750.1	3736.9	3721.2	3692.0	3670.1	3665.3	3679.2	3693.5	3708.4
G21.0	3747.9	3727.8	3714.7	3696.8	3666.8	3644.6	3644.4	3660.2	3676.3	3690.2
G21.5	3722.3	3703.3	3692.0	3671.9	3641.2	3619.0	3623.2	3640.5	3658.4	3669.7
G22.0	3697.1	3678.8	3668.3	3646.5	3615.4	3593.5	3602.0	3621.0	3640.7	3648.2
G22.5	3670.8	3652.8	3643.9	3620.2	3589.3	3567.2	3581.0	3601.1	3623.1	3626.7
G23.0	3644.2	3626.7	3618.3	3593.2	3561.6	3543.3	3560.1	3581.0	3600.9	3605.0
G23.5	3616.4	3599.8	3592.6	3565.0	3533.7	3520.0	3538.8	3561.0	3577.4	3582.6
G24.0	3588.6	3572.7	3566.4	3536.7	3505.0	3496.0	3517.3	3540.8	3553.4	3560.1
G24.5	3562.6	3546.2	3540.3	3508.0	3476.3	3472.0	3495.7	3520.7	3528.8	3537.3
G25.0	3536.7	3519.7	3513.6	3479.2	3447.3	3447.9	3473.2	3500.5	3504.2	3513.8
G25.5	3511.6	3493.9	3487.0	3449.9	3418.2	3423.8	3450.9	3475.3	3479.2	3490.1
G26.0	3486.5	3468.3	3461.1	3420.6	3388.9	3399.6	3428.0	3449.4	3454.1	3466.3
G26.5	3459.2	3442.0	3435.2	3391.9	3359.5	3375.6	3404.9	3422.5	3428.9	3442.0
G27.0	3431.9	3415.5	3408.6	3363.1	3330.3	3351.6	3382.0	3395.4	3403.2	3417.8
G27.5	3402.8	3387.7	3380.7	3333.9	3303.0	3327.7	3359.3	3367.7	3377.2	3393.3
G28.0	3373.6	3359.5	3351.3	3304.8	3277.7	3303.8	3336.8	3339.9	3350.9	3368.5
G28.5	3342.5	3330.1	3321.7	3274.0	3251.8	3279.5	3310.9	3312.1	3323.6	3343.8
G29.0	3311.4	3300.3	3290.5	3243.1	3225.7	3255.3	3282.9	3284.8	3296.2	3319.3
G29.5	3281.7	3270.4	3259.4	3211.2	3198.8	3230.7	3254.1	3257.6	3269.0	3294.2
G30.0	3252.1	3240.4	3227.0	3178.9	3172.1	3206.2	3224.8	3230.0	3243.1	3269.4
G30.5	3222.8	3211.1	3194.8	3146.8	3144.5	3181.2	3195.4	3201.6	3217.3	3244.8
G31.0	3193.6	3182.0	3163.5	3114.9	3117.1	3156.4	3165.9	3173.1	3191.8	3219.7
G31.5	3162.8	3152.6	3132.1	3083.1	3090.2	3131.1	3136.3	3144.0	3166.6	3194.8
G32.0	3132.1	3123.0	3100.6	3051.3	3063.3	3105.5	3106.2	3114.9	3141.5	3170.3
G32.5	3099.3	3092.2	3069.0	3018.9	3036.5	3078.5	3075.8	3085.9	3115.8	3145.4
G33.0	3066.5	3061.1	3036.0	2985.8	3009.9	3046.8	3045.2	3058.6	3090.4	3120.6
G33.5	3033.0	3029.1	3002.9	2952.1	2983.0	3015.2	3014.2	3031.4	3065.4	3093.4
G34.0	2999.4	2996.8	2968.8	2917.8	2955.8	2984.0	2983.3	3003.9	3039.4	3056.4
G34.5	2967.7	2964.6	2934.4	2885.5	2928.4	2952.7	2952.5	2976.5	3013.6	3019.6
G35.0	2935.9	2932.5	2900.2	2855.3	2900.3	2921.0	2921.8	2949.3	2987.9	2983.0
G35.5	2903.5	2901.0	2866.1	2825.5	2872.3	2888.9	2891.1	2922.0	2962.0	2946.4
G36.0	2871.2	2869.8	2832.5	2796.4	2844.0	2856.3	2860.1	2895.0	2935.3	2909.6
G36.5	2837.6	2838.2	2799.2	2767.5	2815.9	2823.2	2831.5	2868.1	2896.9	2872.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	2804.0	2806.5	2765.3	2738.5	2787.9	2790.0	2802.3	2841.5	2858.6	2835.1
G37.5	2770.1	2774.2	2731.3	2709.6	2759.9	2756.7	2773.3	2815.0	2820.4	2797.1
G38.0	2736.3	2741.6	2696.6	2680.0	2732.6	2723.5	2744.6	2788.7	2782.2	2759.2
G38.5	2702.2	2708.8	2661.6	2650.7	2700.6	2690.6	2715.8	2762.7	2743.8	2721.5
G39.0	2668.0	2675.9	2626.6	2620.9	2667.6	2657.9	2687.3	2736.9	2705.6	2683.9
G39.5	2635.2	2643.2	2591.5	2591.2	2634.6	2625.5	2659.0	2700.8	2667.6	2650.5
G40.0	2602.3	2610.4	2556.6	2561.4	2601.2	2593.2	2630.9	2661.9	2629.7	2620.5
G40.5	2570.5	2578.3	2522.0	2531.7	2567.2	2561.0	2603.1	2622.7	2592.0	2590.6
G41.0	2538.8	2546.6	2487.7	2502.3	2533.2	2529.9	2575.6	2583.1	2554.3	2560.9
G41.5	2507.1	2515.3	2453.8	2473.1	2498.8	2500.7	2548.2	2543.7	2516.4	2531.6
G42.0	2475.4	2484.4	2420.2	2444.2	2464.6	2471.4	2521.3	2504.5	2479.7	2502.3
G42.5	2441.8	2453.4	2386.6	2415.6	2430.5	2442.3	2494.5	2465.6	2449.5	2473.3
G43.0	2408.2	2422.4	2352.9	2387.1	2396.5	2413.3	2468.1	2426.9	2419.1	2444.5
G43.5	2373.6	2390.8	2318.6	2358.8	2362.7	2384.5	2429.8	2388.5	2389.2	2415.9
G44.0	2339.0	2358.6	2284.0	2330.6	2329.0	2356.0	2391.4	2350.4	2359.5	2387.5
G44.5	2305.9	2326.1	2248.7	2302.5	2295.4	2327.7	2352.5	2312.5	2330.1	2359.2
G45.0	2272.8	2293.1	2213.7	2274.6	2262.1	2299.7	2313.6	2274.9	2300.8	2327.1
G45.5	2240.3	2259.2	2179.8	2246.4	2228.8	2271.9	2274.8	2242.5	2271.9	2291.9
G46.0	2207.8	2225.2	2149.9	2218.4	2195.6	2244.4	2235.9	2213.3	2243.2	2256.8
G46.5	2176.9	2191.6	2120.3	2183.8	2162.4	2217.1	2197.2	2184.0	2214.8	2221.8
G47.0	2146.0	2158.3	2091.1	2149.2	2130.7	2190.0	2158.8	2155.1	2186.7	2186.6
G47.5	2114.9	2125.8	2062.9	2115.3	2101.7	2163.0	2120.7	2126.4	2157.9	2151.2
G48.0	2083.8	2094.0	2034.8	2081.5	2073.1	2132.0	2082.7	2097.7	2122.4	2115.9
G48.5	2051.4	2062.1	2007.0	2048.1	2044.7	2093.9	2045.0	2069.4	2086.9	2080.6
G49.0	2018.8	2030.0	1979.2	2015.1	2016.6	2055.9	2007.4	2041.4	2051.9	2045.4
G49.5	1987.4	1997.3	1950.8	1982.8	1988.8	2018.0	1976.9	2013.6	2017.0	2010.4
G50.0	1956.0	1964.2	1922.5	1951.0	1961.3	1980.2	1948.6	1986.1	1982.3	1977.4
G50.5	1925.3	1931.4	1894.3	1919.0	1934.6	1942.2	1920.6	1958.9	1947.7	1950.3
G51.0	1894.6	1899.1	1866.2	1886.8	1908.0	1904.4	1892.9	1926.5	1913.2	1923.4
G51.5	1863.9	1867.0	1838.5	1854.3	1882.1	1866.9	1865.4	1891.4	1878.7	1896.8
G52.0	1833.3	1835.3	1810.9	1821.6	1856.5	1829.8	1838.3	1856.6	1844.2	1870.4
G52.5	1802.5	1803.7	1783.8	1788.9	1831.1	1792.9	1811.3	1822.1	1809.9	1844.3
G53.0	1771.6	1772.3	1756.8	1756.4	1806.0	1757.0	1784.6	1787.9	1782.9	1818.4
G53.5	1741.2	1740.8	1730.3	1724.1	1781.1	1721.4	1758.2	1753.8	1756.9	1792.8
G54.0	1710.8	1709.5	1704.0	1692.7	1750.0	1689.6	1731.8	1720.0	1731.1	1767.3
G54.5	1680.4	1678.2	1678.0	1661.6	1713.7	1663.3	1705.3	1686.4	1705.7	1742.1
G55.0	1650.0	1647.0	1652.2	1634.9	1677.3	1637.3	1670.5	1652.9	1680.5	1712.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G55.5	1619.6	1615.8	1626.7	1609.4	1641.1	1611.2	1636.0	1619.4	1655.7	1678.4
G56.0	1589.2	1584.4	1601.3	1584.1	1605.2	1585.5	1601.8	1592.0	1631.1	1644.6
G56.5	1560.7	1553.2	1576.0	1559.1	1569.8	1560.1	1568.3	1567.3	1606.8	1611.0
G57.0	1532.1	1522.3	1550.8	1534.2	1534.7	1534.9	1535.2	1542.6	1582.7	1577.4
G57.5	1504.1	1491.8	1520.1	1509.5	1500.3	1510.1	1502.5	1518.3	1554.4	1544.0
G58.0	1476.1	1462.0	1488.5	1485.0	1466.2	1485.5	1470.2	1494.4	1521.0	1510.7
G58.5	1447.1	1432.2	1457.1	1460.5	1432.2	1461.4	1438.1	1470.6	1487.8	1477.4
G59.0	1418.0	1402.4	1426.4	1436.2	1398.3	1435.5	1406.2	1447.1	1454.8	1444.2
G59.5	1389.0	1372.5	1395.7	1412.1	1367.2	1402.7	1379.3	1423.9	1422.1	1413.4
G60.0	1359.9	1342.4	1365.6	1388.2	1342.6	1370.1	1356.3	1400.9	1389.4	1387.0
G60.5	1331.6	1312.3	1335.5	1364.6	1318.3	1337.8	1333.5	1370.8	1356.8	1360.8
G61.0	1303.3	1282.3	1305.4	1340.6	1294.2	1305.8	1311.2	1337.4	1324.3	1334.7
G61.5	1275.2	1252.4	1275.2	1306.2	1270.4	1274.1	1289.1	1304.3	1291.7	1308.9
G62.0	1247.1	1222.7	1245.0	1272.3	1247.0	1242.5	1267.4	1272.0	1264.0	1283.2
G62.5	1220.2	1193.1	1214.6	1238.6	1223.9	1211.1	1246.0	1239.9	1238.7	1257.7
G63.0	1193.3	1164.2	1184.4	1205.3	1201.2	1179.8	1225.0	1208.0	1213.6	1232.4
G63.5	1166.2	1135.4	1154.3	1172.1	1179.0	1153.1	1202.8	1176.3	1188.6	1207.3
G64.0	1139.1	1109.4	1124.4	1139.0	1156.5	1131.6	1170.8	1144.8	1163.9	1178.5
G64.5	1111.4	1085.1	1094.9	1105.8	1124.9	1110.5	1138.8	1116.4	1139.5	1148.1
G65.0	1083.6	1060.8	1072.1	1072.8	1093.4	1089.7	1106.9	1092.6	1115.4	1117.8
G65.5	1056.3	1036.6	1049.6	1040.0	1062.1	1069.3	1075.1	1069.0	1091.4	1087.6
G66.0	1029.0	1012.8	1027.3	1010.3	1030.9	1049.2	1043.5	1045.6	1064.7	1057.8
G66.5	1002.6	989.1	1005.5	988.5	1000.2	1029.5	1012.0	1022.5	1034.6	1028.0
G67.0	976.2	966.1	983.9	967.1	969.6	1010.3	980.8	999.6	1004.7	998.5
G67.5	950.5	943.2	962.7	946.1	939.4	981.2	954.0	976.9	975.0	969.0
G68.0	924.8	921.0	941.8	925.7	913.1	950.2	931.5	954.4	945.5	941.6
G68.5	898.7	898.9	921.4	905.5	893.8	919.3	909.2	927.0	916.2	917.0
G69.0	872.7	877.0	901.1	886.0	875.0	888.5	887.3	898.2	887.0	892.6
G69.5	847.3	855.4	881.6	867.0	856.5	857.7	865.7	869.5	858.1	868.3
G70.0	821.8	834.0	852.0	841.7	838.6	826.8	844.3	841.0	833.3	844.2
G70.5	796.7	812.7	820.8	811.7	820.9	796.6	823.1	812.5	810.2	820.3
G71.0	771.6	792.2	789.7	781.7	803.7	775.6	797.8	784.3	787.3	796.6
G71.5	746.6	771.9	758.5	752.0	776.4	755.3	769.6	756.1	764.6	772.9
G72.0	721.6	752.0	727.5	722.6	746.2	735.2	741.7	731.9	741.9	748.7
G72.5	697.4	724.8	696.8	693.5	716.3	715.3	713.9	710.0	719.5	724.0
G73.0	673.2	697.8	666.5	668.3	686.5	695.8	686.4	688.3	697.1	699.3
G73.5	649.2	670.7	642.2	652.0	656.8	676.7	659.1	666.9	674.2	674.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	625.2	643.8	624.7	636.3	627.5	649.6	633.2	645.6	650.0	650.2
G74.5	601.0	617.0	607.6	621.0	608.6	622.5	612.8	624.6	626.0	625.7
G75.0	576.7	590.2	591.0	606.2	590.0	595.7	592.8	603.7	602.0	601.4
G75.5	551.1	563.2	574.5	591.7	571.9	568.9	572.8	580.0	578.1	577.1
G76.0	525.6	536.2	558.6	560.2	554.1	542.3	553.1	556.4	554.4	557.9
G76.5	500.4	509.1	528.4	528.3	536.8	519.1	533.7	532.8	530.7	539.5
G77.0	475.2	491.2	495.0	496.2	509.7	500.6	513.4	509.4	509.0	521.1
G77.5	451.9	473.9	460.9	463.8	481.9	482.2	490.3	486.1	491.1	502.9
G78.0	428.6	457.5	426.2	438.2	454.1	464.2	467.2	462.8	473.3	484.6
G78.5	405.1	441.3	398.8	419.2	426.0	446.5	444.3	443.1	455.6	466.5
G79.0	381.6	425.8	384.0	400.7	400.8	427.4	421.5	426.0	438.0	448.4
G79.5	358.6	407.0	369.7	382.9	383.4	404.6	398.8	409.0	420.5	429.3
G80.0	335.6	369.6	355.5	357.6	366.7	381.6	380.2	392.1	403.0	409.0
G80.5	314.7	331.2	325.7	325.5	350.7	358.7	363.9	375.3	384.2	388.7
G81.0	293.7	291.6	290.1	293.3	333.2	336.0	347.7	358.6	364.2	368.5
G81.5	274.6	255.3	255.3	261.3	306.1	316.9	331.7	340.5	344.3	348.3
G82.0	255.4	240.6	233.7	243.8	279.0	301.7	315.8	320.9	324.4	328.2
G82.5	237.1	227.0	222.8	227.1	251.8	286.8	299.0	301.4	304.6	308.1
G83.0	218.7	211.6	213.9	210.8	227.5	272.1	279.9	282.0	284.8	288.3
G83.5	201.0	177.8	188.9	189.6	216.4	257.5	260.8	262.6	265.1	269.8
G84.0	183.3	146.5	161.6	167.3	206.0	238.8	241.7	243.2	247.1	251.4
G84.5	166.3	135.9	142.9	145.8	196.0	219.8	222.8	225.0	229.2	233.0
G85.0	149.3	130.6	135.1	135.4	181.7	200.9	204.0	207.8	211.3	214.6
G85.5	133.3	111.4	125.8	128.1	162.5	182.1	187.5	190.6	193.5	196.2
G86.0	117.3	98.2	108.5	120.9	143.8	165.1	171.0	173.4	175.7	177.8
G86.5	103.0	97.3	94.4	108.3	125.5	149.7	154.5	156.3	157.9	159.4
G87.0	88.7	79.8	89.2	95.6	113.5	134.3	138.1	139.2	139.9	140.4
G87.5	74.3	74.6	81.9	84.0	102.4	119.0	121.7	121.5	121.3	121.4
G88.0	59.8	64.7	70.0	75.6	91.5	103.5	104.3	103.6	102.8	102.3
G88.5	47.6	57.9	60.9	67.3	79.4	86.8	86.9	85.6	84.3	83.3
G89.0	35.3	49.4	54.4	57.8	65.6	70.1	69.6	67.7	65.8	64.3
G89.5	26.4	43.0	45.9	47.6	51.9	53.5	52.2	49.8	47.4	45.3
G90.0	19.5	39.2	40.9	41.6	42.4	41.0	38.7	35.5	32.1	29.2
G90.5	44.0	60.5	69.5	73.2	75.6	73.9	70.8	65.9	60.5	55.9
G91.0	39.7	49.7	64.3	70.8	74.0	73.2	71.1	67.2	62.6	58.5
G91.5	37.7	39.4	58.5	68.0	72.4	72.5	71.4	68.6	64.7	61.2
G92.0	35.7	31.5	53.3	64.8	70.8	71.8	71.7	69.9	66.9	63.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G92.5	35.7	29.2	48.6	61.6	69.2	71.1	72.0	71.3	69.0	66.5
G93.0	35.8	29.9	43.5	59.6	67.7	70.4	72.3	72.6	71.1	69.2
G93.5	36.3	30.9	38.3	58.0	66.2	69.8	72.5	74.0	73.2	71.8
G94.0	36.9	31.5	36.2	56.4	64.8	69.1	72.9	75.3	75.4	74.5
G94.5	38.1	32.4	35.3	53.3	63.6	68.7	73.2	76.7	77.5	77.1
G95.0	39.2	34.2	35.7	50.2	62.3	68.5	73.6	78.2	79.7	79.8
G95.5	40.3	34.9	36.3	48.3	61.0	68.3	74.5	79.6	81.9	82.4
G96.0	41.5	35.8	38.1	49.9	59.4	68.1	75.5	81.3	84.1	85.1
G96.5	42.8	38.8	41.1	51.4	57.9	67.9	76.6	83.3	86.4	87.8
G97.0	44.1	42.0	44.0	52.8	56.5	67.3	77.7	85.4	88.9	90.5
G97.5	45.5	43.4	44.8	54.0	57.6	66.7	78.9	87.5	91.5	93.4
G98.0	46.9	44.6	45.5	55.5	59.3	66.2	79.4	89.6	94.0	96.4
G98.5	48.3	45.8	47.6	57.1	61.1	65.7	79.8	91.8	96.6	99.4
G99.0	49.6	49.7	51.6	61.1	63.0	66.8	80.2	93.6	99.2	102.5
G99.5	51.8	54.4	55.9	65.1	65.9	69.6	80.7	94.9	101.9	105.5
G100.0	54.1	59.6	59.6	69.2	69.0	72.4	81.2	96.3	104.3	108.6
G100.5	57.4	65.2	62.0	72.3	72.2	75.3	83.1	97.8	106.4	111.7
G101.0	60.8	68.2	64.4	74.3	75.6	78.4	86.9	99.4	108.6	114.5
G101.5	64.6	71.0	67.0	76.5	80.3	82.2	90.8	101.0	110.8	117.2
G102.0	68.4	73.9	72.0	79.0	85.6	86.1	94.8	103.9	113.0	119.8
G102.5	72.6	77.1	78.6	83.2	91.0	90.0	98.9	108.3	115.3	122.5
G103.0	76.7	80.5	85.4	89.1	96.5	93.9	103.0	112.6	117.6	125.2
G103.5	81.6	84.3	92.4	95.3	101.9	97.9	107.1	117.0	121.4	127.9
G104.0	86.5	90.5	98.9	101.9	105.5	103.1	111.3	121.4	125.9	130.6
G104.5	92.3	96.8	102.4	108.7	109.2	109.2	115.5	125.8	130.5	133.7
G105.0	98.0	103.1	106.2	112.1	112.9	115.4	119.8	130.2	135.1	138.6
G105.5	103.4	109.5	110.0	115.7	116.8	121.6	124.1	134.6	139.8	143.7
G106.0	108.7	115.9	113.9	119.3	120.8	127.8	128.5	139.1	144.5	148.7
G106.5	113.5	122.2	117.9	122.9	127.2	134.1	134.4	143.6	149.3	153.8
G107.0	118.2	128.2	123.4	126.7	133.7	138.3	140.8	148.1	154.1	158.9
G107.5	123.2	134.2	130.4	132.8	140.3	142.6	147.2	152.8	159.1	164.0
G108.0	128.2	140.0	137.5	139.6	146.9	147.0	153.7	157.5	164.1	169.2
G108.5	133.3	144.3	144.6	146.3	153.7	151.4	160.2	162.8	169.2	174.6
G109.0	138.5	148.7	151.8	153.0	159.9	155.9	166.8	169.2	174.3	180.2
G109.5	144.0	153.2	159.0	159.7	163.8	160.5	172.6	175.7	179.5	185.9
G110.0	149.5	157.9	166.3	166.5	167.8	167.2	177.3	182.2	184.8	191.6
G110.5	155.4	162.6	173.2	172.3	171.9	174.2	181.9	188.8	190.6	197.4

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	161.2	167.5	177.7	176.7	176.2	181.2	186.7	195.5	197.6	203.2
G111.5	167.2	172.4	182.2	181.2	180.6	188.2	191.5	202.2	204.6	209.2
G112.0	173.3	177.5	186.8	185.9	185.1	195.3	196.4	208.4	211.7	215.2
G112.5	179.4	182.6	191.6	190.8	191.4	202.5	201.3	213.4	218.9	222.0
G113.0	185.5	188.0	196.4	195.7	198.6	209.3	207.4	218.5	226.1	229.5
G113.5	191.8	193.3	201.5	200.8	206.0	214.0	214.8	223.7	233.4	237.1
G114.0	198.0	198.8	206.6	206.1	213.5	218.9	222.1	228.9	240.8	244.7
G114.5	204.5	204.4	212.0	213.2	221.1	223.9	229.5	234.2	247.3	252.4
G115.0	211.0	210.1	217.4	221.2	228.9	229.1	237.0	239.6	253.0	260.2
G115.5	217.8	215.9	223.0	229.3	236.7	234.4	244.5	245.1	258.7	268.0
G116.0	224.5	222.0	230.4	237.4	244.6	239.8	252.1	251.9	264.6	276.0
G116.5	231.6	228.6	237.9	245.8	250.2	245.4	259.8	259.6	270.5	283.4
G117.0	238.6	236.1	245.5	254.3	255.8	252.6	265.8	267.5	276.5	289.7
G117.5	245.9	243.6	253.2	262.9	261.6	261.2	271.7	275.6	282.7	296.0
G118.0	253.2	251.4	260.9	271.7	267.5	269.9	277.8	283.8	288.9	302.4
G118.5	260.8	259.2	268.7	280.5	273.7	278.8	283.9	292.0	295.8	308.9
G119.0	268.5	267.2	276.8	289.4	279.9	287.8	290.2	300.5	304.4	315.6
G119.5	276.6	275.3	284.9	295.5	286.3	296.9	296.7	309.1	313.1	322.3
G120.0	284.6	283.5	293.3	301.8	293.1	306.2	303.3	317.2	321.8	329.0
G120.5	292.7	291.8	301.8	308.2	299.9	315.6	310.0	324.1	330.6	335.8
G121.0	300.8	300.3	310.3	314.8	309.0	325.1	317.9	331.1	339.5	344.0
G121.5	309.2	308.9	318.8	321.7	319.1	332.7	327.4	338.2	348.5	352.9
G122.0	317.5	317.7	327.6	328.6	329.3	339.8	337.1	345.4	357.5	361.9
G122.5	326.4	326.6	336.5	336.0	339.7	347.0	347.0	352.7	366.6	371.0
G123.0	335.2	335.6	345.6	343.5	350.3	354.4	357.1	360.1	374.8	380.2
G123.5	344.3	344.7	353.3	351.1	361.1	361.9	367.3	367.7	382.3	389.5
G124.0	353.4	353.9	361.1	358.9	372.0	369.5	377.7	375.3	389.8	398.9
G124.5	362.5	363.3	369.2	366.9	383.0	377.3	388.2	383.7	397.5	408.4
G125.0	371.5	372.9	377.4	375.1	394.2	385.3	398.9	394.1	405.1	418.0
G125.5	380.8	382.6	385.7	383.7	405.5	393.4	409.6	404.6	412.8	426.7
G126.0	390.1	392.6	394.2	393.9	416.8	401.6	417.7	415.2	420.6	434.4
G126.5	399.8	402.8	402.8	404.2	426.5	411.7	425.8	425.9	428.6	442.1
G127.0	409.5	413.1	411.5	414.6	434.5	423.1	434.0	436.6	436.5	449.9
G127.5	419.6	423.5	420.3	425.1	442.6	434.5	442.2	447.3	444.6	457.7
G128.0	429.6	433.9	429.2	435.6	450.9	446.2	450.6	458.1	455.0	465.6
G128.5	439.9	444.5	438.2	446.1	459.2	458.0	459.1	468.9	465.5	473.5
G129.0	450.1	455.0	447.2	456.6	467.6	469.8	467.6	479.8	475.9	481.4

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G129.5	460.4	465.6	456.2	467.2	476.2	481.7	476.3	489.7	486.4	489.4
G130.0	470.8	476.2	465.3	477.7	484.8	493.6	485.1	498.0	497.0	497.4
G130.5	481.0	486.8	474.5	488.4	493.6	505.4	494.0	506.3	507.6	507.1
G131.0	491.3	497.5	483.7	499.0	502.4	517.3	503.5	514.7	518.3	517.4
G131.5	501.7	508.1	492.9	509.7	511.4	529.2	515.2	523.2	529.0	527.7
G132.0	512.1	518.8	502.2	520.5	520.4	541.3	527.0	531.6	539.7	537.9
G132.5	522.5	529.4	511.5	531.3	529.5	551.0	538.7	540.2	550.4	548.1
G133.0	532.9	540.0	520.8	542.2	538.4	559.3	550.4	548.8	558.9	558.4
G133.5	543.2	550.7	530.2	552.8	548.2	567.7	562.0	557.5	567.2	568.5
G134.0	553.5	561.4	539.7	563.4	558.5	576.0	573.6	566.2	575.4	578.6
G134.5	563.8	572.1	549.2	571.9	568.8	584.4	585.2	575.0	583.8	588.7
G135.0	574.2	582.6	559.9	580.5	579.1	592.8	596.7	584.7	592.2	598.8
G135.5	584.6	592.4	570.6	589.1	589.4	601.1	608.2	595.9	600.5	607.9
G136.0	595.1	602.0	581.2	597.8	599.6	609.5	619.7	607.2	608.9	615.8
G136.5	605.2	611.5	591.6	606.4	609.7	617.8	631.1	618.5	617.3	623.8
G137.0	615.3	621.0	601.9	614.9	619.6	626.2	642.5	629.7	625.8	631.7
G137.5	625.1	630.5	612.2	623.4	629.5	634.5	650.1	640.8	634.3	639.7
G138.0	634.8	639.9	622.5	631.7	639.3	642.9	657.9	651.8	642.9	647.7
G138.5	644.5	649.0	632.5	640.0	648.9	651.3	665.7	662.7	653.1	655.7
G139.0	654.3	658.1	642.4	648.2	658.6	659.6	673.3	673.6	663.6	663.6
G139.5	663.5	666.8	652.1	656.4	668.0	668.3	681.0	684.6	674.0	671.6
G140.0	672.8	675.6	661.7	664.7	677.4	677.3	688.7	695.4	684.2	679.5
G140.5	681.5	684.4	671.3	672.9	686.6	686.2	696.2	706.1	694.4	687.4
G141.0	690.2	693.3	681.0	681.1	695.6	695.1	703.9	716.0	704.6	696.1
G141.5	699.3	702.2	690.6	689.2	704.6	704.0	711.3	722.7	714.6	705.8
G142.0	708.3	711.0	700.0	697.1	713.3	712.8	718.8	729.4	724.6	715.5
G142.5	717.5	719.7	709.3	705.0	720.6	721.3	726.3	736.2	734.4	725.4
G143.0	726.7	728.2	718.3	712.8	727.8	729.7	733.9	742.9	744.0	735.2
G143.5	735.3	736.4	727.2	720.5	735.0	737.9	741.5	749.6	753.6	745.1
G144.0	743.9	744.5	735.9	728.1	741.8	746.1	749.0	756.4	763.2	754.9
G144.5	752.2	752.6	744.6	735.8	748.7	754.1	756.7	763.0	769.9	764.6
G145.0	760.4	760.6	753.2	743.3	755.5	762.2	764.1	769.7	776.2	774.2
G145.5	768.4	768.4	761.6	750.7	762.3	770.0	771.4	776.2	782.6	783.6
G146.0	776.4	776.2	769.8	758.5	769.1	777.6	778.6	782.7	789.0	792.9
G146.5	784.2	783.7	777.9	766.7	775.7	785.1	785.7	789.2	795.4	802.1
G147.0	792.0	791.2	785.8	774.8	782.3	792.5	792.7	795.6	801.8	808.7
G147.5	799.5	798.4	793.7	782.8	788.7	799.8	799.5	801.9	808.2	814.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	807.0	805.6	801.4	790.7	795.2	805.8	806.2	808.5	814.6	820.6
G148.5	814.1	812.8	809.1	798.5	801.5	811.3	812.7	815.1	820.7	826.6
G149.0	821.3	819.9	816.7	806.2	807.8	816.8	819.3	821.8	826.9	832.5
G149.5	828.4	826.9	824.2	813.7	813.9	822.1	826.0	828.5	833.1	838.5
G150.0	835.5	833.9	831.4	821.1	820.1	827.5	832.8	835.1	839.1	844.3
G150.5	842.7	840.7	838.6	828.1	825.7	833.1	839.6	841.5	845.0	850.1
G151.0	849.8	847.5	845.2	835.1	831.4	838.7	846.4	847.6	850.9	856.0
G151.5	856.6	853.7	851.8	841.8	837.1	844.3	852.8	853.6	856.9	861.7
G152.0	863.2	860.0	858.3	848.4	842.8	850.0	858.8	859.5	862.8	867.3
G152.5	869.1	865.9	864.7	855.0	848.6	855.5	863.4	865.5	868.5	873.0
G153.0	875.1	872.0	871.3	861.7	854.9	861.1	868.2	871.4	874.2	878.4
G153.5	881.2	878.1	877.6	868.4	861.7	866.5	873.0	877.2	879.8	883.2
G154.0	887.3	884.2	883.7	875.1	868.5	871.6	877.8	883.2	885.0	888.0
G154.5	893.4	890.3	889.7	881.5	875.1	876.8	882.6	888.7	890.1	892.7
G155.0	899.5	896.3	895.3	888.0	881.4	881.8	887.3	894.0	895.1	897.3
G155.5	905.5	902.1	901.0	893.9	887.5	886.6	892.1	898.2	899.9	902.0
G156.0	911.5	907.9	906.2	899.8	893.2	891.5	896.6	902.2	904.5	906.9
G156.5	917.0	913.2	911.3	905.4	899.0	896.4	901.1	906.3	909.2	911.8
G157.0	922.6	918.6	916.3	910.9	904.6	901.2	905.5	910.0	914.0	916.7
G157.5	927.5	923.5	921.3	916.4	910.3	906.2	909.8	913.7	918.6	921.4
G158.0	932.4	928.4	926.1	921.7	915.7	911.8	914.1	917.5	922.5	926.1
G158.5	937.1	933.2	930.8	927.0	921.1	917.1	918.1	921.3	926.4	930.7
G159.0	941.8	937.9	935.5	932.2	926.3	922.2	922.2	925.1	930.2	935.0
G159.5	946.3	942.4	940.1	937.2	931.3	927.0	925.9	928.9	933.8	938.8
G160.0	950.8	947.0	944.5	941.8	935.9	931.7	929.5	932.8	937.5	942.0
G160.5	955.2	951.4	948.7	946.2	940.3	936.1	933.3	936.7	941.0	945.2
G161.0	959.7	955.6	952.5	950.1	944.6	940.5	937.9	940.6	944.4	948.4
G161.5	963.6	959.3	956.2	954.0	949.1	945.1	942.7	944.5	947.8	951.6
G162.0	967.3	963.1	959.9	958.0	953.5	949.8	947.5	948.1	951.1	954.5
G162.5	970.5	966.6	963.6	961.9	958.1	954.5	952.2	951.7	954.5	957.6
G163.0	973.7	970.1	967.5	966.0	962.7	958.9	956.5	955.3	957.7	960.5
G163.5	977.3	973.8	971.4	969.9	966.8	963.3	960.8	959.4	960.9	963.3
G164.0	980.9	977.6	975.2	973.5	970.9	967.3	965.0	963.6	964.1	966.2
G164.5	984.6	981.3	978.8	977.0	974.8	971.4	968.9	967.5	967.2	968.9
G165.0	988.3	984.9	982.2	980.3	978.6	975.3	972.9	971.4	970.5	971.6
G165.5	991.3	988.1	985.5	983.7	982.4	979.2	976.6	975.0	974.0	974.3
G166.0	994.4	991.2	988.7	986.9	985.9	982.8	980.3	978.4	977.3	976.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G166.5	997.3	994.3	991.9	990.2	988.7	986.2	983.6	981.8	980.5	979.9
G167.0	1000.3	997.3	995.0	993.0	991.6	989.3	986.8	984.8	983.6	982.8
G167.5	1003.2	1000.3	997.8	995.9	994.3	992.4	989.9	987.9	986.5	985.7
G168.0	1006.1	1003.2	1000.6	998.5	996.8	995.3	992.7	990.7	989.4	988.6
G168.5	1008.4	1005.5	1003.1	1001.0	999.2	997.7	995.4	993.6	992.2	991.3
G169.0	1010.7	1007.9	1005.4	1003.2	1001.5	1000.0	998.1	996.4	995.0	994.1
G169.5	1012.6	1009.9	1007.5	1005.4	1003.6	1002.2	1000.8	999.0	997.7	996.8
G170.0	1014.5	1011.9	1009.5	1007.4	1005.7	1004.5	1003.3	1001.6	1000.3	999.5
G170.5	1016.0	1013.6	1011.4	1009.4	1007.9	1006.6	1005.5	1004.2	1003.0	1002.2
G171.0	1017.6	1015.3	1013.2	1011.4	1009.9	1008.6	1007.7	1006.8	1005.7	1004.9
G171.5	1019.3	1017.0	1015.1	1013.4	1012.0	1010.7	1009.8	1009.2	1008.3	1007.5
G172.0	1021.0	1018.8	1017.0	1015.3	1013.9	1012.8	1012.0	1011.4	1010.8	1009.8
G172.5	1022.4	1020.4	1018.7	1017.2	1015.9	1014.8	1014.1	1013.6	1013.0	1012.1
G173.0	1023.8	1022.0	1020.4	1019.0	1017.9	1017.0	1016.2	1015.5	1014.8	1014.2
G173.5	1025.4	1023.8	1022.3	1021.0	1019.9	1019.0	1018.1	1017.3	1016.7	1016.0
G174.0	1027.0	1025.5	1024.1	1022.9	1021.8	1020.8	1020.0	1019.2	1018.5	1017.9
G174.5	1028.7	1027.2	1025.8	1024.7	1023.6	1022.7	1021.7	1020.9	1020.2	1019.5
G175.0	1030.2	1028.9	1027.5	1026.4	1025.3	1024.2	1023.3	1022.6	1021.8	1021.0
G175.5	1031.2	1029.9	1028.7	1027.6	1026.7	1025.8	1024.9	1024.0	1023.2	1022.5
G176.0	1032.0	1030.9	1029.9	1028.9	1027.9	1027.0	1026.2	1025.4	1024.7	1024.0
G176.5	1032.9	1031.8	1030.9	1030.0	1029.1	1028.3	1027.5	1026.8	1026.1	1025.5
G177.0	1033.6	1032.7	1031.8	1031.0	1030.2	1029.4	1028.7	1028.1	1027.5	1027.0
G177.5	1033.8	1033.1	1032.4	1031.7	1031.0	1030.4	1029.8	1029.3	1028.8	1028.4
G178.0	1034.0	1033.5	1032.9	1032.4	1031.9	1031.5	1031.0	1030.6	1030.2	1029.9
G178.5	1034.6	1034.1	1033.7	1033.3	1032.9	1032.6	1032.2	1031.9	1031.6	1031.4
G179.0	1035.0	1034.7	1034.4	1034.1	1033.9	1033.6	1033.4	1033.2	1033.0	1032.8
G179.5	1035.3	1035.2	1035.0	1034.9	1034.8	1034.6	1034.5	1034.4	1034.3	1034.2
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4241.9	4241.2	4240.5	4239.7	4239.4	4239.0	4238.6	4238.3	4238.3	4237.9
G1.0	4232.8	4231.3	4229.9	4228.8	4227.7	4226.6	4225.9	4225.5	4225.1	4224.8
G1.5	4224.0	4221.5	4219.6	4217.8	4216.0	4214.5	4213.4	4212.7	4212.0	4211.2
G2.0	4213.4	4211.2	4209.4	4206.9	4204.7	4202.5	4201.0	4199.9	4199.2	4198.1
G2.5	4202.8	4200.3	4197.7	4195.9	4193.3	4190.8	4188.6	4187.1	4186.0	4184.6
G3.0	4193.0	4189.7	4186.8	4184.2	4182.0	4179.1	4176.5	4174.3	4172.9	4171.0
G3.5	4182.0	4179.1	4175.8	4172.5	4169.9	4167.4	4164.1	4161.5	4159.7	4157.9
G4.0	4171.0	4167.8	4165.2	4161.5	4158.3	4155.7	4152.0	4149.1	4146.6	4144.4
G4.5	4160.4	4156.8	4153.9	4150.9	4146.9	4143.6	4140.3	4136.3	4133.8	4130.8
G5.0	4149.5	4145.8	4142.2	4139.6	4136.0	4131.9	4128.3	4123.9	4120.6	4117.7
G5.5	4138.2	4134.5	4131.2	4127.9	4124.6	4120.3	4117.0	4112.2	4108.9	4105.6
G6.0	4126.8	4122.8	4119.5	4115.5	4112.9	4108.6	4105.3	4100.5	4097.2	4093.6
G6.5	4115.5	4110.0	4106.4	4102.7	4099.8	4096.5	4093.2	4088.8	4085.2	4081.9
G7.0	4104.2	4097.2	4093.2	4089.9	4087.0	4084.4	4081.2	4077.1	4073.5	4069.8
G7.5	4092.5	4085.2	4080.1	4076.8	4073.8	4072.4	4069.1	4065.4	4061.8	4057.8
G8.0	4080.8	4073.1	4066.9	4063.2	4061.1	4059.6	4056.7	4053.7	4050.1	4046.1
G8.5	4069.1	4061.1	4054.5	4050.1	4047.5	4046.4	4044.6	4042.1	4038.4	4034.4
G9.0	4057.0	4049.0	4042.1	4036.9	4034.4	4033.3	4032.2	4030.0	4026.7	4022.3
G9.5	4044.6	4036.6	4029.6	4023.8	4020.9	4020.1	4019.8	4017.9	4015.0	4010.6
G10.0	4031.1	4023.8	4017.2	4011.4	4007.7	4007.0	4007.3	4006.2	4003.3	3998.6
G10.5	4017.2	4011.0	4004.4	3998.6	3994.6	3993.8	3994.9	3993.8	3990.2	3985.4
G11.0	4002.6	3996.7	3991.3	3985.8	3982.5	3981.8	3982.5	3981.0	3977.4	3972.3
G11.5	3986.5	3982.1	3977.7	3974.1	3970.4	3969.7	3970.4	3968.6	3964.2	3959.1
G12.0	3970.4	3967.5	3965.7	3962.4	3958.4	3957.6	3958.4	3956.2	3951.4	3945.6
G12.5	3954.0	3953.6	3952.9	3950.0	3946.7	3946.0	3946.0	3943.4	3938.3	3932.4
G13.0	3936.8	3939.7	3940.1	3937.9	3935.0	3933.9	3933.9	3931.0	3925.5	3918.9
G13.5	3922.2	3925.9	3927.7	3925.9	3922.9	3921.8	3921.8	3918.5	3912.3	3905.8
G14.0	3908.0	3912.7	3915.3	3914.2	3910.9	3910.1	3909.8	3906.1	3899.5	3892.2
G14.5	3894.1	3898.8	3902.5	3902.1	3898.8	3898.1	3898.1	3893.7	3886.4	3878.7
G15.0	3879.8	3884.9	3889.3	3889.7	3886.8	3886.0	3886.4	3881.3	3873.6	3865.6
G15.5	3865.6	3871.0	3876.5	3877.6	3875.1	3874.0	3874.0	3869.2	3861.5	3853.5
G16.0	3851.3	3857.2	3864.1	3865.9	3863.0	3860.8	3861.5	3857.2	3849.9	3841.4
G16.5	3837.1	3843.3	3851.0	3853.9	3849.9	3847.3	3848.8	3845.1	3837.8	3829.8
G17.0	3822.8	3829.0	3837.8	3839.6	3836.7	3834.1	3836.0	3833.0	3826.1	3817.7
G17.5	3808.6	3814.8	3822.4	3824.6	3823.5	3821.0	3822.8	3821.0	3814.4	3806.0
G18.0	3794.3	3800.9	3805.6	3809.3	3810.0	3807.8	3809.7	3808.9	3802.4	3794.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G18.5	3780.1	3784.1	3788.5	3794.3	3796.1	3794.7	3796.5	3796.9	3790.7	3782.3
G19.0	3765.8	3766.9	3770.9	3778.6	3781.9	3781.5	3783.0	3784.8	3778.6	3770.6
G19.5	3749.4	3749.7	3753.8	3762.5	3767.6	3768.4	3769.8	3772.4	3766.9	3758.5
G20.0	3731.1	3732.2	3736.2	3745.7	3753.4	3755.2	3756.7	3760.3	3754.9	3746.8
G20.5	3712.5	3714.7	3719.0	3728.9	3739.1	3742.1	3740.2	3740.6	3733.7	3726.3
G21.0	3693.1	3696.8	3701.9	3711.7	3724.5	3723.4	3719.8	3719.4	3712.1	3704.4
G21.5	3673.7	3678.8	3684.7	3694.9	3705.2	3703.0	3699.3	3698.6	3690.5	3682.5
G22.0	3654.0	3660.6	3667.5	3676.7	3684.0	3682.5	3678.5	3677.4	3669.0	3660.6
G22.5	3633.6	3642.3	3650.5	3655.5	3663.1	3662.0	3658.0	3656.6	3647.5	3638.7
G23.0	3613.0	3624.1	3631.3	3634.4	3642.2	3641.4	3637.7	3635.6	3626.0	3616.7
G23.5	3592.2	3604.9	3609.9	3613.3	3621.6	3621.0	3617.3	3614.7	3604.5	3594.7
G24.0	3571.1	3585.1	3588.5	3592.2	3601.2	3600.5	3596.9	3593.7	3583.0	3572.7
G24.5	3549.6	3562.8	3567.3	3571.2	3580.2	3580.0	3576.4	3572.7	3561.5	3550.7
G25.0	3528.2	3540.7	3546.0	3550.3	3559.4	3559.5	3555.9	3551.8	3540.0	3528.6
G25.5	3506.2	3518.0	3524.8	3529.4	3538.7	3539.1	3532.2	3523.7	3510.8	3500.7
G26.0	3482.3	3495.6	3503.5	3508.5	3518.2	3514.1	3501.8	3494.2	3481.7	3471.6
G26.5	3458.8	3473.3	3482.4	3487.6	3495.4	3483.5	3471.5	3464.6	3452.5	3442.5
G27.0	3435.4	3451.1	3461.2	3466.7	3463.4	3453.0	3441.2	3434.9	3423.3	3413.5
G27.5	3411.6	3428.6	3440.1	3439.8	3431.1	3422.3	3410.8	3405.2	3394.1	3384.5
G28.0	3388.0	3406.3	3419.3	3407.7	3398.6	3391.6	3380.5	3375.5	3365.0	3355.5
G28.5	3364.5	3384.1	3393.9	3375.6	3366.2	3360.4	3350.2	3345.7	3335.8	3326.5
G29.0	3341.0	3361.8	3361.1	3343.4	3333.9	3329.2	3320.0	3315.9	3306.6	3297.6
G29.5	3317.4	3339.6	3327.3	3311.2	3301.7	3297.9	3289.7	3286.0	3277.4	3268.6
G30.0	3294.0	3308.6	3293.5	3278.7	3269.5	3266.5	3259.4	3256.1	3248.3	3239.7
G30.5	3270.8	3273.8	3259.7	3246.2	3237.5	3235.0	3229.4	3226.4	3218.2	3209.5
G31.0	3247.4	3238.5	3225.8	3213.7	3205.4	3204.1	3200.2	3196.9	3188.1	3178.9
G31.5	3219.8	3203.0	3191.6	3181.2	3173.4	3175.0	3171.1	3167.4	3158.0	3148.4
G32.0	3183.8	3167.5	3157.2	3148.7	3144.2	3145.9	3141.9	3137.9	3127.9	3117.8
G32.5	3147.4	3132.1	3122.8	3115.8	3115.5	3117.0	3112.7	3108.4	3097.8	3087.2
G33.0	3111.0	3096.4	3088.4	3086.6	3086.9	3087.8	3083.5	3079.0	3067.8	3056.6
G33.5	3074.6	3060.7	3054.0	3057.5	3058.4	3058.8	3054.4	3049.7	3037.6	3026.0
G34.0	3038.0	3025.0	3022.3	3028.5	3029.9	3029.8	3025.3	3020.3	3007.6	2995.3
G34.5	3001.0	2989.4	2992.8	2999.6	3001.2	3001.0	2996.2	2991.1	2977.5	2964.7
G35.0	2964.1	2953.6	2963.4	2970.8	2972.6	2972.2	2967.1	2961.8	2947.4	2934.1
G35.5	2927.2	2921.7	2934.3	2941.8	2944.1	2943.6	2937.8	2932.1	2918.2	2904.7
G36.0	2890.3	2892.0	2905.1	2913.0	2915.6	2914.6	2907.5	2902.3	2889.0	2875.8
G36.5	2853.7	2862.6	2875.9	2884.4	2887.3	2883.7	2877.1	2872.5	2859.8	2846.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	2817.3	2833.0	2846.9	2855.8	2856.9	2852.7	2846.7	2842.7	2830.6	2818.0
G37.5	2787.6	2803.6	2818.0	2827.5	2825.1	2821.7	2816.3	2812.7	2801.4	2789.0
G38.0	2758.3	2774.4	2789.3	2796.4	2792.9	2790.6	2785.8	2782.7	2772.2	2760.0
G38.5	2729.1	2745.4	2760.5	2763.7	2760.9	2759.5	2755.3	2752.7	2742.9	2731.1
G39.0	2700.1	2716.4	2731.4	2730.9	2728.7	2728.5	2724.9	2722.7	2713.8	2702.2
G39.5	2670.8	2687.6	2697.4	2698.1	2696.6	2697.5	2694.3	2692.7	2684.6	2673.3
G40.0	2641.5	2659.1	2663.4	2665.3	2664.5	2666.6	2663.8	2662.6	2655.3	2644.5
G40.5	2612.6	2630.8	2629.4	2632.4	2632.3	2635.6	2633.4	2633.0	2625.3	2614.2
G41.0	2584.1	2596.5	2595.4	2599.3	2600.2	2604.8	2604.2	2603.5	2595.2	2583.6
G41.5	2555.2	2561.8	2561.4	2566.1	2568.1	2576.1	2575.0	2574.1	2565.2	2552.9
G42.0	2526.4	2527.2	2527.4	2532.8	2537.6	2547.5	2545.9	2544.6	2535.1	2522.2
G42.5	2496.9	2492.7	2493.6	2499.6	2509.0	2518.7	2516.7	2515.2	2505.1	2491.6
G43.0	2461.6	2458.4	2459.9	2468.2	2480.4	2490.0	2487.6	2485.8	2475.0	2460.8
G43.5	2426.2	2424.1	2426.2	2439.7	2451.8	2461.3	2458.5	2456.4	2445.0	2430.1
G44.0	2391.0	2390.0	2392.6	2411.2	2423.3	2432.8	2429.4	2427.1	2414.9	2399.4
G44.5	2356.0	2356.0	2363.2	2382.7	2394.7	2404.4	2400.3	2397.7	2384.9	2368.7
G45.0	2321.1	2322.1	2335.0	2354.3	2366.1	2376.1	2371.2	2368.4	2354.8	2337.9
G45.5	2286.3	2287.9	2306.9	2326.0	2337.8	2347.9	2341.7	2337.1	2323.7	2307.2
G46.0	2251.7	2257.3	2278.8	2297.9	2309.4	2319.7	2309.5	2305.3	2292.5	2276.4
G46.5	2217.2	2229.2	2250.8	2269.8	2281.1	2287.0	2277.4	2273.5	2261.4	2245.7
G47.0	2182.9	2201.2	2223.0	2241.8	2250.7	2254.3	2245.2	2241.7	2230.3	2215.1
G47.5	2148.4	2173.5	2195.4	2213.9	2217.6	2221.5	2213.0	2209.8	2199.2	2184.4
G48.0	2119.4	2145.7	2168.0	2183.7	2184.5	2188.3	2180.8	2178.0	2168.0	2153.7
G48.5	2091.9	2118.2	2140.9	2149.7	2151.5	2155.1	2148.6	2146.1	2136.9	2123.1
G49.0	2064.7	2090.9	2113.6	2115.8	2118.5	2122.0	2116.4	2114.2	2105.8	2092.5
G49.5	2037.6	2063.7	2081.0	2081.8	2085.4	2088.7	2084.2	2082.3	2074.7	2061.9
G50.0	2010.7	2036.7	2047.0	2047.9	2052.2	2055.5	2051.9	2050.4	2043.5	2031.3
G50.5	1984.1	2009.8	2013.0	2014.0	2018.9	2022.3	2019.9	2018.9	2011.7	1999.4
G51.0	1957.6	1978.2	1979.0	1980.2	1985.7	1989.2	1988.9	1987.4	1979.8	1967.1
G51.5	1931.2	1943.9	1945.2	1946.4	1952.4	1958.5	1957.9	1956.0	1948.0	1934.9
G52.0	1905.0	1909.8	1911.2	1912.7	1920.6	1927.9	1926.9	1924.6	1916.1	1902.6
G52.5	1879.1	1875.7	1877.3	1879.1	1890.4	1897.3	1896.0	1893.2	1884.3	1870.3
G53.0	1845.7	1841.9	1843.6	1847.5	1860.2	1866.8	1865.0	1861.8	1852.4	1838.0
G53.5	1811.4	1808.1	1809.8	1818.0	1830.2	1836.3	1834.1	1830.4	1820.6	1805.7
G54.0	1777.1	1774.5	1776.3	1788.6	1800.1	1805.8	1803.2	1799.0	1788.7	1773.4
G54.5	1742.8	1740.9	1747.2	1759.2	1770.1	1775.4	1772.2	1767.6	1756.9	1741.1
G55.0	1708.6	1707.4	1718.2	1729.9	1740.1	1745.0	1741.3	1736.2	1725.1	1708.8

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G55.5	1674.5	1673.9	1689.3	1700.7	1710.3	1714.6	1710.2	1704.6	1693.8	1677.7
G56.0	1640.4	1645.5	1660.6	1671.5	1680.4	1684.0	1678.2	1672.8	1662.6	1646.9
G56.5	1606.5	1617.3	1632.0	1642.4	1650.7	1651.5	1646.3	1641.1	1631.4	1616.2
G57.0	1572.8	1589.3	1603.6	1613.4	1619.2	1619.1	1614.4	1609.3	1600.2	1585.4
G57.5	1542.0	1561.4	1575.2	1584.4	1586.8	1586.6	1582.5	1577.6	1568.9	1554.6
G58.0	1514.6	1533.6	1547.0	1552.8	1554.5	1554.2	1550.6	1545.8	1537.7	1523.9
G58.5	1487.3	1506.0	1518.9	1520.7	1522.3	1521.8	1518.8	1514.1	1506.5	1493.1
G59.0	1460.2	1478.4	1489.0	1488.6	1490.0	1489.4	1486.9	1482.3	1475.3	1462.4
G59.5	1433.3	1451.0	1457.0	1456.5	1457.8	1457.0	1455.0	1450.5	1444.0	1431.7
G60.0	1406.6	1423.8	1425.1	1424.5	1425.6	1424.7	1423.2	1418.8	1412.8	1401.0
G60.5	1380.0	1393.6	1393.3	1392.5	1393.4	1392.3	1391.5	1387.2	1381.1	1369.3
G61.0	1353.6	1362.0	1361.5	1360.6	1361.2	1360.5	1360.4	1355.7	1349.3	1337.4
G61.5	1327.3	1330.4	1329.7	1328.7	1329.1	1330.1	1329.3	1324.2	1317.6	1305.5
G62.0	1299.0	1298.9	1298.0	1296.9	1299.1	1299.6	1298.2	1292.6	1285.8	1273.7
G62.5	1267.8	1267.6	1266.4	1265.7	1269.3	1269.2	1267.2	1261.1	1254.1	1241.8
G63.0	1236.7	1236.3	1234.8	1236.7	1239.5	1238.7	1236.1	1229.6	1222.3	1209.9
G63.5	1205.8	1205.1	1203.8	1207.6	1209.8	1208.4	1205.0	1198.2	1190.6	1178.1
G64.0	1175.1	1174.0	1175.7	1178.7	1180.1	1178.0	1173.9	1166.7	1158.8	1146.3
G64.5	1144.5	1142.9	1147.8	1149.9	1150.5	1147.6	1142.8	1135.2	1127.1	1114.4
G65.0	1114.1	1114.3	1119.9	1121.1	1120.9	1117.3	1111.8	1103.8	1095.3	1082.6
G65.5	1083.8	1087.3	1092.1	1092.4	1091.3	1087.0	1082.3	1076.8	1069.5	1056.1
G66.0	1053.7	1060.4	1064.4	1063.7	1061.8	1058.6	1056.0	1050.7	1043.7	1030.6
G66.5	1026.5	1033.6	1036.8	1035.1	1033.4	1032.1	1029.7	1024.5	1017.9	1005.2
G67.0	1000.7	1007.0	1009.3	1006.6	1007.2	1005.7	1003.5	998.5	992.0	979.8
G67.5	975.0	980.5	981.8	980.1	981.0	979.3	977.2	972.3	966.2	954.4
G68.0	949.5	954.1	954.4	954.0	954.8	952.9	950.9	946.2	940.4	929.0
G68.5	924.2	927.8	928.4	928.0	928.6	926.5	924.6	920.1	914.6	903.5
G69.0	899.1	901.6	902.6	902.0	902.4	900.1	898.3	894.0	888.7	878.1
G69.5	874.0	876.0	876.9	876.0	876.3	873.7	872.1	867.9	862.9	852.7
G70.0	849.0	850.5	851.1	850.1	850.1	847.3	845.8	841.8	837.1	827.3
G70.5	824.1	825.1	825.4	824.3	824.0	821.0	822.0	820.3	816.4	806.1
G71.0	798.9	799.8	799.7	798.5	797.9	799.1	801.6	799.6	795.7	785.5
G71.5	773.8	774.4	774.1	772.7	776.3	778.8	781.1	778.9	775.1	765.0
G72.0	748.7	749.1	748.4	749.9	756.2	758.6	760.6	758.2	754.4	744.5
G72.5	723.7	723.8	722.8	730.1	736.1	738.4	740.2	737.6	733.7	723.9
G73.0	698.8	698.5	703.1	710.2	716.0	718.1	719.7	716.9	713.1	703.4
G73.5	673.8	674.4	683.6	690.4	695.9	697.9	699.3	696.2	692.4	682.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	649.0	655.1	664.0	670.5	675.8	677.7	678.8	675.5	671.8	662.4
G74.5	625.1	635.8	644.5	650.7	655.8	657.5	658.3	654.8	651.1	641.9
G75.0	606.2	616.6	625.0	630.9	635.8	637.3	637.9	634.1	630.4	621.4
G75.5	587.3	597.5	605.6	611.1	615.7	617.1	617.3	613.5	610.0	601.3
G76.0	568.6	578.4	586.2	591.3	595.5	596.2	596.5	592.8	589.6	581.2
G76.5	549.8	559.4	566.8	571.3	574.6	575.3	575.7	572.1	569.2	561.1
G77.0	531.1	540.4	547.2	550.5	553.7	554.4	555.0	551.5	548.8	541.1
G77.5	512.5	521.4	526.4	529.8	532.8	533.5	534.2	530.9	528.4	521.1
G78.0	493.9	501.0	505.5	509.0	511.9	512.7	513.4	510.2	507.9	501.0
G78.5	475.0	480.3	484.7	488.2	491.0	491.8	492.6	489.6	487.5	480.9
G79.0	454.4	459.6	463.9	467.5	470.2	471.0	471.9	468.9	467.1	460.9
G79.5	433.9	438.8	443.2	446.8	449.3	450.1	451.1	448.2	446.7	440.9
G80.0	413.4	418.2	422.4	426.1	428.4	429.2	430.3	427.6	426.3	420.8
G80.5	393.0	397.6	401.7	405.3	407.5	408.6	409.7	406.9	405.7	400.5
G81.0	372.6	376.9	381.0	384.8	387.2	388.2	389.2	386.2	385.1	380.2
G81.5	352.2	356.4	360.6	364.7	367.0	367.8	368.6	365.4	364.5	359.8
G82.0	331.8	336.3	340.9	344.7	346.7	347.4	348.0	344.7	344.0	339.5
G82.5	312.1	317.0	321.3	324.7	326.5	327.0	327.5	323.9	323.4	319.1
G83.0	293.1	297.7	301.6	304.7	306.3	306.6	306.9	303.2	302.8	298.8
G83.5	274.2	278.4	282.0	284.7	286.1	286.2	286.3	282.5	282.2	278.5
G84.0	255.3	259.2	262.4	264.7	266.0	265.9	265.8	261.7	261.6	258.1
G84.5	236.5	239.9	242.8	244.8	245.8	245.5	245.2	241.0	241.0	237.8
G85.0	217.6	220.7	223.2	224.8	225.6	225.1	224.7	220.2	220.4	217.5
G85.5	198.8	201.4	203.6	204.8	205.3	204.6	204.0	199.6	199.9	197.3
G86.0	180.0	182.1	183.7	184.5	184.8	184.1	183.4	179.0	179.5	177.1
G86.5	160.8	162.3	163.6	164.2	164.4	163.5	162.8	158.4	159.0	156.9
G87.0	141.3	142.6	143.5	143.9	143.9	142.9	142.1	137.8	138.5	136.7
G87.5	121.9	122.8	123.5	123.7	123.4	122.4	121.5	117.2	118.0	116.5
G88.0	102.5	103.0	103.4	103.4	103.0	101.8	100.9	96.5	97.5	96.4
G88.5	83.1	83.3	83.4	83.1	82.5	81.3	80.2	75.9	77.0	76.2
G89.0	63.7	63.5	63.4	62.8	62.1	60.7	59.6	55.3	56.5	56.0
G89.5	44.3	43.8	43.3	42.6	41.6	40.2	39.0	34.7	36.0	35.8
G90.0	27.6	26.7	25.9	24.8	23.5	21.8	20.4	15.7	17.3	17.4
G90.5	53.3	51.9	50.5	48.8	46.7	43.7	41.3	32.9	35.5	35.6
G91.0	56.4	55.2	54.0	52.5	50.6	47.9	45.6	37.3	39.5	39.7
G91.5	59.4	58.5	57.5	56.2	54.5	52.0	49.9	41.7	43.6	43.7
G92.0	62.4	61.8	61.0	59.9	58.4	56.1	54.2	46.1	47.6	47.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G92.5	65.5	65.0	64.5	63.7	62.4	60.2	58.4	50.5	51.7	51.7
G93.0	68.5	68.3	68.0	67.4	66.3	64.4	62.7	54.8	55.7	55.7
G93.5	71.6	71.6	71.4	71.1	70.2	68.5	67.0	59.2	59.8	59.7
G94.0	74.6	74.9	74.9	74.8	74.2	72.6	71.2	63.6	63.8	63.8
G94.5	77.6	78.1	78.4	78.5	78.1	76.7	75.5	68.0	67.9	67.8
G95.0	80.5	81.4	81.8	82.2	82.0	80.9	79.8	72.4	71.9	71.8
G95.5	83.5	84.6	85.2	85.9	85.9	85.0	84.1	77.2	76.2	75.8
G96.0	86.5	87.8	88.7	89.5	89.8	89.1	88.4	81.8	80.4	79.8
G96.5	89.5	91.0	92.1	93.2	93.7	93.2	92.7	86.6	84.7	83.8
G97.0	92.5	94.3	95.5	96.9	97.7	97.4	97.0	91.2	88.9	87.8
G97.5	95.5	97.5	99.0	100.6	101.6	101.5	101.3	95.9	93.2	91.8
G98.0	98.7	100.8	102.4	104.3	105.5	105.7	105.6	100.6	97.4	95.9
G98.5	102.0	104.2	105.9	108.0	109.4	109.8	109.9	105.3	101.7	99.9
G99.0	105.3	107.7	109.5	111.7	113.4	113.9	114.3	110.0	105.9	103.9
G99.5	108.7	111.2	113.2	115.6	117.3	118.1	118.6	114.7	110.1	107.9
G100.0	112.0	114.7	116.9	119.5	121.4	122.3	122.9	119.3	114.4	111.9
G100.5	115.4	118.3	120.6	123.4	125.5	126.5	127.2	123.8	118.3	115.9
G101.0	118.8	121.8	124.3	127.3	129.6	130.8	131.6	128.2	122.2	119.9
G101.5	122.2	125.4	128.0	131.2	133.7	135.1	136.0	132.7	126.1	124.0
G102.0	125.2	128.9	131.8	135.2	137.8	139.3	140.3	137.1	129.9	128.0
G102.5	128.1	132.4	135.5	139.1	141.9	143.6	144.7	141.6	133.8	132.0
G103.0	131.1	135.6	139.3	143.0	146.1	147.9	149.0	146.0	137.7	136.1
G103.5	134.1	138.8	142.7	147.0	150.2	152.1	153.4	150.5	141.6	140.1
G104.0	137.1	142.0	146.1	150.7	154.3	156.4	157.8	154.9	145.5	144.1
G104.5	140.1	145.2	149.5	154.3	158.3	160.7	162.1	159.3	149.4	148.1
G105.0	143.1	148.4	152.9	158.0	162.1	164.8	166.4	163.8	153.3	152.2
G105.5	146.2	151.7	156.3	161.6	166.0	168.8	170.7	168.5	157.7	156.2
G106.0	151.2	155.0	159.7	165.3	169.8	172.9	174.9	173.1	162.1	160.1
G106.5	156.5	158.2	163.2	169.0	173.7	177.0	179.2	177.7	166.5	164.1
G107.0	161.9	163.4	166.6	172.6	177.6	181.1	183.5	182.4	170.9	168.1
G107.5	167.3	169.1	170.1	176.3	181.4	185.1	187.7	187.0	175.3	172.1
G108.0	172.8	174.8	176.2	180.0	185.3	189.2	192.0	191.6	179.7	176.1
G108.5	178.2	180.6	182.2	185.0	189.2	193.3	196.2	196.3	184.1	180.1
G109.0	183.7	186.3	188.3	191.3	193.7	197.4	200.5	200.9	188.6	184.0
G109.5	189.2	192.1	194.5	197.6	200.3	202.2	204.7	205.5	193.0	188.0
G110.0	195.2	197.9	200.6	204.0	206.8	208.8	210.4	210.4	197.4	192.4
G110.5	201.5	203.7	206.8	210.3	213.3	215.5	217.1	217.1	203.9	199.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	207.8	209.7	212.9	216.7	219.9	222.1	223.8	223.8	210.3	206.1
G111.5	214.2	216.6	219.1	223.0	226.4	228.8	230.6	230.5	216.8	212.9
G112.0	220.6	223.5	225.4	229.4	232.9	235.5	237.3	237.2	223.3	219.8
G112.5	227.1	230.5	232.8	235.8	239.5	242.1	244.1	243.9	229.7	226.6
G113.0	233.6	237.5	240.2	242.5	246.0	248.8	250.8	250.6	236.2	233.5
G113.5	240.2	244.6	247.7	250.4	252.6	255.5	257.6	257.3	242.7	240.4
G114.0	247.2	251.7	255.2	258.3	260.2	262.2	264.3	263.9	249.2	247.2
G114.5	255.2	258.8	262.7	266.2	268.4	269.7	271.1	270.6	255.6	254.1
G115.0	263.2	266.0	270.3	274.1	276.6	278.2	279.1	277.7	262.1	261.4
G115.5	271.3	273.7	277.9	282.1	284.8	286.6	287.8	286.8	271.9	271.0
G116.0	279.5	282.1	285.5	290.0	293.1	295.1	296.5	295.8	281.7	280.6
G116.5	287.7	290.5	293.2	298.0	301.3	303.5	305.1	304.9	291.5	290.2
G117.0	296.0	299.0	301.9	306.0	309.6	312.0	313.8	314.0	301.3	299.9
G117.5	304.3	307.5	310.7	314.0	317.9	320.5	322.5	323.0	311.1	309.5
G118.0	312.7	316.1	319.5	322.8	326.2	329.0	331.2	332.1	320.9	319.1
G118.5	320.2	324.8	328.4	331.7	334.5	337.5	339.9	341.2	330.7	328.7
G119.0	327.0	333.4	337.3	340.7	343.5	346.1	348.7	350.3	340.4	338.3
G119.5	334.0	342.2	346.2	349.7	352.5	355.0	357.4	359.4	350.2	347.9
G120.0	341.0	350.4	355.1	358.7	361.6	364.1	366.5	368.5	360.0	357.6
G120.5	348.1	357.8	364.0	367.8	370.6	373.2	375.6	377.6	369.4	367.2
G121.0	355.2	365.2	373.0	376.8	379.7	382.3	384.8	386.7	378.7	376.9
G121.5	362.4	372.6	381.3	385.9	388.8	391.4	394.0	395.8	388.0	386.5
G122.0	369.8	380.2	389.1	394.9	397.9	400.6	403.3	404.9	397.4	396.2
G122.5	377.1	387.8	396.9	403.8	407.0	409.7	412.5	414.0	406.7	405.8
G123.0	385.6	395.4	404.7	411.8	416.1	418.8	421.7	423.1	416.0	415.5
G123.5	394.9	403.0	412.6	419.9	424.9	428.0	430.9	432.2	425.4	425.1
G124.0	404.4	410.7	420.5	428.0	433.2	437.1	440.1	441.3	434.7	434.8
G124.5	413.8	418.5	428.4	436.1	441.5	445.7	449.3	450.4	444.0	444.5
G125.0	423.3	428.0	436.4	444.2	449.8	454.1	458.1	459.5	453.3	454.1
G125.5	432.8	437.5	444.4	452.4	458.1	462.6	466.7	468.5	462.9	463.8
G126.0	442.3	447.1	452.4	460.6	466.5	471.1	475.4	477.4	472.5	473.4
G126.5	452.0	456.7	462.1	468.8	474.8	479.7	484.1	486.4	482.1	483.1
G127.0	461.7	466.4	471.9	477.0	483.2	488.2	492.8	495.4	491.7	492.7
G127.5	471.2	476.2	481.6	485.9	491.6	496.7	501.5	504.4	501.3	502.4
G128.0	478.9	486.0	491.3	495.5	500.0	505.2	510.2	513.3	510.9	512.0
G128.5	486.6	495.7	501.1	505.1	508.9	513.8	518.9	522.3	520.5	521.7
G129.0	494.3	505.5	510.8	514.7	518.3	522.3	527.6	531.4	530.1	531.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G129.5	501.9	514.5	520.4	524.3	527.8	531.7	536.3	540.4	539.6	540.9
G130.0	509.6	521.9	530.1	533.9	537.2	541.0	545.6	549.5	549.2	550.6
G130.5	517.3	529.3	539.7	543.5	546.7	550.4	555.0	558.8	558.8	560.2
G131.0	525.1	536.8	548.9	553.1	556.2	559.7	564.4	568.1	568.3	569.8
G131.5	532.8	544.2	556.0	562.7	565.7	569.1	573.8	577.4	577.8	579.5
G132.0	540.5	551.7	563.2	572.3	575.2	578.4	583.2	586.8	587.4	589.1
G132.5	548.7	559.2	570.4	580.3	584.7	587.8	592.6	596.1	596.9	598.7
G133.0	558.5	566.7	577.7	587.3	594.2	597.2	602.0	605.4	606.4	608.4
G133.5	568.1	574.2	584.9	594.3	602.3	606.6	611.4	614.7	616.0	618.0
G134.0	577.8	581.8	592.2	601.4	609.3	616.0	620.8	624.1	625.5	627.6
G134.5	587.4	590.0	599.5	608.4	616.3	623.0	630.2	633.4	635.0	637.3
G135.0	597.0	599.5	606.8	615.5	623.3	629.9	637.4	642.2	644.6	646.3
G135.5	606.7	608.9	614.1	622.5	630.2	636.9	644.2	649.0	651.5	653.3
G136.0	616.3	618.2	621.7	629.6	637.2	643.8	651.0	655.8	658.4	660.2
G136.5	625.9	627.5	630.6	636.7	644.2	650.7	657.8	662.6	665.3	667.2
G137.0	635.5	636.8	639.4	643.8	651.2	657.7	664.6	669.4	672.2	674.1
G137.5	645.2	645.9	648.2	651.6	658.3	664.6	671.4	676.3	679.1	681.0
G138.0	653.2	655.1	657.0	660.0	665.3	671.5	678.3	683.1	686.0	688.0
G138.5	660.9	664.2	665.8	668.5	673.0	678.5	685.1	690.0	692.9	694.9
G139.0	668.7	673.3	674.5	676.9	681.1	685.4	691.9	696.8	699.8	701.9
G139.5	676.4	682.3	683.2	685.3	689.2	693.2	698.8	703.7	706.7	708.8
G140.0	684.2	689.7	691.8	693.7	697.3	701.1	706.2	710.6	713.6	715.8
G140.5	692.0	697.1	700.4	702.1	705.4	709.0	713.7	717.8	720.6	722.7
G141.0	699.8	704.6	708.9	710.5	713.4	716.8	721.2	725.0	727.6	729.6
G141.5	707.5	712.1	716.1	718.9	721.5	724.6	728.7	732.2	734.6	736.5
G142.0	715.3	719.5	723.3	727.3	729.5	732.5	736.2	739.4	741.7	743.4
G142.5	723.2	727.0	730.5	735.2	737.5	740.3	743.6	746.6	748.7	750.3
G143.0	730.8	734.6	737.7	742.2	745.5	748.1	751.1	753.8	755.6	757.2
G143.5	740.0	742.1	744.9	749.3	753.0	755.8	758.6	760.9	762.6	764.1
G144.0	749.3	749.5	752.1	756.4	760.1	763.6	766.0	768.0	769.7	771.0
G144.5	758.6	756.9	759.3	763.6	767.1	770.5	773.4	775.2	776.7	777.9
G145.0	768.0	765.0	766.6	770.8	774.0	777.5	780.3	782.3	783.7	784.8
G145.5	777.3	773.9	773.8	777.9	781.0	784.4	787.1	789.2	790.6	791.8
G146.0	786.7	782.6	781.0	785.0	788.1	791.3	793.9	796.0	797.6	798.7
G146.5	795.9	791.3	788.9	792.1	795.1	798.2	800.8	802.9	804.5	805.7
G147.0	805.1	800.0	797.6	799.3	802.1	805.1	807.6	809.8	811.5	812.7
G147.5	814.1	808.6	806.3	806.5	809.2	812.1	814.4	816.7	818.4	819.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	823.1	817.2	815.0	814.8	816.2	818.9	821.2	823.5	825.4	826.6
G148.5	831.9	825.7	823.7	823.1	823.4	825.8	828.1	830.3	832.3	833.5
G149.0	838.4	834.4	832.3	831.4	831.4	832.8	835.0	837.2	839.3	840.5
G149.5	843.8	843.1	840.9	839.6	839.4	840.2	841.9	844.1	846.2	847.5
G150.0	849.1	851.9	849.3	847.8	847.4	847.8	849.1	851.0	853.2	854.4
G150.5	854.3	859.7	857.8	856.0	855.3	855.5	856.6	858.1	860.2	861.3
G151.0	859.7	865.1	866.3	864.1	863.1	863.1	863.9	865.3	867.1	868.2
G151.5	865.0	870.3	874.7	872.1	871.0	870.7	871.3	872.4	874.1	875.1
G152.0	870.3	875.5	880.9	880.3	878.9	878.3	878.7	879.5	881.0	882.0
G152.5	875.5	880.7	885.9	888.4	886.6	885.7	886.1	886.7	888.0	888.8
G153.0	880.8	886.0	890.8	895.0	894.4	893.3	893.5	893.8	894.9	895.7
G153.5	886.2	891.2	895.7	899.6	902.1	900.7	900.9	901.0	901.9	902.7
G154.0	891.6	896.4	900.5	904.3	907.3	908.3	908.2	908.1	908.9	909.5
G154.5	897.0	901.6	905.4	908.9	911.8	914.0	915.6	915.2	915.8	916.4
G155.0	901.9	906.7	910.3	913.6	916.3	918.4	920.9	922.0	922.8	922.9
G155.5	906.8	911.8	915.2	918.3	920.7	922.8	925.2	926.2	927.1	927.3
G156.0	911.5	916.9	920.0	923.0	925.2	927.1	929.5	930.4	931.5	931.6
G156.5	916.1	921.1	924.8	927.6	929.6	931.5	933.8	934.7	935.8	936.1
G157.0	920.5	925.2	929.6	932.1	934.1	935.8	938.0	938.9	940.3	940.4
G157.5	924.9	929.1	933.7	936.8	938.5	940.2	942.2	943.2	944.6	944.9
G158.0	929.2	933.0	937.2	941.5	942.9	944.5	946.5	947.4	949.0	949.2
G158.5	933.3	936.8	940.6	944.8	947.4	948.8	950.8	951.7	953.4	953.6
G159.0	937.5	940.5	944.0	947.7	951.3	953.2	955.1	956.0	957.8	958.0
G159.5	941.5	944.1	947.3	950.5	953.9	957.0	959.4	960.2	962.1	962.4
G160.0	945.4	947.7	950.5	953.4	956.5	959.4	962.5	964.2	966.5	966.4
G160.5	949.1	951.2	953.6	956.2	959.0	961.9	964.6	966.1	968.2	968.1
G161.0	952.3	954.5	956.6	959.0	961.6	964.2	966.7	968.1	969.9	969.8
G161.5	955.1	957.9	959.6	961.8	964.1	966.5	968.7	970.1	971.7	971.5
G162.0	957.8	960.9	962.6	964.4	966.7	968.9	970.7	972.0	973.4	973.2
G162.5	960.5	963.3	965.4	967.2	969.2	971.2	972.7	973.9	975.1	974.9
G163.0	963.2	965.6	968.1	969.8	971.6	973.5	974.7	975.9	976.8	976.6
G163.5	965.7	968.0	970.2	972.5	974.1	975.8	976.6	977.8	978.5	978.3
G164.0	968.3	970.3	972.4	974.5	976.6	978.1	978.6	979.7	980.3	980.0
G164.5	970.8	972.6	974.5	976.6	978.6	980.3	980.5	981.7	982.0	981.7
G165.0	973.2	974.9	976.6	978.6	980.5	982.0	982.5	983.6	983.7	983.4
G165.5	975.6	977.1	978.8	980.6	982.3	983.7	984.2	985.3	985.4	985.2
G166.0	978.0	979.4	980.8	982.6	984.2	985.3	985.9	986.9	987.1	987.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G166.5	980.3	981.6	983.0	984.6	986.1	987.1	987.6	988.6	988.9	988.8
G167.0	982.6	983.7	985.1	986.6	987.9	988.8	989.3	990.3	990.6	990.6
G167.5	985.5	985.9	987.2	988.6	989.9	990.7	991.0	991.9	992.4	992.4
G168.0	988.2	988.2	989.3	990.7	991.7	992.4	992.7	993.6	994.1	994.1
G168.5	991.0	991.0	991.4	992.6	993.6	994.3	994.4	995.3	995.8	995.9
G169.0	993.7	993.7	994.0	994.5	995.4	996.1	996.2	997.0	997.6	997.7
G169.5	996.4	996.4	996.6	996.9	997.3	997.8	997.9	998.6	999.3	999.5
G170.0	999.1	998.9	999.0	999.2	999.5	999.6	999.7	1000.3	1001.1	1001.2
G170.5	1001.8	1001.5	1001.4	1001.5	1001.5	1001.5	1001.6	1002.1	1002.8	1002.9
G171.0	1004.3	1003.9	1003.7	1003.6	1003.6	1003.4	1003.5	1004.0	1004.6	1004.6
G171.5	1006.7	1006.3	1005.9	1005.7	1005.5	1005.3	1005.4	1005.8	1006.3	1006.3
G172.0	1009.1	1008.5	1008.1	1007.7	1007.4	1007.2	1007.4	1007.7	1008.0	1008.0
G172.5	1011.3	1010.7	1010.1	1009.6	1009.3	1009.1	1009.3	1009.5	1009.8	1009.7
G173.0	1013.4	1012.8	1012.0	1011.5	1011.2	1011.1	1011.2	1011.3	1011.5	1011.5
G173.5	1015.6	1014.7	1013.9	1013.4	1013.1	1013.0	1013.1	1013.1	1013.3	1013.2
G174.0	1017.2	1016.5	1015.7	1015.3	1015.1	1014.9	1015.0	1014.9	1015.0	1014.9
G174.5	1018.7	1018.0	1017.5	1017.2	1017.0	1016.8	1016.8	1016.7	1016.8	1016.7
G175.0	1020.2	1019.6	1019.2	1018.9	1018.7	1018.7	1018.6	1018.5	1018.5	1018.4
G175.5	1021.9	1021.3	1020.9	1020.6	1020.4	1020.4	1020.3	1020.2	1020.2	1020.2
G176.0	1023.4	1023.0	1022.6	1022.3	1022.1	1022.1	1021.9	1021.9	1021.9	1021.9
G176.5	1025.0	1024.6	1024.2	1024.0	1023.8	1023.8	1023.6	1023.6	1023.6	1023.6
G177.0	1026.5	1026.1	1025.9	1025.7	1025.6	1025.4	1025.3	1025.3	1025.3	1025.3
G177.5	1028.1	1027.8	1027.5	1027.4	1027.2	1027.1	1027.0	1027.0	1027.0	1027.1
G178.0	1029.6	1029.4	1029.2	1029.0	1028.9	1028.8	1028.7	1028.7	1028.8	1028.8
G178.5	1031.2	1030.9	1030.8	1030.6	1030.6	1030.5	1030.4	1030.4	1030.5	1030.5
G179.0	1032.6	1032.5	1032.4	1032.3	1032.2	1032.2	1032.2	1032.2	1032.2	1032.3
G179.5	1034.1	1034.0	1034.0	1034.0	1033.9	1033.9	1033.9	1033.9	1033.9	1034.0
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4237.9	4237.9	4237.9	4237.9	4238.3	4238.6	4239.0	4239.4	4240.1	4240.8
G1.0	4224.4	4224.0	4224.4	4224.4	4225.1	4225.9	4226.6	4227.7	4228.8	4230.2
G1.5	4210.9	4210.5	4210.5	4211.2	4212.0	4212.7	4214.2	4215.6	4217.4	4219.6
G2.0	4197.3	4197.0	4197.0	4197.7	4198.4	4199.9	4201.4	4203.6	4206.1	4208.7
G2.5	4183.8	4183.5	4183.5	4184.2	4185.3	4186.8	4188.9	4191.5	4194.4	4197.7
G3.0	4169.9	4169.6	4169.9	4170.7	4171.8	4173.6	4176.2	4179.1	4182.7	4186.8
G3.5	4156.4	4156.1	4156.1	4156.8	4158.6	4160.8	4163.4	4166.7	4170.7	4175.4
G4.0	4142.9	4142.2	4142.5	4143.3	4145.1	4147.3	4149.8	4153.9	4158.3	4162.6
G4.5	4129.4	4128.7	4128.7	4129.8	4131.2	4133.4	4136.7	4140.0	4144.4	4149.5
G5.0	4115.9	4114.8	4115.1	4115.9	4117.0	4119.5	4122.1	4125.4	4130.1	4135.6
G5.5	4103.4	4102.3	4102.0	4101.6	4102.7	4104.5	4107.1	4110.8	4114.8	4120.3
G6.0	4091.4	4089.9	4089.6	4088.8	4089.2	4089.2	4091.7	4094.7	4098.7	4104.5
G6.5	4079.3	4077.9	4077.1	4076.4	4076.0	4075.3	4075.3	4078.2	4082.6	4087.7
G7.0	4067.3	4065.8	4064.7	4064.0	4062.9	4062.5	4061.1	4061.4	4065.1	4070.6
G7.5	4055.2	4053.7	4052.3	4051.2	4049.7	4048.3	4047.2	4046.1	4047.2	4053.4
G8.0	4043.2	4041.3	4039.9	4038.4	4036.9	4034.4	4032.9	4031.1	4030.7	4035.5
G8.5	4031.1	4028.9	4027.8	4025.6	4023.4	4020.9	4017.9	4016.1	4015.4	4017.6
G9.0	4019.0	4016.8	4015.4	4012.8	4009.9	4007.0	4003.3	4001.1	4000.4	4001.9
G9.5	4007.0	4004.8	4003.0	4000.4	3996.7	3992.7	3988.7	3986.1	3985.4	3987.2
G10.0	3994.9	3992.7	3990.5	3987.6	3983.6	3978.5	3974.1	3971.2	3970.4	3971.9
G10.5	3981.8	3979.9	3978.1	3974.8	3970.1	3964.2	3959.1	3956.2	3955.8	3955.8
G11.0	3968.2	3966.1	3964.2	3962.0	3956.2	3950.0	3944.5	3941.6	3940.1	3940.1
G11.5	3954.7	3952.2	3949.2	3946.3	3942.7	3935.4	3929.9	3926.6	3924.8	3922.9
G12.0	3941.2	3937.9	3934.3	3929.9	3925.5	3921.1	3914.9	3911.2	3908.7	3906.1
G12.5	3927.3	3923.3	3918.5	3913.1	3907.6	3903.9	3900.3	3896.6	3892.2	3888.6
G13.0	3913.8	3908.7	3902.8	3895.9	3889.7	3886.0	3885.7	3881.3	3876.2	3870.7
G13.5	3899.9	3894.1	3886.8	3878.7	3871.8	3868.1	3867.4	3865.6	3859.0	3852.8
G14.0	3886.0	3879.5	3870.7	3861.5	3854.2	3849.9	3849.1	3850.2	3841.4	3834.1
G14.5	3872.1	3864.5	3854.6	3844.4	3836.3	3831.9	3829.8	3829.8	3824.3	3815.9
G15.0	3858.3	3849.9	3837.8	3826.8	3818.4	3813.3	3810.0	3808.2	3806.0	3797.2
G15.5	3845.5	3834.9	3821.0	3809.3	3800.9	3795.0	3789.9	3786.6	3786.6	3778.6
G16.0	3833.4	3822.1	3804.9	3791.8	3783.0	3776.0	3769.1	3764.4	3764.0	3760.3
G16.5	3821.4	3809.3	3791.8	3774.2	3765.1	3755.9	3747.2	3742.1	3741.3	3741.3
G17.0	3809.3	3796.5	3778.6	3760.7	3746.4	3735.5	3725.6	3719.4	3718.7	3722.7
G17.5	3797.6	3784.1	3765.8	3747.2	3730.7	3715.0	3703.3	3696.8	3695.7	3700.0
G18.0	3785.2	3771.7	3752.7	3734.0	3716.1	3693.8	3681.4	3674.1	3672.3	3675.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G18.5	3773.1	3759.6	3739.5	3720.5	3701.5	3675.9	3659.1	3651.2	3648.9	3651.9
G19.0	3761.4	3747.5	3726.7	3707.0	3686.5	3659.8	3636.7	3627.9	3624.8	3626.5
G19.5	3749.4	3735.5	3713.9	3693.5	3671.5	3643.6	3616.4	3604.6	3600.7	3601.1
G20.0	3737.7	3723.4	3700.8	3679.9	3656.9	3627.3	3599.0	3581.2	3575.8	3575.1
G20.5	3720.9	3711.0	3688.0	3666.4	3642.4	3611.1	3581.8	3557.1	3550.5	3548.7
G21.0	3698.6	3690.2	3675.2	3653.3	3627.2	3594.8	3564.3	3535.5	3525.1	3522.3
G21.5	3675.9	3666.1	3654.4	3640.1	3612.2	3578.6	3546.8	3516.8	3499.1	3495.5
G22.0	3653.1	3641.6	3629.7	3623.9	3597.3	3562.3	3529.4	3497.6	3473.0	3468.6
G22.5	3630.3	3617.2	3605.0	3598.2	3582.4	3546.1	3511.8	3478.7	3446.8	3441.6
G23.0	3607.5	3592.9	3580.3	3572.3	3561.7	3530.1	3494.2	3460.0	3424.5	3414.4
G23.5	3584.7	3568.5	3555.6	3546.2	3533.5	3513.6	3476.8	3440.9	3403.8	3386.9
G24.0	3561.6	3544.1	3531.0	3520.0	3505.3	3496.1	3459.4	3422.0	3383.2	3358.5
G24.5	3538.2	3519.7	3506.1	3493.2	3477.2	3467.1	3442.1	3403.3	3362.4	3330.0
G25.0	3514.8	3495.3	3481.2	3465.9	3448.9	3438.2	3425.1	3384.1	3341.8	3301.0
G25.5	3489.5	3470.9	3456.3	3438.5	3420.6	3409.3	3406.0	3365.1	3320.5	3277.5
G26.0	3460.4	3444.4	3431.4	3411.0	3392.3	3380.4	3376.3	3346.1	3299.2	3254.5
G26.5	3431.3	3415.5	3405.5	3383.5	3363.9	3351.7	3346.4	3326.6	3278.1	3231.1
G27.0	3402.4	3386.7	3376.6	3356.0	3335.4	3322.9	3316.6	3307.2	3256.6	3208.0
G27.5	3373.5	3357.9	3347.4	3327.4	3307.0	3294.1	3285.8	3281.1	3235.2	3184.7
G28.0	3344.8	3329.2	3318.0	3298.1	3278.6	3265.2	3254.8	3248.8	3213.9	3161.4
G28.5	3316.1	3300.4	3288.9	3268.8	3249.7	3236.4	3223.7	3216.5	3192.7	3138.3
G29.0	3287.5	3271.7	3259.9	3239.7	3220.2	3207.0	3192.4	3184.1	3171.8	3114.4
G29.5	3259.0	3243.1	3231.2	3210.7	3191.0	3177.3	3160.7	3151.4	3150.8	3090.7
G30.0	3230.5	3214.5	3202.8	3181.5	3161.8	3147.2	3129.1	3118.9	3117.6	3066.8
G30.5	3201.2	3185.9	3174.6	3152.5	3132.7	3117.2	3097.4	3086.6	3083.8	3042.7
G31.0	3169.3	3156.5	3145.8	3123.6	3103.7	3086.9	3065.4	3053.9	3049.4	3018.6
G31.5	3137.5	3124.6	3117.3	3094.9	3074.7	3056.6	3033.9	3021.3	3014.6	2995.0
G32.0	3105.6	3092.7	3084.6	3066.3	3045.7	3026.7	3003.1	2988.7	2979.7	2971.4
G32.5	3073.8	3060.8	3051.2	3037.6	3017.0	2996.9	2972.6	2955.1	2944.5	2945.8
G33.0	3042.0	3028.9	3017.9	3003.2	2988.4	2967.0	2942.3	2921.5	2909.4	2911.7
G33.5	3010.2	2996.9	2984.6	2968.9	2959.9	2937.2	2912.2	2888.3	2874.5	2877.7
G34.0	2978.4	2965.0	2951.3	2934.6	2927.6	2907.6	2882.3	2856.2	2840.5	2843.0
G34.5	2946.6	2933.0	2917.7	2900.5	2893.1	2878.1	2852.3	2824.4	2806.9	2808.0
G35.0	2914.9	2901.1	2884.1	2866.5	2858.5	2848.7	2822.7	2792.9	2773.5	2773.0
G35.5	2883.6	2869.1	2850.6	2832.5	2823.8	2814.9	2793.4	2761.9	2739.8	2737.0
G36.0	2854.9	2837.5	2817.1	2798.7	2788.8	2778.7	2763.8	2731.0	2706.3	2700.9
G36.5	2826.3	2808.9	2783.6	2764.9	2753.5	2742.7	2734.4	2700.3	2675.0	2664.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	2797.6	2780.5	2753.3	2731.2	2718.1	2706.9	2705.3	2670.1	2643.4	2628.3
G37.5	2769.0	2751.9	2724.9	2697.6	2682.7	2671.3	2668.7	2640.1	2612.2	2592.0
G38.0	2740.4	2723.2	2696.4	2667.2	2647.4	2635.9	2631.5	2610.2	2581.1	2556.2
G38.5	2711.8	2694.7	2668.0	2638.8	2611.9	2600.7	2594.3	2580.6	2549.9	2520.7
G39.0	2683.3	2666.3	2639.8	2610.5	2576.9	2565.3	2557.2	2551.6	2519.1	2485.4
G39.5	2654.8	2638.1	2611.6	2582.3	2548.2	2529.9	2520.1	2518.7	2488.5	2453.2
G40.0	2626.3	2609.9	2583.6	2554.3	2519.5	2494.4	2482.9	2482.4	2458.0	2422.1
G40.5	2597.4	2581.8	2555.6	2526.3	2491.0	2459.0	2446.0	2445.7	2427.7	2391.3
G41.0	2566.3	2553.8	2527.8	2498.3	2462.6	2429.9	2409.3	2409.1	2397.8	2360.8
G41.5	2535.1	2522.4	2500.0	2470.4	2434.4	2401.2	2373.1	2372.6	2368.0	2330.6
G42.0	2504.0	2490.9	2469.8	2442.6	2406.3	2372.7	2337.3	2335.6	2337.3	2300.5
G42.5	2473.0	2459.3	2437.1	2415.0	2378.3	2344.5	2302.8	2298.7	2299.6	2270.7
G43.0	2441.9	2427.6	2404.6	2385.3	2350.4	2316.6	2274.8	2261.8	2262.3	2241.2
G43.5	2410.9	2396.0	2372.0	2352.4	2322.8	2288.5	2246.7	2225.0	2225.1	2211.7
G44.0	2379.9	2364.5	2339.6	2319.4	2295.4	2260.7	2218.9	2188.1	2188.2	2182.4
G44.5	2348.9	2332.9	2307.3	2286.1	2263.5	2233.1	2191.2	2151.3	2151.5	2153.5
G45.0	2318.0	2301.4	2275.0	2252.8	2230.7	2205.8	2163.8	2119.5	2115.2	2124.7
G45.5	2287.0	2269.9	2242.8	2219.5	2198.0	2178.6	2136.4	2091.5	2078.9	2090.8
G46.0	2256.7	2238.4	2210.7	2186.3	2165.5	2147.1	2109.3	2063.8	2042.9	2053.8
G46.5	2226.3	2208.3	2178.6	2153.1	2132.8	2113.1	2082.5	2036.3	2006.9	2017.1
G47.0	2196.0	2178.1	2147.6	2119.9	2100.1	2079.3	2055.9	2009.0	1971.1	1980.6
G47.5	2165.7	2148.1	2117.9	2086.7	2067.5	2045.6	2029.4	1982.0	1936.1	1944.4
G48.0	2135.4	2117.9	2088.3	2054.9	2034.8	2012.1	1997.6	1955.2	1908.8	1908.6
G48.5	2105.1	2087.8	2058.8	2025.6	2002.1	1978.8	1964.3	1928.6	1881.8	1873.1
G49.0	2074.8	2057.8	2029.4	1996.4	1969.1	1945.6	1931.1	1902.3	1855.1	1837.8
G49.5	2044.6	2027.9	2000.0	1967.3	1939.3	1912.7	1897.7	1876.2	1828.6	1802.7
G50.0	2014.3	1998.1	1970.6	1938.3	1910.4	1880.0	1864.4	1848.4	1802.5	1767.7
G50.5	1983.8	1968.4	1941.3	1909.5	1881.7	1847.5	1831.3	1815.1	1776.7	1732.8
G51.0	1951.5	1938.7	1912.1	1880.9	1853.2	1817.8	1798.3	1782.2	1751.1	1703.6
G51.5	1919.2	1905.9	1883.0	1852.3	1824.7	1789.7	1765.3	1749.4	1725.9	1677.6
G52.0	1886.9	1873.1	1852.0	1823.7	1796.3	1761.7	1732.4	1716.8	1700.9	1651.9
G52.5	1854.6	1840.3	1819.0	1795.2	1768.1	1733.9	1699.7	1684.2	1676.1	1626.4
G53.0	1822.3	1807.5	1786.1	1764.5	1740.0	1706.2	1671.3	1651.9	1644.3	1601.3
G53.5	1789.9	1774.6	1753.3	1731.6	1712.1	1678.6	1643.6	1619.9	1612.1	1576.3
G54.0	1757.6	1741.6	1720.4	1698.9	1684.3	1651.2	1616.1	1588.0	1580.1	1551.7
G54.5	1725.3	1708.6	1687.5	1666.4	1651.2	1624.0	1588.7	1556.4	1548.3	1527.5
G55.0	1693.0	1675.7	1654.6	1634.0	1618.1	1596.9	1561.6	1527.3	1516.6	1503.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G55.5	1661.0	1642.8	1621.8	1601.7	1585.1	1569.9	1534.6	1500.7	1484.9	1479.9
G56.0	1630.6	1610.4	1589.1	1569.5	1552.2	1537.3	1508.0	1474.2	1453.3	1450.5
G56.5	1600.3	1580.5	1556.3	1537.4	1519.4	1504.9	1481.4	1447.8	1422.0	1419.0
G57.0	1570.0	1550.7	1526.0	1505.3	1486.7	1472.6	1455.0	1421.5	1390.8	1387.8
G57.5	1539.7	1521.0	1496.9	1473.3	1454.0	1440.3	1425.8	1395.5	1362.2	1356.8
G58.0	1509.4	1491.4	1467.9	1444.3	1421.6	1407.9	1393.4	1369.7	1336.5	1326.1
G58.5	1479.1	1461.8	1438.9	1415.9	1389.2	1375.6	1361.3	1344.1	1310.8	1295.4
G59.0	1448.9	1432.3	1410.0	1387.6	1359.2	1343.4	1329.3	1318.7	1285.4	1264.7
G59.5	1418.6	1402.9	1381.1	1359.5	1331.8	1311.2	1297.4	1291.0	1260.2	1234.2
G60.0	1388.4	1373.5	1352.3	1331.4	1304.6	1279.2	1265.5	1259.2	1235.3	1203.8
G60.5	1357.8	1344.2	1323.7	1303.5	1277.4	1250.8	1233.8	1227.6	1210.7	1177.1
G61.0	1325.9	1314.1	1295.1	1275.8	1250.3	1224.2	1202.2	1196.1	1186.2	1152.3
G61.5	1294.0	1282.2	1266.5	1248.1	1223.3	1197.7	1170.9	1164.8	1162.0	1127.8
G62.0	1262.1	1250.3	1235.3	1220.5	1196.4	1171.4	1141.9	1133.5	1133.0	1103.8
G62.5	1230.2	1218.5	1203.9	1192.3	1169.7	1145.3	1116.4	1102.4	1102.0	1080.0
G63.0	1198.3	1186.7	1172.6	1161.2	1143.0	1119.3	1091.1	1071.4	1071.1	1056.3
G63.5	1166.4	1154.9	1141.4	1130.3	1116.0	1093.4	1065.9	1040.4	1040.4	1032.8
G64.0	1134.5	1123.2	1110.2	1099.3	1085.7	1067.7	1040.8	1013.9	1009.9	1009.8
G64.5	1102.7	1091.5	1079.0	1068.4	1055.5	1042.2	1015.9	989.4	979.4	983.9
G65.0	1070.8	1059.8	1047.9	1037.6	1025.4	1013.9	991.1	965.1	949.2	953.7
G65.5	1041.2	1028.2	1016.8	1006.8	995.3	984.0	966.5	941.0	919.0	923.3
G66.0	1016.3	1000.1	985.7	976.1	965.3	954.2	942.0	917.2	891.9	893.0
G66.5	991.3	975.8	957.1	945.4	935.3	924.6	914.2	893.5	868.6	862.8
G67.0	966.4	951.5	933.3	914.7	905.3	895.0	885.0	869.9	845.5	832.7
G67.5	941.5	927.2	909.6	890.4	875.4	865.6	856.0	846.5	822.6	802.9
G68.0	916.6	902.9	886.0	867.4	845.6	836.2	827.0	821.1	799.9	773.3
G68.5	891.8	878.6	862.4	844.5	823.3	806.9	798.2	793.0	777.4	749.4
G69.0	866.9	854.5	838.8	821.7	801.2	777.6	769.5	765.0	755.2	727.4
G69.5	842.0	830.2	815.3	798.9	779.3	754.9	740.8	737.2	733.1	705.7
G70.0	817.2	806.0	791.9	776.3	757.4	733.8	712.4	709.4	707.1	684.1
G70.5	794.2	781.9	768.5	753.6	735.5	712.7	686.6	681.7	679.6	662.8
G71.0	773.7	760.5	745.1	731.0	713.7	691.8	666.4	654.1	652.2	641.6
G71.5	753.2	740.0	724.2	708.4	692.0	671.0	646.4	626.6	624.9	620.7
G72.0	732.7	719.6	704.1	687.2	670.3	650.3	626.4	603.2	597.9	595.8
G72.5	712.2	699.2	684.0	667.2	648.7	629.5	606.5	584.0	570.9	568.7
G73.0	691.7	678.8	663.9	647.2	629.1	608.9	586.6	565.0	544.1	541.9
G73.5	671.3	658.4	643.8	627.3	609.5	588.7	566.9	546.1	520.4	515.1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	650.8	638.0	623.7	607.4	590.0	569.5	547.3	527.4	502.4	488.6
G74.5	630.3	617.6	603.6	587.6	570.5	550.4	528.0	508.8	484.5	462.3
G75.0	609.9	597.3	583.6	567.8	551.1	531.3	509.6	490.3	466.8	436.2
G75.5	589.9	577.0	563.5	548.0	531.7	512.3	491.1	471.8	449.3	419.0
G76.0	570.4	557.8	543.9	528.2	512.3	493.4	472.8	453.8	431.9	402.4
G76.5	550.8	538.7	525.2	509.0	493.0	474.5	454.6	435.9	414.6	386.0
G77.0	531.2	519.6	506.4	490.9	474.0	455.7	436.3	418.1	397.3	369.7
G77.5	511.7	500.5	487.8	472.9	456.6	436.9	418.2	400.4	380.0	353.6
G78.0	492.1	481.4	469.1	454.9	439.3	419.8	400.1	382.8	362.7	337.7
G78.5	472.6	462.3	450.5	436.9	422.0	403.4	382.5	365.2	345.5	321.6
G79.0	453.0	443.3	431.9	418.9	404.8	387.0	367.0	347.7	328.5	305.6
G79.5	433.5	424.2	413.3	401.0	387.6	370.6	351.5	331.6	311.5	289.6
G80.0	414.0	405.2	394.7	383.1	370.4	354.3	336.0	317.0	294.6	273.8
G80.5	394.0	385.9	376.2	365.2	353.3	338.0	320.6	302.4	279.5	258.1
G81.0	373.9	366.0	356.9	347.2	336.2	321.8	305.3	288.0	266.1	242.6
G81.5	353.8	346.2	337.5	328.3	318.7	305.6	290.0	273.6	252.7	228.6
G82.0	333.7	326.3	318.1	309.4	300.4	288.8	274.8	259.2	239.5	216.6
G82.5	313.6	306.5	298.6	290.6	282.1	271.2	258.9	244.9	226.3	204.6
G83.0	293.5	286.6	279.2	271.7	263.9	253.6	242.1	230.3	213.3	192.7
G83.5	273.4	266.8	259.9	252.9	245.6	236.1	225.4	214.2	200.3	180.9
G84.0	253.3	246.9	240.5	234.1	227.4	218.6	208.7	198.2	185.3	169.1
G84.5	233.2	227.1	221.1	215.3	209.2	201.1	192.0	182.3	170.2	156.3
G85.0	213.1	207.3	201.7	196.5	191.0	183.6	175.4	166.4	155.1	142.4
G85.5	193.3	187.8	182.5	177.7	172.8	166.2	158.8	150.5	140.2	128.7
G86.0	173.5	168.5	163.6	159.4	155.1	148.9	142.2	134.7	125.2	115.0
G86.5	153.8	149.1	144.7	141.1	137.6	132.2	126.2	118.9	110.4	101.4
G87.0	134.0	129.8	125.8	122.9	120.1	115.6	110.5	104.1	96.0	87.8
G87.5	114.3	110.5	107.0	104.6	102.5	98.9	94.7	89.3	82.4	75.1
G88.0	94.5	91.2	88.1	86.3	85.1	82.3	79.0	74.5	68.7	62.7
G88.5	74.8	71.9	69.2	68.1	67.6	65.7	63.3	59.8	55.1	50.4
G89.0	55.0	52.6	50.3	49.8	50.1	49.1	47.7	45.0	41.6	38.0
G89.5	35.2	33.3	31.4	31.5	32.6	32.5	32.0	30.3	28.0	25.7
G90.0	17.2	15.6	14.0	14.7	16.8	17.6	18.1	17.3	16.0	14.9
G90.5	35.3	32.3	29.5	30.8	33.7	34.4	34.9	33.3	31.1	28.9
G91.0	39.3	36.3	33.6	34.7	36.9	36.7	36.8	35.1	32.9	30.7
G91.5	43.3	40.3	37.6	38.7	40.1	39.0	38.8	36.9	34.7	32.5
G92.0	47.3	44.3	41.7	42.6	43.3	41.3	40.7	38.8	36.6	34.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G92.5	51.3	48.3	45.8	46.6	46.5	43.6	42.6	40.6	38.4	36.1
G93.0	55.3	52.3	49.9	50.5	49.7	46.0	44.6	42.4	40.3	38.0
G93.5	59.3	56.3	54.0	54.5	52.9	48.3	46.5	44.3	42.3	40.1
G94.0	63.3	60.3	58.1	58.5	56.1	50.6	48.5	46.3	44.3	42.1
G94.5	67.4	64.4	62.1	62.4	59.4	53.2	50.6	48.4	46.4	44.2
G95.0	71.4	68.4	66.3	66.4	63.0	55.9	52.6	50.4	48.4	46.3
G95.5	75.5	72.7	70.5	70.4	66.6	58.6	54.7	52.5	50.5	48.3
G96.0	79.6	76.9	74.7	74.3	70.2	61.3	56.8	54.6	52.5	50.3
G96.5	83.7	81.1	78.9	78.3	73.9	64.0	58.9	56.7	54.6	52.0
G97.0	87.8	85.4	83.1	82.3	77.5	66.7	61.0	58.8	56.4	53.7
G97.5	91.9	89.6	87.2	86.3	81.2	69.5	63.1	60.7	58.2	55.5
G98.0	95.9	93.8	91.4	90.3	84.9	72.3	65.1	62.5	60.0	57.2
G98.5	100.0	98.1	95.6	94.3	88.6	74.7	66.9	64.3	61.8	59.0
G99.0	104.1	102.3	99.8	98.3	91.8	76.9	68.8	66.1	63.7	61.0
G99.5	108.2	106.5	104.0	102.1	94.8	79.1	70.7	67.9	65.5	63.3
G100.0	112.3	110.6	108.0	105.9	97.8	81.3	72.6	69.7	67.5	65.7
G100.5	116.3	114.7	112.1	109.8	100.8	83.5	74.5	71.6	69.7	68.0
G101.0	120.3	118.7	116.1	113.6	103.9	85.8	76.4	73.6	71.9	70.3
G101.5	124.3	122.7	120.1	117.4	107.0	88.1	78.3	75.8	74.1	72.6
G102.0	128.3	126.7	124.1	121.2	110.2	90.4	80.5	78.0	76.3	74.9
G102.5	132.3	130.8	128.2	125.1	113.4	92.9	82.9	80.2	78.6	77.4
G103.0	136.3	134.8	132.2	129.0	116.6	96.4	85.4	82.4	80.8	79.8
G103.5	140.3	138.8	136.3	132.9	120.9	99.9	87.8	84.7	83.5	82.3
G104.0	144.3	142.9	140.3	137.0	125.3	103.4	90.3	86.9	86.4	84.8
G104.5	148.3	146.9	144.5	141.4	129.8	107.0	92.9	89.3	89.4	87.3
G105.0	152.4	151.1	148.9	145.7	134.2	110.6	95.4	93.3	92.5	89.9
G105.5	156.5	155.3	153.2	150.1	138.6	114.3	98.0	97.2	95.6	94.1
G106.0	160.6	159.6	157.5	154.4	143.1	118.0	102.4	101.2	98.8	98.3
G106.5	164.7	163.8	161.8	158.8	147.5	121.8	107.2	105.3	102.0	102.7
G107.0	168.8	168.0	166.2	163.1	152.0	126.9	112.0	109.4	106.8	107.1
G107.5	172.9	172.2	170.5	167.4	156.5	132.4	116.9	113.6	112.5	111.5
G108.0	176.9	176.4	174.8	171.8	162.4	137.8	121.8	117.9	118.5	116.1
G108.5	181.0	180.7	179.1	177.0	168.3	143.4	126.8	123.8	124.6	120.3
G109.0	185.1	184.9	184.0	183.3	174.2	149.0	131.7	131.5	130.8	123.9
G109.5	189.2	189.7	190.5	189.5	180.2	154.6	136.8	139.3	137.3	127.6
G110.0	194.8	196.4	197.0	195.9	186.2	160.3	144.7	147.1	143.9	131.3
G110.5	201.5	203.0	203.6	202.2	192.2	166.0	154.1	155.1	150.2	135.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	208.3	209.7	210.1	208.5	198.3	172.6	163.7	163.2	155.4	139.2
G111.5	215.0	216.4	216.7	214.9	204.3	183.2	173.3	171.4	160.8	143.3
G112.0	221.8	223.1	223.2	221.4	210.6	193.9	183.1	179.7	166.3	148.0
G112.5	228.5	229.7	229.8	227.8	220.6	204.6	192.9	187.2	172.0	154.4
G113.0	235.3	236.4	236.4	234.7	230.7	215.4	202.9	194.2	178.0	161.0
G113.5	242.1	243.1	243.0	244.2	240.7	226.2	212.9	201.3	184.2	168.1
G114.0	248.8	249.8	251.6	253.7	250.7	237.1	222.5	208.6	190.6	175.3
G114.5	255.6	257.9	261.3	263.3	260.8	247.9	230.9	215.9	198.6	182.8
G115.0	264.3	267.6	270.9	272.8	270.7	258.8	239.3	223.5	208.2	190.7
G115.5	273.9	277.2	280.5	282.4	280.6	268.9	247.7	231.2	217.8	199.0
G116.0	283.6	286.8	290.1	291.9	290.5	277.7	256.2	239.0	227.6	205.8
G116.5	293.3	296.5	299.8	301.5	300.4	286.5	264.8	247.6	237.5	211.4
G117.0	302.9	306.2	309.4	311.1	309.1	295.3	273.5	258.0	247.6	217.4
G117.5	312.6	315.8	319.0	320.7	317.7	304.2	282.3	268.6	257.7	223.8
G118.0	322.3	325.5	328.6	329.7	326.4	313.0	291.2	279.3	267.9	230.3
G118.5	331.9	335.2	338.2	338.5	335.1	322.0	301.6	290.1	277.3	236.9
G119.0	341.6	344.9	347.3	347.3	343.8	330.9	313.2	301.1	284.7	244.1
G119.5	351.3	354.3	356.4	356.1	352.5	339.9	324.9	312.1	292.4	251.5
G120.0	360.8	363.6	365.5	365.0	361.2	349.5	336.7	323.4	300.1	260.6
G120.5	370.3	372.8	374.6	373.9	370.0	360.4	348.4	334.9	308.2	272.8
G121.0	379.7	382.1	383.7	382.9	378.7	371.4	360.2	344.6	316.4	285.1
G121.5	389.2	391.4	392.9	391.8	388.3	382.4	372.0	353.4	324.8	297.4
G122.0	398.7	400.7	402.0	400.8	398.5	393.3	383.9	362.2	333.4	309.6
G122.5	408.1	410.0	411.2	410.0	408.7	404.2	395.6	371.2	342.1	321.5
G123.0	417.6	419.3	420.3	420.0	418.8	415.0	406.0	380.3	352.1	333.4
G123.5	427.1	428.6	429.7	430.1	429.0	425.8	415.2	389.6	363.0	345.2
G124.0	436.6	438.0	439.6	440.1	439.1	436.6	424.5	399.0	373.9	356.7
G124.5	446.1	447.8	449.4	450.1	449.3	447.3	433.9	408.5	384.9	367.1
G125.0	455.8	457.7	459.3	460.1	459.5	456.2	443.1	418.1	395.9	375.0
G125.5	465.6	467.6	469.2	470.2	469.7	465.0	452.5	428.3	407.0	382.9
G126.0	475.5	477.5	479.1	480.2	479.9	473.9	462.0	439.3	418.1	390.8
G126.5	485.3	487.4	489.0	490.3	488.7	482.8	471.5	450.5	429.3	398.8
G127.0	495.1	497.3	498.8	500.3	497.5	491.7	481.0	461.8	440.6	406.8
G127.5	504.9	507.1	508.7	509.9	506.3	500.7	490.5	473.1	451.8	414.9
G128.0	514.8	517.0	518.6	518.9	515.2	509.6	500.5	484.4	459.8	423.1
G128.5	524.6	526.8	528.2	527.9	524.1	518.6	510.5	495.7	467.8	431.3
G129.0	534.4	536.6	537.3	536.9	533.1	527.6	520.5	507.1	476.0	439.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G129.5	544.3	545.9	546.4	546.0	542.0	536.8	530.4	518.5	484.3	449.2
G130.0	553.7	555.2	555.6	555.1	551.0	546.1	540.2	529.7	492.7	461.1
G130.5	563.2	564.5	564.8	564.2	560.1	555.2	550.1	538.5	501.4	473.2
G131.0	572.6	573.9	574.0	573.3	569.1	564.4	560.0	546.7	510.1	485.4
G131.5	582.0	583.2	583.2	582.5	577.9	573.5	569.8	555.1	518.9	497.8
G132.0	591.5	592.6	592.4	591.7	586.7	582.7	579.6	563.2	528.0	510.4
G132.5	601.0	602.0	601.6	600.3	595.4	591.8	588.9	571.5	537.2	523.1
G133.0	610.4	611.4	610.9	608.6	604.2	600.8	596.6	580.1	549.9	536.1
G133.5	619.9	620.7	619.4	616.9	612.9	609.9	604.2	588.6	563.1	549.3
G134.0	629.4	630.1	627.2	625.0	621.6	618.9	611.9	597.0	576.3	562.6
G134.5	638.9	637.6	635.0	633.1	630.2	627.3	619.6	605.7	589.6	576.2
G135.0	646.5	645.0	642.7	641.2	638.8	634.6	627.4	614.4	602.8	588.6
G135.5	653.7	652.4	650.5	649.3	647.3	642.0	635.1	624.0	615.8	598.7
G136.0	660.9	659.8	658.2	657.2	655.5	649.4	642.8	634.9	628.9	609.0
G136.5	668.0	667.2	666.0	665.2	662.7	656.8	650.6	645.9	641.7	619.4
G137.0	675.2	674.6	673.7	673.1	669.8	664.2	658.5	656.6	654.1	630.0
G137.5	682.3	682.1	681.5	680.5	677.0	671.6	666.2	667.1	666.4	640.6
G138.0	689.5	689.5	689.2	687.5	684.1	679.0	675.4	677.5	678.3	651.3
G138.5	696.6	696.8	696.5	694.4	691.3	686.4	684.9	687.8	687.5	662.2
G139.0	703.7	704.2	703.4	701.4	698.5	693.8	694.3	697.8	696.4	673.1
G139.5	710.8	711.0	710.3	708.3	705.7	701.4	703.6	707.8	705.3	684.2
G140.0	717.6	717.8	717.1	715.3	712.9	710.4	712.8	717.8	714.1	695.1
G140.5	724.4	724.7	724.0	722.3	720.1	719.3	722.1	727.5	723.0	706.1
G141.0	731.2	731.5	730.8	729.3	727.4	728.3	731.2	736.3	731.8	717.2
G141.5	738.0	738.3	737.7	736.3	735.9	737.1	740.3	744.1	740.4	726.6
G142.0	744.8	745.2	744.6	743.4	744.4	745.7	749.5	751.9	749.2	735.6
G142.5	751.6	752.0	751.5	750.8	752.7	754.4	758.6	759.7	757.8	744.3
G143.0	758.4	758.9	758.4	758.8	760.9	763.1	767.7	767.5	766.2	752.4
G143.5	765.2	765.7	765.5	766.8	769.0	771.7	775.2	775.3	774.8	760.3
G144.0	771.9	772.5	773.2	774.7	777.0	780.5	782.7	783.0	783.0	768.0
G144.5	778.7	779.8	780.9	782.6	785.1	789.3	790.3	790.7	789.6	775.3
G145.0	785.8	787.0	788.6	790.5	793.2	797.6	797.6	798.4	796.3	782.8
G145.5	792.9	794.3	796.3	798.3	801.4	804.9	805.0	806.0	802.8	790.1
G146.0	800.0	801.7	803.9	806.0	809.5	812.0	812.4	813.6	809.5	797.6
G146.5	807.2	808.9	811.5	813.7	817.2	819.2	819.8	821.2	816.4	805.3
G147.0	814.3	816.2	819.0	821.5	824.3	826.4	827.1	827.6	822.8	813.1
G147.5	821.5	823.5	826.6	829.2	831.3	833.6	834.4	833.5	829.3	821.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	828.6	830.7	834.0	836.1	838.3	840.7	841.7	839.4	835.7	824.8
G148.5	835.8	837.9	841.4	843.0	845.4	847.7	849.0	845.1	841.9	827.7
G149.0	843.0	845.1	848.2	849.8	852.4	854.8	854.9	850.6	848.0	831.1
G149.5	850.1	851.9	855.1	856.7	859.4	861.9	859.8	856.0	854.1	833.9
G150.0	856.9	858.7	861.8	863.6	866.4	868.7	864.8	861.1	860.0	837.5
G150.5	863.6	865.4	868.6	870.4	873.5	874.6	869.4	866.0	865.7	840.8
G151.0	870.4	872.2	875.4	877.3	880.6	878.1	873.9	871.0	867.0	843.8
G151.5	877.1	879.0	882.2	884.2	887.5	881.8	877.9	875.8	868.1	847.0
G152.0	883.9	885.8	889.0	891.1	892.2	885.6	881.5	880.6	869.2	849.3
G152.5	890.6	892.5	895.9	898.0	895.4	889.4	884.9	885.4	870.1	851.8
G153.0	897.5	899.3	902.7	903.4	898.7	893.2	888.1	887.2	870.8	853.8
G153.5	904.3	906.0	909.5	907.0	902.1	896.9	891.7	886.6	871.5	855.6
G154.0	911.2	912.7	913.8	910.7	905.7	900.5	895.4	885.9	871.8	857.4
G154.5	918.0	918.2	917.6	914.4	909.2	904.1	899.0	884.6	872.0	858.2
G155.0	923.4	922.5	921.5	918.2	912.9	907.8	898.7	883.2	871.8	858.9
G155.5	927.9	927.0	925.6	922.0	916.7	911.4	897.4	881.4	871.0	859.7
G156.0	932.4	931.5	929.7	925.8	920.6	915.1	895.9	879.8	870.2	859.8
G156.5	937.0	936.1	933.9	929.6	924.5	914.0	894.5	877.8	868.6	859.6
G157.0	941.4	940.6	938.3	933.6	928.6	912.6	893.1	875.5	866.5	858.4
G157.5	945.7	945.2	942.7	937.6	929.6	911.4	891.9	873.9	864.0	856.8
G158.0	950.2	949.9	947.2	941.8	928.4	910.3	890.7	872.2	861.2	854.4
G158.5	954.5	954.6	951.8	942.3	927.4	909.5	889.9	870.4	858.5	851.3
G159.0	958.9	959.3	955.1	942.0	926.6	908.8	889.2	869.6	856.2	847.9
G159.5	963.3	963.1	955.5	941.8	926.0	908.4	888.7	869.7	855.7	845.5
G160.0	966.1	964.5	956.2	942.0	925.6	908.1	888.6	870.5	855.4	843.3
G160.5	967.8	966.0	957.3	942.4	925.5	908.0	888.7	872.1	856.1	842.1
G161.0	969.4	967.4	958.6	943.1	925.6	908.1	889.8	873.9	857.8	842.8
G161.5	971.1	968.9	960.2	944.2	925.9	908.4	892.0	876.1	859.7	843.8
G162.0	972.8	970.4	962.1	945.7	926.7	909.3	894.3	878.6	862.4	846.3
G162.5	974.5	972.1	963.9	947.6	927.9	911.9	896.9	881.4	865.4	849.2
G163.0	976.2	973.9	965.8	949.8	930.4	915.2	899.9	884.5	868.7	852.4
G163.5	977.9	975.8	967.8	952.2	935.0	918.8	903.1	887.8	872.4	855.0
G164.0	979.6	977.7	970.1	957.0	940.1	922.8	906.7	891.4	876.4	857.6
G164.5	981.3	979.7	973.5	962.1	945.8	927.9	910.9	895.3	880.6	860.7
G165.0	983.1	981.9	977.2	967.1	951.9	933.8	916.0	899.9	883.8	863.9
G165.5	984.9	983.9	980.4	972.1	958.2	940.2	921.6	904.7	886.7	867.4
G166.0	986.8	986.1	983.2	976.5	964.4	947.2	927.9	910.4	890.2	871.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G166.5	988.6	988.1	985.9	980.3	970.0	954.3	935.7	914.9	893.8	875.1
G167.0	990.4	990.2	988.5	984.2	975.5	961.8	944.1	919.4	897.9	879.6
G167.5	992.3	992.1	991.1	987.9	981.1	969.5	949.5	924.8	903.3	884.3
G168.0	994.1	994.1	993.6	991.6	986.5	975.4	954.5	931.0	908.7	889.7
G168.5	996.0	996.0	995.8	994.4	990.4	978.5	960.1	937.5	915.2	895.9
G169.0	997.8	997.8	997.8	997.0	992.3	982.3	966.1	944.4	922.8	902.2
G169.5	999.6	999.7	999.8	998.6	994.7	986.8	971.3	952.0	930.6	911.0
G170.0	1001.4	1001.5	1001.3	1000.4	997.6	989.7	976.9	960.1	939.8	920.0
G170.5	1003.0	1003.1	1003.0	1002.5	999.5	993.2	983.3	967.5	949.5	930.2
G171.0	1004.7	1004.8	1004.8	1004.1	1001.8	997.2	988.4	975.3	959.4	941.8
G171.5	1006.4	1006.5	1006.5	1005.9	1004.2	1000.8	993.3	984.0	969.1	954.9
G172.0	1008.1	1008.2	1008.2	1007.7	1006.9	1003.5	998.7	989.9	979.5	969.3
G172.5	1009.8	1010.0	1009.9	1009.7	1008.8	1006.6	1003.0	996.5	989.0	983.4
G173.0	1011.5	1011.6	1011.6	1011.7	1010.8	1009.9	1006.5	1003.2	998.3	994.3
G173.5	1013.3	1013.3	1013.4	1013.4	1013.0	1012.1	1010.3	1008.2	1006.9	1003.3
G174.0	1015.0	1015.0	1015.1	1015.1	1015.3	1014.5	1014.2	1013.0	1011.7	1011.1
G174.5	1016.8	1016.8	1016.8	1016.9	1017.1	1017.2	1016.9	1017.0	1016.3	1015.7
G175.0	1018.5	1018.5	1018.6	1018.8	1019.0	1019.5	1019.6	1019.6	1019.9	1020.2
G175.5	1020.2	1020.4	1020.4	1020.7	1021.0	1021.3	1021.9	1022.1	1022.4	1023.0
G176.0	1022.0	1022.1	1022.3	1022.5	1022.9	1023.2	1023.6	1024.2	1024.8	1025.3
G176.5	1023.7	1023.9	1024.1	1024.3	1024.7	1025.0	1025.5	1025.9	1026.5	1027.2
G177.0	1025.5	1025.6	1025.8	1026.1	1026.4	1026.7	1027.2	1027.6	1028.1	1028.7
G177.5	1027.2	1027.3	1027.5	1027.8	1028.1	1028.4	1028.7	1029.2	1029.7	1030.2
G178.0	1028.9	1029.0	1029.2	1029.5	1029.8	1030.0	1030.3	1030.6	1031.1	1031.5
G178.5	1030.6	1030.7	1030.9	1031.0	1031.2	1031.5	1031.8	1032.1	1032.4	1032.7
G179.0	1032.3	1032.3	1032.5	1032.6	1032.7	1032.9	1033.1	1033.3	1033.6	1033.8
G179.5	1034.0	1034.0	1034.0	1034.1	1034.2	1034.3	1034.4	1034.5	1034.6	1034.8
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4241.6	4242.7	4243.4	4244.5	4245.6	4246.7	4247.8	4246.7	4245.6	4244.9
G1.0	4232.1	4233.5	4235.7	4237.5	4239.7	4241.9	4244.1	4241.9	4240.1	4238.3
G1.5	4221.8	4224.4	4227.3	4230.2	4233.2	4236.4	4240.1	4236.8	4233.9	4231.3
G2.0	4212.0	4215.3	4218.9	4222.9	4226.9	4231.3	4235.7	4231.7	4227.7	4224.0
G2.5	4201.7	4206.1	4210.5	4215.6	4220.7	4226.2	4232.1	4226.9	4221.8	4217.1
G3.0	4191.5	4196.6	4202.1	4208.3	4214.5	4221.5	4228.4	4221.8	4216.0	4210.1
G3.5	4180.9	4186.4	4192.2	4199.2	4206.5	4214.2	4222.6	4214.9	4207.9	4201.4
G4.0	4168.1	4174.7	4181.6	4189.7	4198.1	4207.2	4216.4	4207.9	4199.9	4192.2
G4.5	4155.7	4162.6	4169.9	4178.3	4187.8	4197.7	4208.7	4198.8	4189.7	4181.6
G5.0	4141.4	4148.8	4157.2	4166.7	4177.3	4188.6	4200.6	4189.7	4179.4	4170.3
G5.5	4126.8	4134.9	4144.0	4153.9	4165.2	4177.6	4191.1	4178.7	4167.8	4157.5
G6.0	4111.5	4119.5	4129.4	4140.3	4152.8	4166.7	4181.3	4167.8	4155.7	4144.4
G6.5	4095.0	4103.8	4114.4	4126.1	4139.3	4153.9	4169.6	4155.3	4142.2	4130.5
G7.0	4078.2	4087.4	4098.3	4111.1	4125.4	4140.7	4157.9	4142.5	4128.3	4115.9
G7.5	4061.1	4070.9	4082.6	4096.1	4111.1	4127.9	4146.2	4129.8	4114.8	4101.2
G8.0	4043.9	4054.5	4066.9	4081.2	4097.2	4115.1	4134.1	4117.0	4100.9	4086.6
G8.5	4026.7	4038.0	4051.2	4066.2	4083.0	4102.3	4122.8	4104.2	4087.0	4072.0
G9.0	4009.9	4021.2	4034.7	4050.5	4068.7	4089.2	4111.8	4091.4	4073.1	4056.7
G9.5	3992.4	4003.7	4017.9	4034.4	4053.0	4074.6	4098.3	4076.8	4057.4	4041.0
G10.0	3974.1	3985.4	3999.3	4016.5	4036.6	4059.6	4084.8	4061.8	4041.3	4023.4
G10.5	3957.6	3965.7	3980.3	3998.2	4019.0	4042.8	4069.5	4045.3	4023.8	4005.5
G11.0	3940.1	3945.6	3960.6	3978.8	4000.8	4026.0	4054.1	4028.5	4005.9	3986.5
G11.5	3922.6	3924.4	3939.7	3959.1	3981.8	4008.1	4037.7	4010.6	3987.2	3967.1
G12.0	3904.3	3904.7	3918.9	3939.0	3962.8	3990.2	4020.9	3992.7	3968.2	3947.4
G12.5	3886.0	3885.7	3897.7	3918.9	3943.4	3971.9	4004.1	3974.8	3949.2	3927.3
G13.0	3867.4	3867.0	3876.9	3898.5	3924.0	3953.6	3986.9	3956.9	3930.2	3907.2
G13.5	3848.8	3848.0	3855.3	3878.0	3904.3	3935.4	3970.1	3938.6	3910.9	3887.5
G14.0	3829.8	3829.0	3833.8	3856.4	3884.2	3916.7	3953.3	3920.0	3891.1	3866.7
G14.5	3811.1	3810.0	3812.2	3835.2	3863.0	3896.3	3934.6	3899.9	3870.0	3845.8
G15.0	3792.1	3790.3	3791.8	3811.1	3840.4	3875.8	3916.4	3879.5	3847.7	3821.7
G15.5	3772.8	3770.6	3769.5	3787.0	3816.6	3852.4	3894.1	3856.1	3823.5	3797.6
G16.0	3753.8	3749.0	3747.2	3761.1	3791.8	3828.7	3871.8	3831.9	3798.7	3771.7
G16.5	3733.7	3727.8	3723.8	3735.1	3766.5	3804.2	3848.0	3807.5	3773.5	3745.4
G17.0	3713.6	3705.5	3700.4	3708.8	3741.0	3779.3	3823.9	3783.0	3748.3	3719.8
G17.5	3693.1	3683.2	3677.4	3682.9	3715.8	3755.2	3800.9	3758.9	3723.1	3694.2
G18.0	3671.9	3660.9	3654.4	3657.3	3690.5	3731.1	3777.9	3735.1	3698.6	3668.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G18.5	3650.7	3638.4	3631.4	3631.4	3665.7	3707.3	3755.6	3711.4	3673.7	3643.6
G19.0	3629.0	3615.9	3608.4	3607.4	3641.0	3683.6	3733.3	3687.6	3649.2	3619.9
G19.5	3606.6	3593.4	3585.5	3584.2	3615.4	3659.1	3711.0	3663.5	3623.9	3597.0
G20.0	3580.1	3570.8	3562.5	3559.7	3588.7	3634.6	3688.7	3638.8	3597.3	3572.6
G20.5	3553.4	3548.2	3538.8	3534.2	3561.2	3607.7	3663.5	3611.9	3569.8	3547.3
G21.0	3526.6	3525.5	3514.5	3508.0	3532.2	3580.3	3637.8	3584.6	3540.8	3521.3
G21.5	3499.5	3502.5	3489.8	3481.2	3502.8	3551.4	3610.1	3555.7	3511.4	3494.5
G22.0	3472.4	3479.7	3464.1	3454.0	3472.4	3522.2	3582.4	3526.5	3481.1	3467.4
G22.5	3444.8	3455.8	3438.4	3426.4	3442.1	3492.7	3553.5	3497.2	3450.9	3439.8
G23.0	3417.0	3428.1	3412.0	3398.9	3412.1	3463.2	3524.6	3467.9	3421.4	3412.6
G23.5	3388.4	3398.5	3385.7	3371.7	3382.0	3434.0	3497.1	3439.0	3391.9	3385.8
G24.0	3359.1	3368.5	3359.0	3344.4	3351.6	3404.9	3469.7	3410.2	3361.9	3359.0
G24.5	3329.7	3338.2	3332.4	3316.7	3320.7	3374.8	3441.6	3380.1	3331.5	3332.0
G25.0	3299.5	3307.2	3305.7	3288.9	3288.2	3344.3	3413.5	3349.7	3299.0	3304.8
G25.5	3269.2	3276.1	3279.1	3259.7	3255.6	3312.6	3382.4	3318.0	3266.4	3276.2
G26.0	3238.5	3244.8	3251.9	3230.7	3223.0	3280.6	3351.3	3286.0	3233.9	3247.6
G26.5	3207.6	3213.4	3224.5	3201.4	3190.5	3248.7	3320.1	3254.1	3201.3	3218.4
G27.0	3176.3	3181.4	3196.7	3172.2	3159.4	3216.7	3288.9	3222.2	3170.4	3189.2
G27.5	3144.6	3149.2	3166.3	3143.4	3129.6	3185.0	3258.1	3190.5	3140.8	3160.4
G28.0	3112.7	3116.8	3133.6	3114.6	3100.1	3153.4	3227.3	3158.8	3111.2	3131.7
G28.5	3084.4	3084.5	3101.3	3085.9	3070.5	3121.8	3197.3	3127.2	3081.6	3103.2
G29.0	3058.6	3052.4	3068.9	3057.2	3040.4	3090.2	3167.3	3095.6	3051.5	3074.7
G29.5	3033.4	3020.2	3036.2	3028.3	3010.3	3058.0	3136.7	3063.4	3021.4	3045.6
G30.0	3008.5	2988.0	3003.6	2999.3	2979.4	3025.5	3106.2	3031.0	2990.5	3016.6
G30.5	2983.7	2955.3	2970.4	2969.8	2948.6	2992.3	3074.4	2997.9	2959.7	2987.1
G31.0	2958.9	2922.6	2937.2	2940.2	2916.9	2958.7	3042.7	2964.4	2928.2	2957.5
G31.5	2934.4	2889.3	2903.4	2910.2	2885.2	2924.8	3009.3	2930.6	2896.7	2927.6
G32.0	2909.5	2855.6	2869.4	2880.1	2853.7	2890.8	2976.0	2896.7	2865.5	2897.6
G32.5	2884.7	2823.3	2835.1	2849.9	2822.3	2857.5	2943.0	2863.3	2834.3	2867.7
G33.0	2859.8	2795.7	2800.9	2819.6	2791.8	2824.6	2910.0	2830.2	2803.8	2837.7
G33.5	2834.4	2768.2	2766.5	2789.5	2761.5	2791.5	2878.8	2796.8	2773.3	2808.0
G34.0	2809.2	2740.8	2732.1	2759.5	2730.7	2758.3	2847.6	2763.4	2742.2	2778.4
G34.5	2783.4	2713.5	2698.0	2727.9	2699.9	2724.0	2814.7	2729.1	2710.9	2746.8
G35.0	2757.7	2686.4	2664.3	2694.6	2668.3	2689.3	2781.9	2694.4	2679.0	2712.7
G35.5	2732.1	2659.5	2630.7	2661.1	2636.5	2654.6	2747.6	2659.8	2647.0	2678.3
G36.0	2706.5	2632.9	2596.9	2626.6	2604.7	2619.8	2713.3	2625.2	2615.2	2643.2
G36.5	2670.8	2606.7	2563.1	2592.0	2572.9	2585.3	2679.7	2590.6	2583.5	2608.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	2634.5	2580.5	2528.2	2556.6	2541.2	2550.9	2646.0	2556.2	2552.1	2572.8
G37.5	2598.3	2554.3	2493.2	2521.3	2509.7	2517.1	2612.5	2522.2	2520.8	2537.7
G38.0	2562.3	2528.3	2458.3	2486.3	2478.7	2483.6	2579.0	2488.4	2489.7	2503.0
G38.5	2526.4	2502.0	2428.8	2451.4	2447.9	2450.6	2546.8	2455.1	2458.7	2468.3
G39.0	2490.7	2475.9	2400.5	2417.0	2417.6	2417.8	2514.5	2422.0	2428.0	2433.5
G39.5	2455.3	2449.7	2372.5	2382.7	2387.7	2384.2	2482.9	2388.1	2397.5	2398.6
G40.0	2419.9	2423.4	2344.8	2349.1	2357.6	2350.0	2451.1	2353.6	2366.8	2364.0
G40.5	2384.2	2397.2	2317.7	2315.6	2327.4	2315.5	2417.2	2319.0	2336.0	2329.6
G41.0	2348.3	2365.3	2290.7	2282.1	2296.9	2280.9	2383.3	2284.4	2305.0	2295.0
G41.5	2312.5	2328.6	2264.1	2248.3	2266.1	2246.6	2349.5	2250.1	2273.7	2260.3
G42.0	2276.4	2292.4	2237.6	2214.1	2235.3	2212.3	2315.8	2216.0	2242.6	2225.4
G42.5	2240.6	2256.4	2210.9	2179.6	2204.5	2178.0	2282.6	2181.7	2211.7	2190.5
G43.0	2205.0	2220.9	2184.3	2145.0	2173.8	2143.6	2249.5	2147.1	2181.1	2155.8
G43.5	2174.2	2185.8	2157.7	2110.3	2143.2	2109.5	2215.7	2112.9	2150.7	2121.5
G44.0	2143.8	2150.8	2131.2	2075.8	2112.7	2075.7	2181.8	2078.8	2120.4	2087.1
G44.5	2114.1	2115.8	2104.7	2041.7	2082.5	2042.2	2148.9	2045.3	2089.8	2052.7
G45.0	2084.6	2081.0	2078.1	2007.6	2052.4	2009.1	2115.9	2011.9	2059.4	2018.2
G45.5	2055.3	2045.9	2051.7	1973.7	2022.1	1977.7	2083.4	1980.4	2028.8	1983.8
G46.0	2026.3	2010.7	2025.2	1940.1	1988.3	1946.8	2051.0	1949.3	1994.7	1949.6
G46.5	1997.7	1975.4	1998.8	1913.2	1955.3	1915.9	2018.4	1918.1	1961.2	1922.4
G47.0	1969.2	1939.9	1969.0	1886.3	1922.3	1884.8	1985.9	1886.9	1927.8	1895.1
G47.5	1940.9	1904.4	1933.7	1859.7	1889.2	1854.2	1953.4	1856.1	1894.2	1868.0
G48.0	1912.9	1871.7	1898.6	1833.3	1856.0	1823.9	1921.0	1825.5	1860.6	1841.1
G48.5	1885.1	1842.6	1863.6	1806.6	1822.6	1794.1	1889.3	1795.5	1826.7	1813.8
G49.0	1857.7	1813.6	1829.2	1779.9	1789.2	1764.7	1857.7	1765.9	1792.8	1786.7
G49.5	1823.5	1784.9	1795.4	1753.6	1756.6	1735.2	1826.9	1736.4	1759.7	1759.7
G50.0	1787.6	1756.6	1761.7	1727.3	1724.1	1705.7	1796.1	1706.9	1726.7	1732.8
G50.5	1751.8	1728.9	1727.6	1701.3	1692.1	1676.3	1764.9	1677.3	1694.6	1706.3
G51.0	1716.2	1701.4	1693.5	1675.9	1660.2	1646.8	1733.8	1647.5	1662.6	1680.3
G51.5	1680.8	1674.2	1659.3	1650.5	1628.3	1617.6	1702.1	1617.9	1630.2	1654.5
G52.0	1645.7	1647.4	1625.2	1625.7	1596.5	1588.6	1670.6	1588.4	1597.8	1629.5
G52.5	1611.1	1620.9	1591.6	1601.0	1564.8	1559.9	1639.7	1559.2	1565.0	1604.7
G53.0	1576.7	1594.5	1558.4	1576.6	1533.3	1531.4	1608.8	1530.4	1532.2	1580.1
G53.5	1542.6	1568.6	1525.4	1552.4	1501.7	1503.1	1578.6	1502.0	1500.0	1555.9
G54.0	1508.6	1539.2	1495.7	1528.7	1470.2	1475.0	1548.5	1473.9	1468.0	1531.1
G54.5	1475.4	1504.6	1468.8	1505.4	1438.8	1447.0	1518.7	1445.9	1436.6	1506.3
G55.0	1450.8	1470.1	1442.5	1474.3	1407.5	1419.3	1489.0	1418.2	1405.5	1473.5

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G55.5	1426.4	1435.9	1416.5	1441.6	1376.5	1391.6	1459.4	1390.5	1374.4	1439.3
G56.0	1402.3	1402.1	1390.8	1408.9	1345.5	1363.9	1429.9	1362.7	1343.4	1405.8
G56.5	1378.4	1368.5	1365.3	1375.9	1314.6	1336.4	1400.0	1335.0	1312.2	1373.0
G57.0	1354.8	1335.4	1340.1	1343.2	1283.8	1309.1	1370.1	1307.4	1280.9	1340.4
G57.5	1331.5	1302.4	1315.0	1310.7	1258.5	1282.1	1340.7	1280.1	1255.1	1308.1
G58.0	1308.6	1269.8	1290.3	1278.3	1234.3	1255.6	1311.2	1253.2	1230.3	1275.8
G58.5	1286.2	1237.5	1265.7	1246.3	1210.4	1229.3	1282.7	1226.5	1205.7	1243.4
G59.0	1264.1	1207.4	1241.4	1214.3	1187.3	1203.5	1254.3	1200.2	1181.6	1211.0
G59.5	1237.0	1184.6	1214.6	1182.8	1164.2	1177.8	1226.0	1174.1	1157.7	1178.8
G60.0	1206.2	1162.0	1181.6	1151.6	1141.3	1152.2	1197.6	1148.5	1134.3	1146.7
G60.5	1175.7	1139.7	1148.7	1120.9	1118.6	1126.7	1169.9	1123.0	1111.1	1114.9
G61.0	1145.5	1117.6	1116.3	1091.1	1096.1	1101.6	1142.2	1098.0	1088.6	1083.7
G61.5	1115.5	1095.9	1084.0	1067.3	1073.7	1076.5	1115.0	1073.1	1066.2	1059.3
G62.0	1085.8	1074.5	1052.1	1043.5	1051.6	1051.8	1087.8	1048.5	1044.3	1035.7
G62.5	1056.4	1053.3	1020.6	1020.1	1029.6	1027.1	1060.5	1023.9	1022.7	1012.3
G63.0	1027.1	1032.5	989.2	997.0	1007.9	1002.8	1033.3	999.5	1001.2	989.6
G63.5	998.7	1007.6	958.5	974.1	986.5	978.6	1006.3	975.2	979.8	967.1
G64.0	975.2	977.7	928.8	951.6	965.4	952.2	979.2	948.7	958.7	945.0
G64.5	952.0	948.0	908.2	929.5	944.5	924.2	953.1	920.6	937.7	923.4
G65.0	929.0	918.8	888.0	907.8	914.6	896.8	927.1	893.0	907.8	902.1
G65.5	906.2	889.9	868.0	886.7	885.2	869.5	901.6	865.5	878.2	881.2
G66.0	883.8	861.3	848.5	863.0	856.0	842.6	876.2	838.0	848.8	857.8
G66.5	861.6	833.0	829.2	832.8	827.2	815.6	850.7	810.5	819.6	827.4
G67.0	839.8	804.9	810.3	802.8	798.4	788.6	825.1	782.9	790.3	797.3
G67.5	813.8	782.0	792.0	773.1	770.0	761.5	800.0	755.2	760.8	767.4
G68.0	784.0	760.7	770.4	743.7	741.4	735.0	775.0	728.4	731.3	737.7
G68.5	754.3	739.7	742.6	714.5	712.9	708.5	751.2	701.6	702.0	708.1
G69.0	724.8	719.0	715.5	685.7	684.3	682.6	727.3	675.5	672.8	678.7
G69.5	695.6	698.5	688.6	657.2	656.1	656.7	704.3	649.4	644.3	649.4
G70.0	666.6	678.4	662.0	634.9	635.1	631.1	681.2	623.6	623.5	626.6
G70.5	637.8	658.2	635.4	617.6	615.6	605.5	658.2	598.0	604.3	609.0
G71.0	613.9	629.7	608.9	600.7	596.3	580.2	635.1	572.5	585.6	591.9
G71.5	593.5	601.5	587.7	584.2	577.5	554.9	612.4	547.0	567.2	575.4
G72.0	573.3	573.4	568.4	568.3	558.8	530.0	589.8	521.5	549.6	559.4
G72.5	553.4	545.6	549.3	552.7	540.3	512.2	566.9	503.1	532.3	543.8
G73.0	533.7	518.0	530.6	534.1	522.3	494.9	544.0	485.2	515.7	525.4
G73.5	514.3	490.9	512.2	506.7	498.4	477.9	521.2	467.7	493.8	498.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	493.8	472.0	493.8	478.4	468.3	461.5	498.3	450.6	466.1	472.4
G74.5	468.0	453.4	465.4	449.4	438.3	445.5	476.2	434.1	438.5	446.4
G75.0	442.5	435.2	437.5	419.8	408.3	430.0	454.1	418.1	410.9	420.5
G75.5	417.1	417.2	409.6	390.1	378.7	414.9	432.5	402.7	383.7	395.0
G76.0	391.9	399.5	382.0	372.2	349.2	400.4	410.9	387.7	356.7	379.2
G76.5	366.8	379.0	354.4	355.0	332.0	386.3	390.1	373.3	341.6	363.9
G77.0	344.2	354.2	336.3	338.9	317.2	360.3	369.2	348.6	329.0	349.2
G77.5	329.0	329.3	319.2	323.5	302.6	332.7	348.8	323.3	316.9	335.0
G78.0	314.0	304.4	302.3	301.5	288.6	304.0	328.3	297.9	305.5	315.0
G78.5	299.2	279.5	285.8	273.1	268.8	272.9	308.4	272.5	289.1	289.4
G79.0	284.6	258.0	266.5	245.4	239.5	241.0	288.5	247.0	263.9	264.0
G79.5	270.2	244.5	241.5	218.3	210.1	212.4	269.6	224.0	238.9	238.9
G80.0	255.4	231.2	216.6	198.8	180.8	197.7	250.7	212.2	214.0	220.4
G80.5	240.4	218.1	191.8	186.1	165.6	184.6	232.3	201.2	198.9	207.7
G81.0	225.6	205.4	168.9	173.9	157.1	172.9	213.9	191.2	188.4	195.4
G81.5	210.9	191.9	157.6	162.2	149.1	159.3	196.0	179.1	178.6	183.6
G82.0	196.4	177.5	146.5	140.7	133.7	132.5	178.2	153.4	160.9	161.7
G82.5	183.0	163.4	135.7	120.1	113.1	106.7	161.1	127.7	137.2	140.1
G83.0	172.4	149.4	125.0	100.2	93.4	86.6	144.1	106.5	113.8	118.8
G83.5	161.8	135.6	113.5	89.6	85.3	81.6	128.1	101.3	103.2	107.1
G84.0	151.4	126.7	102.3	82.0	79.8	78.0	112.2	97.4	95.3	98.6
G84.5	141.0	118.3	91.4	74.7	70.2	61.6	97.7	77.6	82.3	90.4
G85.0	130.6	110.1	82.9	66.8	55.6	43.8	83.2	55.3	62.6	79.7
G85.5	118.0	102.1	77.0	58.9	44.2	42.1	70.3	51.3	47.0	68.3
G86.0	105.6	92.5	71.2	51.2	40.8	36.6	57.5	42.9	42.4	57.2
G86.5	93.1	81.4	65.6	47.0	37.0	22.9	44.9	23.0	37.1	51.4
G87.0	80.8	70.4	57.3	43.2	30.6	22.0	32.4	20.2	27.9	46.2
G87.5	68.5	59.5	48.9	39.0	26.0	14.1	22.9	10.5	21.3	40.4
G88.0	57.4	49.1	40.6	33.0	24.6	10.9	13.4	5.1	19.9	31.9
G88.5	46.4	40.1	33.0	27.1	21.8	9.5	10.9	4.0	16.3	23.4
G89.0	35.4	31.2	26.3	22.0	17.5	10.0	8.3	4.0	10.6	16.2
G89.5	24.5	22.3	19.7	17.4	14.7	9.8	9.1	3.9	6.7	9.8
G90.0	15.0	14.8	14.6	14.2	13.7	11.8	10.9	4.4	4.0	3.9
G90.5	28.9	28.3	27.3	26.2	24.3	19.7	8.3	8.5	8.4	8.7
G91.0	30.5	29.5	28.0	26.5	24.0	19.2	8.8	9.3	9.7	10.3
G91.5	32.1	30.8	28.8	26.8	24.3	17.9	9.5	9.8	11.2	12.0
G92.0	33.7	32.1	29.7	27.2	24.1	17.6	10.3	10.7	12.3	14.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G92.5	35.4	33.6	30.9	27.7	23.4	18.2	12.8	11.5	13.1	16.1
G93.0	37.2	35.2	32.0	27.9	23.7	20.2	15.3	13.4	14.8	17.5
G93.5	39.0	36.8	33.1	28.1	24.5	20.6	18.4	13.3	17.0	18.9
G94.0	40.8	38.4	33.7	28.3	24.8	24.0	21.5	17.0	18.3	20.3
G94.5	42.7	39.8	34.3	29.1	25.2	25.5	23.9	18.4	19.5	22.9
G95.0	44.6	40.9	34.9	30.0	27.5	26.3	26.2	18.6	23.0	25.5
G95.5	46.1	42.1	36.1	31.0	30.5	29.6	29.0	24.1	27.2	27.9
G96.0	47.6	43.3	37.8	32.1	32.5	32.6	31.8	29.1	30.1	29.9
G96.5	49.1	44.5	39.5	33.2	33.7	33.2	35.0	30.2	31.8	31.9
G97.0	50.7	46.6	41.2	34.9	35.4	34.0	38.3	31.4	34.2	34.6
G97.5	52.2	48.6	42.7	38.5	39.0	37.4	41.9	36.5	39.3	39.3
G98.0	54.2	50.7	44.2	42.1	42.8	41.7	45.6	42.5	44.5	44.1
G98.5	56.4	52.8	45.7	45.9	45.6	46.1	49.4	48.4	48.5	49.0
G99.0	58.6	54.7	47.3	47.9	47.2	48.2	53.3	51.1	50.6	51.7
G99.5	60.8	56.4	50.7	50.1	48.9	49.9	57.4	53.3	53.0	54.5
G100.0	63.0	58.2	54.4	52.3	51.6	51.9	61.4	55.7	56.4	57.4
G100.5	65.2	60.1	58.1	55.4	56.1	54.0	65.8	58.4	61.9	61.6
G101.0	67.2	62.0	61.8	59.6	60.7	58.0	70.1	63.5	67.6	67.3
G101.5	69.4	65.0	64.6	63.8	65.4	62.6	74.6	69.2	73.3	73.1
G102.0	71.5	68.5	66.9	67.9	68.6	67.1	79.2	74.9	77.1	78.9
G102.5	73.7	72.1	69.3	71.2	70.9	71.7	83.9	80.8	79.8	83.5
G103.0	76.0	75.7	71.6	73.5	73.3	76.4	88.7	86.7	82.6	86.8
G103.5	79.4	79.3	74.1	76.0	75.9	81.0	93.6	92.6	85.6	90.2
G104.0	83.1	82.3	78.1	78.4	79.0	83.2	98.5	96.0	89.2	93.7
G104.5	86.9	84.8	82.0	80.9	84.3	85.6	103.7	99.5	95.8	97.4
G105.0	90.7	87.3	85.9	85.3	89.6	88.1	108.8	103.2	102.3	103.6
G105.5	94.6	89.8	89.9	89.6	94.8	90.7	114.3	107.0	109.0	110.0
G106.0	98.4	92.5	93.9	94.0	99.9	93.5	119.7	110.9	115.8	116.5
G106.5	101.5	95.2	96.4	98.2	104.9	96.3	125.3	115.1	122.7	123.1
G107.0	104.4	99.3	99.0	102.5	108.8	99.3	131.0	119.3	128.2	129.8
G107.5	107.4	103.6	101.6	105.7	111.8	102.4	136.9	123.7	132.5	134.4
G108.0	110.4	107.9	104.2	108.4	114.8	105.5	142.9	128.2	136.9	138.5
G108.5	113.4	112.4	106.9	111.3	118.0	110.1	149.0	134.7	141.4	142.6
G109.0	116.6	116.9	110.1	114.1	121.1	114.8	155.2	141.3	146.2	146.8
G109.5	120.2	121.5	114.6	117.0	124.2	119.5	161.5	148.0	151.0	151.3
G110.0	124.8	124.5	119.3	119.9	127.4	124.4	167.7	154.8	156.1	155.8
G110.5	129.4	127.6	124.1	123.6	130.7	129.3	174.2	161.6	161.5	161.8

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	134.1	130.7	128.9	128.3	135.0	134.5	180.6	168.6	169.0	169.6
G111.5	139.0	133.9	133.8	133.0	139.3	139.7	187.4	175.7	176.5	177.5
G112.0	144.0	137.2	138.8	137.9	143.8	145.3	194.1	182.9	184.2	185.6
G112.5	149.1	140.6	142.7	142.9	148.4	150.9	201.1	190.2	192.1	193.7
G113.0	153.7	144.3	146.1	148.1	153.0	156.9	208.2	197.7	200.0	202.2
G113.5	157.5	149.2	149.6	153.4	158.1	162.9	215.7	205.3	208.2	210.8
G114.0	161.3	154.1	153.1	158.7	163.4	169.4	223.2	213.2	216.5	219.5
G114.5	165.2	159.2	156.6	163.0	168.9	176.0	230.9	221.0	225.1	226.3
G115.0	169.4	164.4	160.2	166.8	174.7	183.0	238.6	229.2	233.8	232.4
G115.5	173.6	169.8	163.7	170.6	180.7	190.1	246.6	237.3	242.7	238.8
G116.0	177.9	175.5	167.2	174.5	185.4	197.6	254.5	245.8	249.1	245.3
G116.5	182.5	181.4	172.2	178.3	190.2	204.7	262.8	253.8	255.5	251.9
G117.0	190.1	186.6	177.4	182.2	195.2	211.5	271.1	261.3	262.0	258.8
G117.5	198.3	191.2	182.8	186.0	200.4	218.5	279.7	268.8	268.6	265.8
G118.0	207.1	195.9	188.3	189.7	205.5	225.5	288.2	276.5	275.5	273.1
G118.5	216.4	200.9	194.4	193.5	210.9	232.7	297.2	284.3	282.4	280.5
G119.0	226.1	206.3	200.7	197.2	216.1	239.8	306.1	292.4	289.6	288.1
G119.5	236.3	211.7	207.4	202.6	221.6	247.1	315.6	300.6	296.9	297.9
G120.0	247.2	217.7	214.8	208.6	227.1	254.2	325.0	309.1	304.5	307.9
G120.5	258.5	224.0	222.6	214.8	232.7	261.5	334.7	317.6	312.1	318.2
G121.0	268.5	230.3	229.5	221.5	238.5	268.8	344.4	326.3	319.8	328.6
G121.5	276.7	240.3	235.8	229.0	244.4	276.1	354.2	335.1	327.7	339.1
G122.0	285.1	251.5	242.6	236.6	250.7	283.7	364.0	344.1	335.8	349.8
G122.5	293.7	263.3	249.9	245.5	257.1	291.3	374.2	353.1	344.0	360.7
G123.0	302.5	276.0	257.2	254.6	264.0	299.2	384.4	362.3	352.5	371.7
G123.5	311.4	289.2	265.6	264.8	272.4	307.1	394.7	371.7	363.0	382.8
G124.0	320.4	303.0	274.1	275.4	281.3	315.2	404.9	381.1	373.6	393.9
G124.5	329.4	317.1	283.3	286.8	290.6	323.4	415.4	390.7	384.3	405.0
G125.0	338.5	331.5	293.1	298.8	300.2	331.8	426.0	400.4	395.2	416.2
G125.5	347.5	345.6	303.2	311.1	310.3	340.3	436.8	410.2	406.1	427.1
G126.0	359.9	359.8	314.4	322.2	320.7	349.0	447.6	420.1	417.1	435.5
G126.5	372.5	371.3	327.7	333.2	331.6	357.7	458.4	430.1	428.0	443.9
G127.0	384.8	381.0	343.8	345.2	342.7	366.7	469.2	440.1	438.9	452.5
G127.5	396.9	391.1	360.1	356.9	354.4	375.7	479.9	450.1	449.9	461.1
G128.0	409.0	400.7	376.1	369.3	366.3	384.9	490.6	460.2	461.0	469.7
G128.5	420.8	410.4	391.7	381.5	379.0	394.3	501.3	470.2	472.1	478.4
G129.0	432.6	420.0	406.8	393.7	391.7	404.0	512.1	480.4	483.3	487.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G129.5	444.4	429.4	420.6	405.9	405.0	413.8	522.8	490.6	494.4	496.0
G130.0	456.3	438.8	434.2	417.4	418.2	423.7	533.5	500.8	505.6	504.8
G130.5	468.1	448.0	446.4	428.7	431.4	433.9	544.3	511.0	516.8	513.7
G131.0	479.5	457.2	458.4	439.5	444.5	444.0	555.0	521.2	528.1	522.6
G131.5	488.4	466.3	469.9	449.5	456.5	454.2	566.0	531.4	539.1	531.4
G132.0	497.4	475.4	481.0	459.3	468.4	464.2	577.0	541.7	550.1	540.2
G132.5	506.6	485.5	492.1	468.3	479.1	474.0	587.4	552.2	561.0	549.2
G133.0	515.9	496.5	502.9	477.2	489.5	483.4	597.8	562.4	571.9	558.1
G133.5	525.2	507.5	512.0	485.5	499.3	492.3	608.2	572.4	582.8	567.1
G134.0	534.9	518.8	520.0	493.8	508.9	501.0	618.5	582.5	593.6	576.1
G134.5	544.5	530.2	528.0	503.6	518.2	509.3	628.8	592.5	604.1	586.6
G135.0	554.4	541.6	536.3	513.4	526.5	517.6	639.1	602.6	613.4	597.1
G135.5	564.5	553.2	544.7	523.4	535.0	526.1	648.7	613.3	622.6	607.6
G136.0	574.6	564.8	553.2	533.6	543.5	534.7	658.3	623.7	631.7	618.0
G136.5	585.2	576.6	561.8	544.1	552.6	543.3	668.0	633.7	640.7	628.1
G137.0	595.8	588.3	570.3	554.8	561.9	552.3	677.8	643.8	649.6	638.1
G137.5	608.4	600.2	578.9	565.5	571.5	561.9	687.1	653.9	658.2	647.8
G138.0	621.1	612.1	587.3	576.2	581.2	571.9	696.4	663.9	666.6	657.6
G138.5	633.7	624.0	595.4	586.5	590.6	582.5	705.0	673.5	675.2	667.3
G139.0	646.3	636.3	603.4	596.1	599.8	593.2	713.5	682.9	683.7	677.0
G139.5	658.8	646.5	610.8	605.1	608.4	603.8	722.5	692.0	692.3	686.7
G140.0	671.0	654.6	617.9	613.1	616.2	613.7	731.4	701.2	700.8	696.1
G140.5	683.1	662.3	624.6	620.6	623.2	622.6	740.0	710.5	709.2	705.4
G141.0	694.9	669.6	630.9	627.1	629.2	630.3	748.5	719.6	717.3	714.5
G141.5	705.9	676.6	637.1	633.3	634.4	636.0	756.6	728.5	725.4	723.5
G142.0	716.6	683.2	643.3	639.1	638.5	640.7	764.7	737.3	733.4	732.1
G142.5	726.5	689.2	650.5	644.7	642.2	643.4	773.0	745.9	741.3	740.6
G143.0	735.6	695.0	657.3	649.9	645.3	645.5	781.3	754.5	749.0	748.7
G143.5	744.4	699.6	663.7	654.9	648.1	646.4	788.6	762.9	756.6	756.9
G144.0	752.1	703.8	669.2	659.1	650.5	647.1	796.0	771.1	763.8	764.9
G144.5	754.8	706.9	674.2	662.9	652.7	647.3	803.0	778.7	771.0	772.8
G145.0	757.2	709.1	677.7	665.4	654.3	647.3	810.0	786.4	778.0	780.7
G145.5	759.5	710.8	680.3	667.2	655.5	646.6	817.0	793.7	785.0	788.6
G146.0	761.7	711.9	681.7	666.9	655.6	645.3	824.0	801.2	792.0	795.8
G146.5	764.0	712.7	682.4	665.4	655.3	642.7	831.1	808.6	799.1	802.5
G147.0	766.5	714.8	683.6	663.8	653.1	639.3	838.1	816.0	806.0	809.1
G147.5	769.5	716.8	685.7	661.9	650.6	633.6	844.9	823.3	812.9	815.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	772.9	721.4	688.8	661.3	645.6	627.3	851.8	830.5	819.7	822.1
G148.5	776.7	727.2	694.1	662.4	640.6	619.8	858.4	837.6	826.5	828.4
G149.0	781.6	733.9	699.9	664.4	636.9	613.4	865.1	844.7	833.1	834.5
G149.5	787.0	742.0	708.2	669.0	633.0	610.3	871.6	851.7	839.6	840.5
G150.0	793.4	751.0	716.7	674.2	635.0	609.2	878.1	858.5	846.0	846.5
G150.5	800.5	762.1	728.3	681.9	636.7	613.8	883.9	865.0	852.3	852.3
G151.0	807.8	773.9	740.5	690.1	643.7	620.0	889.8	871.4	858.3	858.1
G151.5	814.9	786.3	755.2	701.4	650.7	631.0	895.5	877.5	864.2	863.9
G152.0	823.2	798.8	770.9	712.9	661.9	643.5	901.2	883.5	870.0	869.6
G152.5	829.3	809.6	786.0	727.8	673.2	660.6	906.7	889.5	875.8	875.1
G153.0	835.3	818.9	799.0	742.9	689.2	679.1	912.2	895.3	881.5	880.6
G153.5	839.9	826.7	808.7	759.1	706.6	702.0	917.3	901.0	887.4	885.9
G154.0	843.6	832.0	816.1	775.8	728.8	725.2	922.4	906.7	893.3	891.1
G154.5	846.9	837.1	823.0	789.2	751.6	748.5	927.2	912.0	899.0	896.2
G155.0	849.2	840.4	827.5	802.7	771.4	770.3	932.1	917.2	904.5	901.3
G155.5	851.2	843.6	832.1	811.5	790.3	786.2	937.0	922.5	910.0	906.4
G156.0	852.0	845.4	835.0	819.2	802.3	800.5	941.9	927.6	915.4	911.3
G156.5	852.4	846.7	837.9	824.3	812.4	808.4	946.3	932.6	920.8	916.0
G157.0	852.0	847.0	839.1	828.5	818.5	815.5	950.8	937.5	925.9	920.6
G157.5	851.0	846.5	840.4	831.3	823.2	819.2	954.6	941.8	930.8	925.1
G158.0	849.5	845.5	840.4	833.4	826.1	822.3	958.3	946.1	935.4	929.3
G158.5	846.5	843.7	840.2	834.4	828.2	823.2	962.4	950.5	939.9	933.6
G159.0	843.2	841.6	838.9	834.5	828.5	823.7	966.6	954.8	944.5	938.0
G159.5	839.3	838.1	837.0	833.6	827.9	821.9	970.4	959.0	949.1	942.3
G160.0	835.3	834.5	834.2	831.9	825.7	819.6	974.3	963.3	953.7	946.6
G160.5	832.2	830.5	830.5	829.2	822.5	815.1	978.3	967.6	958.2	950.9
G161.0	830.8	826.1	826.2	825.4	817.9	810.2	982.4	971.9	962.7	955.1
G161.5	829.3	822.7	821.1	820.6	812.2	803.2	986.0	975.9	967.0	959.4
G162.0	830.1	819.6	816.0	814.1	805.7	796.2	989.7	979.9	971.2	963.7
G162.5	830.5	817.5	811.3	807.5	798.7	788.9	992.7	983.4	975.1	967.9
G163.0	832.3	817.0	806.8	801.4	792.8	781.9	995.8	986.9	978.8	971.8
G163.5	834.5	816.7	805.2	796.2	787.8	778.2	998.9	990.2	982.5	975.6
G164.0	837.1	819.1	803.3	794.8	785.7	775.2	1001.9	993.5	985.9	979.3
G164.5	840.5	821.2	805.6	794.1	786.3	777.6	1004.6	996.5	989.3	983.0
G165.0	844.1	825.4	807.9	798.3	789.3	780.7	1007.2	999.5	992.6	986.5
G165.5	848.3	829.7	812.4	802.5	795.0	787.7	1009.8	1002.5	995.8	989.9
G166.0	852.6	834.6	818.2	809.6	801.7	795.0	1012.4	1005.4	999.0	993.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G166.5	857.3	839.9	825.3	816.9	809.9	804.0	1015.1	1008.3	1002.1	996.7
G167.0	862.2	845.5	832.8	825.1	818.4	813.2	1017.6	1011.1	1005.1	999.7
G167.5	867.5	851.5	840.7	833.5	827.5	823.0	1019.6	1013.5	1007.8	1002.7
G168.0	873.0	857.6	849.0	842.4	836.9	832.8	1021.7	1015.8	1010.3	1005.4
G168.5	878.9	864.7	857.6	851.4	846.5	843.1	1023.3	1017.8	1012.6	1008.0
G169.0	885.8	873.2	866.8	861.2	856.7	853.5	1025.0	1019.8	1015.0	1010.5
G169.5	892.9	883.4	876.9	871.5	867.8	865.4	1027.0	1022.0	1017.3	1013.0
G170.0	902.3	894.1	888.8	884.0	880.1	877.8	1029.0	1024.2	1019.7	1015.6
G170.5	915.2	908.1	901.7	897.5	894.9	893.8	1030.9	1026.4	1022.1	1018.2
G171.0	930.2	923.1	917.8	913.6	910.9	910.2	1032.9	1028.5	1024.4	1020.7
G171.5	946.5	939.5	934.4	931.3	929.8	930.2	1034.2	1030.2	1026.4	1022.9
G172.0	962.7	956.8	952.2	949.5	948.8	950.1	1035.6	1031.8	1028.2	1024.9
G172.5	977.1	972.8	970.1	967.9	967.5	969.2	1036.3	1032.9	1029.6	1026.5
G173.0	991.3	987.0	984.7	984.1	985.2	987.9	1037.1	1034.0	1030.9	1028.1
G173.5	1000.9	999.8	998.7	997.8	998.6	1000.8	1037.7	1034.8	1032.0	1029.4
G174.0	1009.5	1008.3	1008.1	1009.0	1010.8	1013.4	1038.3	1035.7	1033.2	1030.8
G174.5	1015.7	1016.2	1015.9	1016.5	1017.7	1019.7	1039.3	1036.9	1034.6	1032.3
G175.0	1020.1	1020.4	1021.3	1022.4	1024.0	1025.9	1040.3	1038.0	1035.9	1033.8
G175.5	1023.8	1024.4	1025.0	1026.0	1027.2	1028.7	1040.9	1038.9	1037.0	1035.2
G176.0	1025.9	1026.7	1027.7	1028.9	1030.1	1031.5	1041.5	1039.8	1038.1	1036.5
G176.5	1028.0	1028.7	1029.5	1030.4	1031.5	1032.6	1042.0	1040.5	1039.1	1037.7
G177.0	1029.4	1030.1	1030.9	1031.8	1032.6	1033.6	1042.5	1041.2	1040.0	1038.7
G177.5	1030.8	1031.4	1032.0	1032.7	1033.5	1034.3	1042.5	1041.4	1040.3	1039.3
G178.0	1032.0	1032.5	1033.1	1033.7	1034.3	1034.9	1042.3	1041.5	1040.6	1039.8
G178.5	1033.1	1033.5	1033.9	1034.3	1034.8	1035.2	1041.4	1040.8	1040.3	1039.6
G179.0	1034.1	1034.3	1034.6	1034.9	1035.3	1035.6	1040.5	1040.2	1039.8	1039.4
G179.5	1034.9	1035.0	1035.2	1035.3	1035.4	1035.6	1039.7	1039.6	1039.4	1039.1
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 40)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4243.8	4243.0	4242.3	4241.6	4240.8	4240.5	4240.1	4239.7	4239.4	4239.0
G1.0	4236.4	4234.6	4233.2	4231.7	4230.6	4229.5	4228.4	4227.7	4227.3	4226.9
G1.5	4228.4	4226.2	4223.7	4221.8	4220.0	4218.5	4217.1	4216.0	4215.3	4214.5
G2.0	4220.4	4217.4	4214.2	4211.6	4209.0	4207.2	4205.4	4203.9	4202.8	4202.1
G2.5	4212.7	4208.3	4204.7	4201.4	4198.4	4195.9	4193.7	4191.9	4190.4	4189.7
G3.0	4204.7	4199.5	4194.8	4190.8	4187.1	4184.2	4181.6	4179.8	4178.3	4177.3
G3.5	4195.2	4189.7	4184.9	4180.2	4175.8	4172.5	4169.6	4167.8	4165.9	4164.8
G4.0	4184.9	4178.7	4173.2	4168.1	4164.1	4160.4	4157.2	4155.0	4153.5	4152.0
G4.5	4174.0	4167.4	4161.2	4155.7	4151.3	4147.7	4144.7	4142.2	4140.3	4139.6
G5.0	4161.9	4154.2	4148.0	4142.5	4137.8	4134.1	4131.2	4129.0	4127.6	4126.8
G5.5	4148.8	4141.1	4134.1	4128.3	4123.9	4120.3	4117.0	4115.5	4114.0	4113.7
G6.0	4134.5	4126.1	4119.5	4113.7	4108.6	4105.3	4103.1	4100.9	4101.6	4102.0
G6.5	4120.3	4111.1	4103.4	4097.6	4093.6	4089.9	4087.7	4088.5	4089.2	4090.7
G7.0	4104.9	4095.4	4087.7	4081.2	4076.8	4074.2	4074.6	4076.4	4077.1	4079.0
G7.5	4089.6	4079.3	4070.9	4064.7	4060.0	4060.0	4061.8	4063.6	4065.4	4067.3
G8.0	4074.2	4063.6	4054.5	4047.5	4044.2	4045.7	4048.6	4050.8	4053.7	4055.6
G8.5	4058.9	4047.5	4038.0	4030.7	4030.0	4031.8	4034.7	4038.4	4041.3	4043.9
G9.0	4042.8	4031.5	4022.0	4015.7	4015.7	4017.9	4021.2	4025.6	4028.9	4032.6
G9.5	4026.7	4014.3	4005.1	4001.9	4001.9	4004.1	4008.1	4012.5	4017.2	4020.9
G10.0	4008.4	3996.7	3987.2	3987.2	3988.0	3989.8	3994.2	3999.7	4005.1	4009.2
G10.5	3990.2	3977.7	3971.5	3972.3	3974.1	3976.3	3980.7	3986.9	3992.7	3997.5
G11.0	3970.8	3958.4	3954.7	3957.3	3959.1	3962.4	3966.8	3973.7	3980.7	3986.1
G11.5	3950.3	3937.6	3938.3	3940.8	3944.5	3948.5	3953.3	3960.2	3968.2	3971.9
G12.0	3929.9	3918.2	3920.4	3924.8	3929.5	3934.3	3939.7	3947.1	3952.9	3957.3
G12.5	3909.0	3899.9	3902.8	3908.0	3914.2	3920.4	3926.2	3931.3	3936.5	3941.9
G13.0	3888.6	3881.6	3884.9	3890.8	3898.5	3906.1	3912.3	3914.5	3919.6	3926.2
G13.5	3868.1	3863.4	3866.7	3874.0	3882.4	3891.5	3895.5	3897.7	3903.2	3910.9
G14.0	3846.9	3845.1	3848.8	3856.1	3865.9	3876.9	3878.4	3880.9	3886.4	3895.2
G14.5	3826.1	3826.8	3830.5	3838.2	3849.5	3857.2	3859.7	3863.7	3870.0	3879.1
G15.0	3806.4	3807.8	3812.2	3820.3	3832.3	3837.1	3841.1	3846.6	3853.5	3862.6
G15.5	3784.1	3788.8	3793.9	3802.4	3813.7	3816.6	3822.1	3829.0	3837.1	3846.6
G16.0	3761.8	3768.0	3775.7	3784.4	3791.8	3795.0	3802.0	3811.1	3820.6	3830.5
G16.5	3738.4	3747.2	3756.7	3766.9	3769.8	3773.5	3781.5	3792.1	3803.4	3814.4
G17.0	3715.4	3724.9	3737.3	3749.4	3747.9	3751.6	3760.7	3773.1	3786.3	3802.4
G17.5	3692.4	3702.6	3717.9	3727.8	3726.0	3730.0	3739.9	3754.1	3771.3	3789.9
G18.0	3669.3	3680.3	3696.4	3705.2	3704.4	3708.4	3718.3	3733.7	3758.1	3777.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 41)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G18.5	3647.0	3658.0	3675.6	3681.8	3682.5	3686.9	3696.4	3717.2	3744.3	3765.8
G19.0	3624.7	3635.5	3653.5	3655.8	3658.8	3665.0	3675.2	3701.9	3730.7	3753.4
G19.5	3602.2	3613.7	3630.8	3630.2	3635.1	3643.3	3656.2	3686.9	3717.2	3741.3
G20.0	3579.8	3591.8	3604.6	3604.1	3610.3	3621.5	3640.5	3671.5	3703.7	3728.9
G20.5	3556.6	3570.0	3578.7	3577.9	3584.5	3597.5	3624.6	3656.2	3690.2	3716.8
G21.0	3532.5	3548.2	3552.7	3551.8	3558.7	3576.1	3608.5	3641.0	3676.3	3704.8
G21.5	3508.1	3525.6	3526.6	3526.1	3533.1	3557.6	3592.5	3625.8	3662.4	3693.1
G22.0	3482.6	3503.1	3500.4	3500.4	3507.6	3538.5	3576.6	3610.6	3649.0	3677.8
G22.5	3457.0	3479.6	3473.2	3474.2	3482.3	3519.7	3560.0	3595.3	3635.5	3653.0
G23.0	3430.6	3452.1	3445.6	3447.7	3461.3	3501.0	3543.5	3579.9	3615.9	3628.0
G23.5	3404.4	3422.6	3417.3	3420.8	3442.0	3482.6	3527.4	3565.0	3588.5	3602.9
G24.0	3377.9	3392.4	3388.1	3392.7	3422.3	3464.1	3510.8	3549.1	3561.0	3577.7
G24.5	3351.5	3362.2	3358.7	3364.5	3402.2	3445.7	3493.8	3521.9	3533.6	3552.0
G25.0	3325.7	3331.5	3328.5	3335.6	3382.4	3427.6	3476.9	3494.7	3506.1	3525.8
G25.5	3300.1	3301.0	3298.3	3312.3	3361.9	3409.6	3457.9	3467.0	3478.9	3499.5
G26.0	3273.8	3271.0	3268.4	3289.5	3341.1	3391.6	3427.3	3439.0	3451.7	3473.1
G26.5	3247.3	3240.8	3238.6	3266.4	3320.5	3373.6	3397.1	3410.8	3424.7	3446.6
G27.0	3220.1	3209.8	3208.8	3243.5	3299.4	3355.7	3366.9	3382.1	3397.9	3419.9
G27.5	3189.7	3178.1	3178.5	3221.0	3278.5	3331.0	3337.2	3352.6	3371.1	3391.9
G28.0	3157.0	3146.1	3148.1	3198.6	3257.6	3298.9	3307.5	3323.2	3344.3	3363.2
G28.5	3124.6	3113.8	3120.1	3176.3	3236.6	3266.9	3277.8	3293.6	3316.8	3334.6
G29.0	3092.2	3081.6	3094.6	3153.9	3215.7	3234.7	3247.7	3264.3	3288.2	3306.1
G29.5	3059.8	3049.6	3069.6	3131.7	3194.9	3202.2	3217.0	3235.2	3259.0	3277.9
G30.0	3027.2	3017.7	3044.8	3109.2	3161.9	3169.7	3186.2	3206.1	3230.0	3249.8
G30.5	2993.9	2985.0	3020.1	3086.2	3128.5	3137.3	3155.1	3177.0	3201.3	3221.7
G31.0	2960.5	2952.1	2995.7	3063.7	3095.4	3104.5	3123.5	3147.8	3172.8	3193.7
G31.5	2926.6	2918.7	2971.5	3040.4	3062.3	3071.9	3092.3	3118.8	3144.2	3165.7
G32.0	2892.7	2884.9	2946.8	3017.1	3029.1	3039.3	3061.9	3090.0	3115.4	3137.8
G32.5	2858.6	2852.6	2922.3	2991.6	2995.1	3006.9	3031.7	3061.5	3086.9	3110.0
G33.0	2824.7	2825.2	2897.6	2957.2	2960.9	2974.6	3001.6	3032.5	3058.5	3077.1
G33.5	2790.7	2797.9	2872.2	2922.9	2926.6	2942.9	2971.7	3003.7	3030.3	3044.2
G34.0	2756.8	2771.0	2846.9	2888.2	2892.5	2912.0	2941.9	2975.2	2998.1	3011.3
G34.5	2722.9	2744.2	2821.3	2853.3	2858.6	2881.3	2912.2	2947.1	2963.6	2978.4
G35.0	2688.7	2717.7	2795.6	2818.1	2825.0	2850.9	2882.8	2918.5	2929.3	2945.4
G35.5	2654.4	2691.4	2770.1	2781.6	2791.4	2820.2	2853.6	2885.2	2895.1	2911.9
G36.0	2619.6	2665.1	2744.7	2745.2	2758.1	2789.6	2824.5	2849.3	2861.1	2878.3
G36.5	2584.6	2638.8	2709.0	2708.6	2727.0	2759.4	2795.5	2813.5	2827.1	2844.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 42)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	2549.6	2612.5	2673.3	2672.1	2695.1	2729.5	2766.8	2777.6	2793.2	2810.9
G37.5	2514.5	2585.5	2637.7	2635.7	2663.7	2699.8	2730.6	2741.7	2759.2	2777.0
G38.0	2480.1	2558.6	2601.9	2600.1	2632.4	2670.1	2694.2	2705.9	2725.3	2747.0
G38.5	2451.2	2531.6	2566.0	2565.0	2601.0	2640.8	2657.8	2670.3	2691.0	2719.3
G39.0	2423.2	2504.7	2529.9	2530.1	2569.8	2611.9	2621.5	2634.8	2656.9	2691.7
G39.5	2395.2	2478.1	2492.9	2498.4	2539.0	2578.9	2585.1	2599.3	2628.8	2664.1
G40.0	2367.3	2451.9	2455.9	2467.6	2508.4	2542.3	2548.6	2564.1	2600.9	2636.7
G40.5	2339.4	2425.8	2419.1	2436.7	2478.0	2505.3	2512.2	2528.9	2573.3	2609.2
G41.0	2311.7	2394.8	2382.4	2405.5	2448.0	2468.3	2475.9	2500.6	2545.7	2582.0
G41.5	2284.1	2358.7	2346.1	2374.7	2418.2	2431.2	2439.8	2472.6	2518.1	2554.9
G42.0	2256.6	2322.0	2310.5	2344.0	2387.4	2393.4	2404.1	2444.9	2490.7	2528.0
G42.5	2228.9	2285.4	2275.2	2313.5	2349.6	2355.7	2369.6	2417.4	2463.6	2501.2
G43.0	2201.4	2248.6	2239.8	2283.4	2312.4	2318.2	2341.9	2390.1	2436.6	2472.3
G43.5	2174.0	2211.8	2208.8	2253.5	2275.4	2280.7	2314.0	2362.6	2409.6	2440.4
G44.0	2146.8	2175.1	2178.1	2223.9	2238.5	2243.5	2286.5	2335.3	2382.7	2408.6
G44.5	2119.8	2138.5	2147.3	2194.5	2201.7	2206.4	2259.2	2308.2	2350.5	2376.9
G45.0	2093.3	2102.1	2116.9	2165.3	2165.1	2174.5	2232.0	2281.3	2317.1	2345.1
G45.5	2066.9	2065.9	2086.8	2130.9	2128.3	2146.7	2204.6	2254.4	2284.0	2313.3
G46.0	2040.9	2030.1	2056.9	2093.5	2091.5	2119.2	2177.6	2223.2	2250.9	2281.4
G46.5	2015.1	1994.5	2027.3	2056.7	2054.7	2091.9	2150.9	2189.5	2218.1	2249.7
G47.0	1984.7	1959.3	1998.0	2020.1	2018.1	2064.9	2124.5	2155.9	2185.5	2217.9
G47.5	1948.7	1924.3	1968.9	1983.5	1982.3	2038.1	2097.8	2122.6	2152.9	2185.7
G48.0	1912.8	1891.2	1940.2	1946.9	1954.7	2011.4	2064.9	2089.6	2120.6	2154.4
G48.5	1877.1	1861.6	1911.6	1910.4	1927.6	1984.9	2030.6	2056.7	2088.4	2124.5
G49.0	1841.9	1832.3	1883.2	1874.0	1900.9	1958.7	1996.4	2024.0	2055.6	2094.8
G49.5	1807.3	1803.1	1848.4	1837.6	1874.4	1932.9	1962.5	1991.4	2025.1	2065.2
G50.0	1772.8	1774.2	1812.1	1801.4	1848.0	1905.3	1928.8	1958.8	1995.6	2035.8
G50.5	1737.8	1746.0	1776.2	1765.2	1822.1	1872.1	1895.2	1926.1	1966.3	2006.6
G51.0	1702.8	1718.0	1740.5	1735.1	1796.4	1839.1	1861.9	1895.8	1937.2	1977.2
G51.5	1667.6	1690.2	1705.0	1708.6	1770.9	1806.2	1828.5	1867.0	1908.4	1948.0
G52.0	1632.4	1663.0	1669.5	1682.7	1745.8	1773.6	1795.3	1838.4	1879.5	1919.0
G52.5	1597.9	1635.9	1633.9	1657.1	1721.1	1740.7	1762.3	1809.9	1850.9	1890.1
G53.0	1564.3	1609.2	1598.5	1631.7	1688.9	1707.6	1733.5	1781.4	1822.3	1858.8
G53.5	1531.1	1583.0	1563.3	1606.7	1656.2	1674.6	1705.5	1753.2	1794.0	1824.9
G54.0	1501.4	1553.1	1528.4	1582.1	1623.4	1641.6	1677.7	1725.2	1765.7	1791.0
G54.5	1474.6	1517.4	1494.4	1557.8	1590.8	1608.9	1650.1	1697.5	1731.6	1757.1
G55.0	1447.5	1481.8	1469.5	1533.9	1558.3	1579.2	1622.6	1670.1	1697.6	1723.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 43)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G55.5	1420.5	1446.8	1445.1	1510.3	1525.7	1551.9	1595.4	1642.4	1663.8	1689.5
G56.0	1393.9	1412.2	1420.8	1480.9	1493.1	1524.9	1568.4	1608.3	1630.1	1655.8
G56.5	1367.4	1378.1	1396.6	1448.9	1460.7	1498.1	1541.6	1574.3	1596.6	1622.3
G57.0	1341.2	1344.7	1372.8	1416.8	1428.4	1471.6	1514.9	1540.5	1563.2	1588.8
G57.5	1315.7	1311.5	1349.4	1384.8	1399.3	1445.2	1485.2	1506.9	1529.9	1555.4
G58.0	1290.4	1278.2	1326.2	1352.9	1373.3	1419.1	1452.3	1473.5	1496.9	1525.8
G58.5	1265.7	1244.7	1303.3	1321.0	1347.4	1393.1	1419.7	1440.3	1463.9	1497.3
G59.0	1241.6	1213.5	1280.7	1289.4	1321.7	1367.5	1387.3	1407.2	1433.5	1468.8
G59.5	1215.1	1190.2	1252.8	1257.9	1296.4	1339.5	1354.9	1374.3	1405.7	1440.3
G60.0	1182.5	1167.2	1221.2	1227.0	1271.3	1307.1	1322.6	1341.5	1378.1	1412.0
G60.5	1149.9	1144.6	1190.0	1200.5	1246.5	1275.0	1290.4	1312.7	1350.5	1383.7
G61.0	1117.4	1122.6	1159.4	1175.9	1221.8	1242.8	1258.0	1285.8	1323.0	1355.5
G61.5	1084.9	1100.9	1129.1	1151.4	1197.5	1210.8	1225.6	1259.1	1295.6	1327.3
G62.0	1052.7	1079.6	1099.0	1127.1	1168.3	1178.8	1195.9	1232.5	1268.3	1299.3
G62.5	1020.8	1058.7	1068.9	1103.3	1136.8	1146.9	1170.0	1206.1	1241.2	1270.3
G63.0	989.2	1038.2	1038.8	1079.7	1105.4	1115.1	1144.3	1179.9	1214.2	1238.7
G63.5	957.8	1013.6	1009.6	1056.4	1073.9	1083.2	1118.9	1153.9	1186.8	1207.2
G64.0	927.2	984.0	986.2	1033.3	1042.6	1056.1	1093.6	1128.1	1155.9	1175.7
G64.5	906.3	954.5	963.4	1007.2	1011.4	1031.4	1068.5	1102.3	1125.0	1144.3
G65.0	886.1	925.0	940.8	976.3	980.4	1007.0	1043.5	1073.6	1094.3	1112.9
G65.5	866.1	895.9	918.4	945.5	949.4	982.8	1018.8	1043.1	1063.5	1081.6
G66.0	846.6	867.1	896.5	914.9	922.0	959.0	994.2	1012.7	1032.6	1050.4
G66.5	827.6	838.7	875.0	884.6	898.7	935.2	965.9	982.5	1001.8	1019.2
G67.0	808.7	810.7	853.6	854.6	875.7	911.6	936.2	952.3	971.0	988.1
G67.5	790.4	788.3	828.1	825.0	853.0	888.1	906.7	922.2	940.3	962.7
G68.0	769.0	767.3	798.9	795.5	830.6	862.3	877.3	892.2	909.6	938.6
G68.5	741.3	746.7	769.8	772.0	808.3	833.6	848.0	862.4	886.2	914.5
G69.0	714.0	726.5	740.9	750.5	786.2	805.0	818.9	832.6	863.1	890.5
G69.5	686.9	706.6	712.1	729.2	764.2	776.7	789.9	809.1	840.1	866.6
G70.0	659.9	687.0	683.4	708.1	738.1	748.5	761.1	787.1	817.3	842.8
G70.5	632.9	667.3	655.0	687.3	710.7	720.4	734.9	765.1	794.5	819.1
G71.0	606.0	638.8	631.5	666.7	683.4	692.5	713.9	743.3	771.7	795.5
G71.5	585.1	610.7	611.8	646.5	656.2	664.7	693.0	721.5	749.0	772.0
G72.0	566.3	582.9	592.3	622.1	629.2	640.9	672.2	699.8	726.4	749.2
G72.5	548.0	555.4	573.1	595.5	602.4	621.1	651.5	678.3	703.9	727.2
G73.0	530.2	528.3	554.1	569.1	575.5	601.4	630.9	656.7	682.1	705.1
G73.5	512.7	501.5	535.4	543.0	551.8	581.9	610.4	635.3	660.3	683.1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 44)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	495.4	483.3	515.6	517.0	533.2	562.4	590.0	614.2	638.6	661.1
G74.5	468.0	465.6	490.4	491.3	514.7	543.1	569.7	593.2	616.9	639.0
G75.0	440.9	448.2	465.4	465.7	496.6	524.0	549.4	572.3	595.3	617.0
G75.5	414.2	431.1	440.6	448.2	478.6	504.9	529.1	551.4	573.8	595.0
G76.0	387.8	414.3	415.9	431.3	460.8	485.4	508.8	530.6	552.3	573.0
G76.5	361.7	394.4	391.3	414.5	443.1	465.9	488.6	509.9	530.9	551.7
G77.0	345.1	370.2	369.0	398.0	425.1	446.4	468.5	489.2	509.9	531.8
G77.5	329.6	345.9	353.5	381.6	406.1	427.0	448.3	468.6	490.9	511.9
G78.0	314.5	321.9	338.2	365.3	387.4	407.8	428.3	449.8	471.9	492.1
G78.5	299.7	298.0	323.2	348.2	368.7	388.5	408.8	431.7	452.9	472.3
G79.0	282.2	277.1	308.3	330.4	350.1	369.3	391.6	413.6	434.0	452.5
G79.5	259.0	263.5	293.7	312.8	331.7	351.5	374.5	395.5	415.1	432.8
G80.0	235.9	250.1	277.7	295.3	313.4	335.5	357.4	377.6	396.2	413.2
G80.5	213.1	236.9	261.0	277.9	296.9	319.5	340.5	359.6	377.4	393.5
G81.0	191.9	223.9	244.4	260.6	282.1	303.6	323.6	341.7	358.6	373.7
G81.5	180.4	209.7	228.0	245.1	267.3	287.7	306.7	323.8	339.2	352.7
G82.0	169.2	194.1	211.7	231.6	252.6	272.0	289.9	305.3	319.0	331.8
G82.5	158.3	178.7	196.6	218.1	238.0	256.3	272.5	285.9	298.8	310.8
G83.0	147.0	163.6	184.5	204.8	223.5	240.2	253.9	266.6	278.7	289.9
G83.5	133.1	148.6	172.5	191.5	209.1	222.6	235.4	247.3	258.6	269.0
G84.0	119.5	137.9	160.6	178.3	192.6	205.1	216.9	228.0	238.5	248.2
G84.5	106.1	127.8	148.9	163.9	176.1	187.6	198.4	208.7	218.4	227.3
G85.0	95.3	117.8	137.0	148.6	159.7	170.1	180.0	189.5	198.4	206.5
G85.5	87.3	107.9	122.8	133.2	143.3	152.7	161.6	170.3	178.3	185.7
G86.0	79.5	96.5	108.7	118.0	126.9	135.4	143.3	151.2	158.8	165.6
G86.5	71.8	83.8	94.6	102.8	110.6	118.1	125.6	132.9	139.5	145.5
G87.0	61.2	71.2	80.6	87.6	94.8	101.8	108.2	114.5	120.3	125.4
G87.5	50.4	58.7	66.7	73.4	79.7	85.5	90.9	96.2	101.0	105.3
G88.0	39.7	46.6	54.1	59.5	64.6	69.3	73.6	77.9	81.8	85.2
G88.5	29.8	35.8	41.6	45.7	49.5	53.1	56.3	59.5	62.5	65.1
G89.0	21.0	25.0	29.1	31.8	34.4	36.9	39.1	41.2	43.3	45.1
G89.5	12.2	14.2	16.7	18.0	19.4	20.6	21.8	22.9	24.0	25.0
G90.0	3.8	3.8	4.7	4.7	4.8	4.9	5.0	5.1	5.3	5.5
G90.5	8.9	9.4	11.2	11.6	12.0	12.5	12.8	13.2	13.7	14.1
G91.0	11.0	11.9	14.0	14.6	15.3	16.0	16.6	17.1	17.7	18.2
G91.5	13.0	14.3	16.8	17.7	18.7	19.6	20.3	21.0	21.7	22.3
G92.0	15.3	16.8	19.5	20.7	22.0	23.1	24.0	24.8	25.7	26.4

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 45)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G92.5	17.8	19.6	22.3	23.8	25.3	26.6	27.7	28.7	29.7	30.5
G93.0	20.3	22.5	25.4	26.9	28.6	30.2	31.4	32.6	33.7	34.6
G93.5	22.7	25.4	28.4	30.3	32.1	33.7	35.1	36.4	37.7	38.7
G94.0	24.5	28.3	31.5	33.6	35.7	37.5	38.9	40.3	41.7	42.8
G94.5	26.3	31.0	34.7	37.0	39.2	41.2	42.8	44.3	45.7	46.9
G95.0	28.2	33.3	37.8	40.4	42.9	45.0	46.8	48.4	49.9	51.1
G95.5	30.7	35.6	40.4	43.8	46.5	48.8	50.7	52.4	54.0	55.3
G96.0	33.7	37.9	43.0	47.0	50.1	52.5	54.6	56.5	58.2	59.5
G96.5	36.8	40.3	45.6	49.9	53.7	56.3	58.6	60.5	62.3	63.8
G97.0	40.0	43.7	48.3	52.8	56.9	60.1	62.5	64.6	66.5	68.0
G97.5	42.6	47.1	50.9	55.8	60.1	63.6	66.5	68.7	70.7	72.2
G98.0	45.1	50.6	54.3	58.8	63.3	67.1	70.2	72.7	74.8	76.4
G98.5	47.7	54.1	57.9	61.7	66.5	70.5	73.8	76.6	79.0	80.7
G99.0	50.4	57.3	61.5	65.2	69.7	73.9	77.4	80.4	83.0	84.9
G99.5	55.3	60.4	65.1	69.0	73.0	77.4	81.1	84.2	86.9	89.0
G100.0	60.6	63.4	68.8	72.9	76.6	80.9	84.7	88.0	90.8	93.0
G100.5	65.9	66.6	72.4	76.8	80.6	84.4	88.4	91.8	94.8	97.0
G101.0	71.4	69.8	75.9	80.7	84.6	88.2	92.0	95.6	98.7	101.1
G101.5	75.5	74.6	79.4	84.6	88.6	92.3	95.7	99.4	102.6	105.1
G102.0	78.9	80.2	83.0	88.6	92.7	96.4	99.9	103.3	106.6	109.2
G102.5	82.5	85.8	86.6	92.5	96.7	100.5	104.1	107.2	110.5	113.2
G103.0	86.1	91.5	90.3	96.5	100.8	104.7	108.3	111.5	114.5	117.3
G103.5	90.0	97.3	95.7	100.5	105.1	108.8	112.6	115.8	118.8	121.4
G104.0	96.2	102.0	101.8	104.6	109.5	113.0	116.8	120.1	123.2	125.6
G104.5	102.5	106.1	107.9	108.7	113.9	117.3	121.1	124.4	127.5	130.0
G105.0	108.8	110.2	114.1	113.0	118.4	122.1	125.4	128.8	131.9	134.4
G105.5	115.2	114.4	120.3	119.5	122.9	126.9	129.7	133.1	136.3	138.7
G106.0	121.6	118.7	126.6	126.1	127.5	131.8	134.7	137.5	140.7	143.1
G106.5	125.7	123.2	131.6	132.7	132.1	136.7	139.9	141.8	145.0	147.5
G107.0	129.9	129.9	136.3	139.3	138.2	141.6	145.1	147.1	149.4	151.8
G107.5	134.1	136.6	141.1	146.1	145.2	146.6	150.4	152.6	153.9	156.2
G108.0	138.4	143.4	146.0	152.9	152.3	151.6	155.6	158.2	159.7	160.6
G108.5	142.9	150.3	151.0	159.1	159.5	157.8	161.0	163.7	165.4	165.8
G109.0	148.0	157.3	156.0	164.5	166.7	165.3	166.3	169.3	171.3	171.8
G109.5	155.1	164.5	162.0	169.9	173.9	172.8	171.6	174.9	177.1	177.9
G110.0	162.3	169.4	169.3	175.3	181.2	180.4	178.8	180.5	182.9	183.9
G110.5	169.6	174.3	176.7	180.9	188.1	188.0	186.7	186.2	188.8	190.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 46)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	177.1	179.3	184.2	186.5	194.0	195.7	194.6	192.3	194.6	196.1
G111.5	184.7	184.4	191.7	192.3	200.0	203.4	202.6	200.6	200.5	202.1
G112.0	192.6	189.6	199.4	198.6	206.0	211.2	210.7	208.9	206.5	208.3
G112.5	198.7	195.0	207.1	206.4	212.2	218.2	218.7	217.2	215.0	214.4
G113.0	204.0	200.9	213.7	214.3	218.4	224.7	226.8	225.5	223.5	221.0
G113.5	209.4	209.2	219.3	222.3	224.6	231.3	234.9	233.9	232.1	229.6
G114.0	215.0	217.5	224.9	230.4	231.0	238.0	242.8	242.3	240.6	238.4
G114.5	220.8	226.0	230.7	238.5	238.4	244.7	249.7	250.7	249.2	247.1
G115.0	226.8	234.6	236.6	246.7	246.7	251.4	256.8	259.1	257.8	255.8
G115.5	232.9	243.4	242.6	255.0	255.1	258.3	263.9	267.2	266.4	264.6
G116.0	239.2	252.3	248.6	262.0	263.6	265.2	271.0	274.7	275.0	273.3
G116.5	248.3	261.5	254.9	268.2	272.2	272.7	278.2	282.1	283.7	282.1
G117.0	257.8	269.2	263.8	274.5	280.8	281.4	285.5	289.6	291.6	290.9
G117.5	267.5	275.7	273.2	280.9	289.4	290.1	292.8	297.2	299.4	299.8
G118.0	277.4	282.3	282.7	287.4	298.1	298.9	300.1	304.8	307.3	308.0
G118.5	287.4	289.1	292.2	294.0	306.2	307.8	308.4	312.5	315.1	316.1
G119.0	297.6	296.1	301.9	300.7	313.0	316.7	317.3	320.2	323.0	324.3
G119.5	307.9	303.2	311.6	307.5	319.8	325.7	326.3	327.9	330.9	332.4
G120.0	318.4	310.5	321.5	315.4	326.8	334.7	335.3	336.1	338.9	340.6
G120.5	329.1	317.9	331.4	325.3	333.8	343.7	344.4	345.1	346.9	348.8
G121.0	337.7	325.4	340.3	335.2	340.9	351.6	353.6	354.2	355.0	357.0
G121.5	345.6	335.4	347.6	345.3	348.1	358.9	362.7	363.2	363.7	365.3
G122.0	353.6	346.3	355.2	355.5	355.4	366.2	372.0	372.3	372.9	373.6
G122.5	361.8	357.2	362.8	365.7	362.8	373.6	381.2	381.5	382.1	382.0
G123.0	370.1	368.3	370.6	376.0	371.7	381.0	389.5	390.6	391.4	391.1
G123.5	378.7	379.4	378.5	386.4	381.8	388.6	397.1	399.9	400.6	400.2
G124.0	387.3	390.5	386.5	396.7	392.0	396.2	404.8	409.1	409.8	409.4
G124.5	396.2	401.8	394.6	406.3	402.3	403.8	412.5	418.4	419.1	418.5
G125.0	405.2	413.2	402.9	414.2	412.6	411.6	420.3	426.3	428.4	427.7
G125.5	414.3	424.5	411.2	422.3	422.9	420.4	428.1	434.1	437.6	436.9
G126.0	423.6	435.8	422.3	430.3	433.3	430.4	436.0	442.1	446.9	446.1
G126.5	434.0	445.6	433.6	438.5	443.7	440.4	444.0	450.0	455.0	455.3
G127.0	445.3	454.5	444.9	446.8	454.0	450.5	452.0	458.0	463.1	464.6
G127.5	456.7	463.4	456.3	455.1	464.1	460.5	460.2	466.1	471.3	473.4
G128.0	468.2	472.4	467.8	463.4	472.3	470.6	469.9	474.2	479.5	481.7
G128.5	479.6	481.5	479.1	471.9	480.4	480.7	479.7	482.4	487.7	490.0
G129.0	491.0	490.8	490.5	480.4	488.5	490.8	489.4	490.6	495.9	498.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 47)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G129.5	502.4	500.1	501.9	490.0	496.8	500.9	498.9	499.2	504.2	506.6
G130.0	513.8	509.5	513.1	501.2	505.1	511.0	508.5	508.6	512.5	514.9
G130.5	525.3	519.0	524.4	512.4	513.3	519.5	518.1	518.1	520.9	523.3
G131.0	536.9	528.6	535.3	523.6	521.6	527.6	527.6	527.5	529.4	531.7
G131.5	548.3	538.2	544.2	534.8	530.0	535.7	537.2	536.9	538.3	540.1
G132.0	559.7	547.9	553.2	545.8	538.4	543.7	546.8	546.3	547.2	548.6
G132.5	571.1	558.4	562.3	556.9	546.8	551.9	556.0	555.7	556.0	557.2
G133.0	582.5	569.2	571.5	567.8	557.2	560.0	563.9	565.0	564.8	565.8
G133.5	592.0	580.0	580.8	578.7	567.7	568.2	571.7	574.2	573.6	574.3
G134.0	599.9	590.7	590.0	589.6	578.3	576.3	579.6	583.3	582.3	582.8
G134.5	607.8	601.3	599.3	600.4	588.9	584.6	587.5	591.9	591.1	591.4
G135.0	615.6	612.1	608.6	610.3	599.4	592.8	595.5	599.6	599.8	599.9
G135.5	623.3	622.9	617.8	618.9	609.9	601.7	603.4	607.2	608.6	608.4
G136.0	631.1	633.8	627.1	627.5	620.4	611.6	611.4	614.9	617.1	617.0
G136.5	638.9	644.4	636.3	636.2	630.8	621.5	619.4	622.6	624.6	625.5
G137.0	646.8	655.0	645.5	644.9	641.2	631.3	627.4	630.3	632.1	633.9
G137.5	654.7	665.3	655.3	653.5	651.5	641.1	635.3	637.9	639.6	641.7
G138.0	662.6	675.4	665.0	662.2	661.7	650.9	644.8	645.6	647.2	649.1
G138.5	670.4	685.5	674.6	671.0	670.1	660.8	654.5	653.3	654.8	656.4
G139.0	678.2	695.3	684.1	679.7	678.3	670.6	664.1	661.1	662.4	663.8
G139.5	685.7	703.6	693.6	688.4	686.4	680.5	673.6	668.8	669.9	671.2
G140.0	693.2	710.1	703.0	697.1	694.6	690.4	683.1	677.9	677.4	678.6
G140.5	700.5	716.6	712.4	705.8	702.8	700.2	692.5	686.9	685.0	685.9
G141.0	707.9	723.2	721.7	714.6	710.9	709.2	701.8	695.9	692.5	693.3
G141.5	715.1	729.6	730.9	723.5	719.1	717.3	711.1	704.9	701.1	700.7
G142.0	722.4	736.1	740.0	732.3	727.3	725.3	720.4	713.9	709.8	708.1
G142.5	730.8	742.5	749.1	740.9	735.5	733.3	729.7	722.9	718.4	715.9
G143.0	739.0	748.8	758.1	749.3	743.7	741.3	738.8	731.9	727.0	724.4
G143.5	747.1	755.2	767.0	757.6	752.0	749.3	746.4	741.0	735.7	732.8
G144.0	755.3	761.5	775.1	765.9	760.3	757.2	754.1	749.8	744.2	741.2
G144.5	763.3	767.7	780.6	774.1	768.5	765.2	761.8	758.6	752.8	749.6
G145.0	771.2	774.0	786.0	782.3	776.8	773.1	769.4	766.9	761.4	758.1
G145.5	779.1	780.2	791.4	790.6	784.8	781.0	777.0	774.5	769.9	766.3
G146.0	786.9	786.3	796.8	798.8	792.7	788.9	784.7	781.9	778.4	774.5
G146.5	794.6	792.4	802.2	807.0	800.7	796.8	792.4	789.4	786.4	782.7
G147.0	802.1	798.3	807.5	815.1	808.4	804.2	800.1	796.9	793.8	790.7
G147.5	809.5	804.1	812.9	823.1	816.1	811.6	807.8	804.3	801.3	798.8

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 48)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	816.7	810.7	818.3	828.6	823.7	818.9	815.5	811.8	808.7	806.0
G148.5	823.6	817.5	823.7	833.4	831.1	826.0	823.4	819.2	816.1	813.3
G149.0	830.5	824.3	829.0	838.2	838.5	833.1	830.8	826.7	823.5	820.6
G149.5	837.2	831.1	834.3	842.9	845.8	840.2	837.9	834.2	831.0	827.8
G150.0	843.9	837.8	839.5	847.5	852.9	847.5	844.6	841.6	838.5	835.1
G150.5	850.5	844.4	844.7	852.2	859.9	854.6	851.2	848.8	846.0	842.3
G151.0	857.1	850.9	849.7	856.8	864.0	861.9	857.7	855.3	853.5	849.5
G151.5	863.5	857.3	854.7	861.4	868.2	868.7	864.2	861.7	861.0	856.8
G152.0	869.8	863.5	860.1	865.8	872.4	875.5	870.7	868.0	867.6	864.0
G152.5	875.8	869.6	866.0	870.2	876.6	882.2	877.2	874.4	873.8	871.3
G153.0	881.4	875.6	871.9	874.6	880.9	887.3	883.7	880.9	879.8	877.8
G153.5	886.5	881.5	877.6	878.8	885.1	890.9	890.1	887.3	885.6	883.5
G154.0	891.5	887.2	883.2	883.1	889.0	894.5	896.4	893.7	891.3	889.1
G154.5	896.5	892.9	888.6	887.4	893.0	898.1	902.7	900.0	897.0	894.8
G155.0	901.3	898.2	893.9	891.7	897.0	901.7	906.7	906.4	902.6	900.4
G155.5	906.0	903.3	899.1	897.1	900.8	905.3	910.2	912.2	908.3	906.1
G156.0	910.3	908.5	904.4	902.5	904.7	908.8	913.7	917.9	914.0	911.6
G156.5	914.8	913.7	909.8	907.8	908.5	912.3	917.1	920.9	919.7	917.2
G157.0	919.2	919.0	915.0	912.7	912.2	915.8	920.3	923.7	925.3	922.8
G157.5	923.6	923.9	920.1	917.6	916.3	919.3	923.7	926.6	929.3	928.3
G158.0	928.0	928.3	925.1	922.3	920.8	922.8	926.9	929.5	931.9	933.9
G158.5	932.4	932.4	929.9	926.9	925.3	926.2	930.0	932.4	934.6	937.2
G159.0	936.7	936.6	934.6	931.5	929.7	929.7	933.1	935.2	937.3	939.8
G159.5	940.9	940.5	939.1	935.9	934.1	933.7	936.3	938.1	940.1	942.3
G160.0	945.2	944.5	943.5	940.3	938.4	938.1	939.2	940.9	942.7	944.9
G160.5	949.3	948.3	947.8	944.6	942.7	942.2	942.2	943.7	945.4	947.6
G161.0	953.3	952.1	951.4	948.9	947.0	946.2	945.5	946.5	948.2	950.2
G161.5	957.1	955.7	955.1	953.2	951.3	950.1	949.1	949.3	950.9	952.7
G162.0	961.0	959.3	958.6	957.3	955.2	953.7	952.5	952.2	953.6	955.2
G162.5	964.5	962.9	962.1	961.4	959.0	957.3	956.0	955.6	956.3	957.8
G163.0	968.1	966.4	965.5	965.2	962.7	960.7	959.5	959.0	959.3	960.4
G163.5	971.6	970.0	968.9	968.2	966.2	964.1	962.9	962.4	962.6	962.9
G164.0	975.1	973.3	972.1	971.2	969.7	967.5	966.3	965.8	965.8	965.7
G164.5	978.4	976.6	975.2	974.2	973.1	970.9	969.7	969.1	968.8	968.5
G165.0	981.7	979.8	978.3	977.1	976.0	974.3	973.1	972.3	971.8	971.2
G165.5	984.9	983.0	981.3	980.0	978.8	977.7	976.4	975.6	974.8	974.0
G166.0	988.4	986.0	984.3	982.7	981.5	981.0	979.7	978.7	977.6	976.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 49)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G166.5	991.8	989.0	987.1	985.5	984.3	983.8	982.9	981.6	980.3	979.4
G167.0	995.0	991.9	989.9	988.2	987.1	986.6	986.0	984.4	983.0	982.2
G167.5	998.1	994.7	992.6	990.9	989.9	989.3	988.6	987.1	985.6	984.9
G168.0	1000.9	997.2	995.2	993.6	992.7	991.9	991.0	989.7	988.3	987.6
G168.5	1003.7	999.9	997.8	996.4	995.4	994.5	993.3	992.0	991.0	990.4
G169.0	1006.4	1002.7	1000.5	999.2	998.1	997.0	995.7	994.3	993.5	993.0
G169.5	1009.1	1005.7	1003.2	1001.8	1000.7	999.3	998.0	996.7	995.8	995.4
G170.0	1012.0	1008.7	1005.9	1004.6	1003.2	1001.8	1000.2	999.0	998.3	997.8
G170.5	1014.7	1011.5	1008.8	1007.1	1005.5	1004.0	1002.5	1001.3	1000.6	1000.1
G171.0	1017.3	1014.3	1011.7	1009.4	1007.9	1006.2	1004.7	1003.6	1002.9	1002.4
G171.5	1019.8	1016.8	1014.2	1012.0	1010.0	1008.3	1006.9	1006.0	1005.3	1004.6
G172.0	1021.8	1019.0	1016.5	1014.1	1012.1	1010.5	1009.1	1008.3	1007.7	1007.0
G172.5	1023.7	1021.0	1018.5	1016.2	1014.2	1012.5	1011.4	1010.6	1010.0	1009.3
G173.0	1025.3	1022.7	1020.4	1018.3	1016.4	1014.7	1013.7	1013.0	1012.2	1011.6
G173.5	1026.9	1024.5	1022.4	1020.4	1018.6	1017.2	1016.1	1015.3	1014.5	1013.9
G174.0	1028.5	1026.4	1024.4	1022.6	1021.0	1019.7	1018.5	1017.6	1016.8	1016.2
G174.5	1030.2	1028.2	1026.4	1024.7	1023.3	1022.1	1020.9	1020.0	1019.1	1018.5
G175.0	1031.8	1030.1	1028.4	1027.0	1025.5	1024.3	1023.3	1022.3	1021.5	1020.8
G175.5	1033.5	1031.8	1030.3	1028.9	1027.6	1026.5	1025.5	1024.5	1023.7	1023.0
G176.0	1034.9	1033.5	1032.0	1030.8	1029.7	1028.6	1027.5	1026.7	1026.0	1025.0
G176.5	1036.3	1035.0	1033.8	1032.6	1031.5	1030.4	1029.5	1028.8	1027.8	1027.0
G177.0	1037.4	1036.3	1035.2	1034.1	1033.2	1032.3	1031.4	1030.4	1029.6	1028.8
G177.5	1038.3	1037.3	1036.4	1035.5	1034.6	1033.7	1032.9	1032.0	1031.3	1030.6
G178.0	1038.9	1038.0	1037.2	1036.4	1035.6	1034.9	1034.2	1033.5	1032.9	1032.3
G178.5	1039.0	1038.3	1037.7	1037.1	1036.6	1036.0	1035.4	1034.9	1034.5	1034.0
G179.0	1039.0	1038.6	1038.2	1037.7	1037.4	1037.0	1036.6	1036.3	1036.0	1035.7
G179.5	1038.9	1038.8	1038.6	1038.3	1038.2	1038.0	1037.8	1037.6	1037.4	1037.3
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 50)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4239.0	4239.0	4239.0	4239.4	4239.4	4239.7	4239.7	4240.1	4240.5	4241.2
G1.0	4226.6	4226.6	4226.9	4227.3	4227.7	4228.0	4228.4	4229.1	4229.9	4231.0
G1.5	4214.2	4214.2	4214.5	4215.3	4216.0	4216.4	4217.4	4218.2	4219.6	4221.1
G2.0	4201.7	4201.7	4202.1	4203.2	4204.3	4205.0	4206.1	4207.6	4209.4	4211.2
G2.5	4189.3	4189.3	4190.0	4190.8	4192.2	4193.3	4194.8	4197.0	4199.2	4201.4
G3.0	4176.9	4176.9	4177.6	4178.7	4180.5	4182.0	4183.8	4186.4	4188.9	4190.8
G3.5	4164.5	4164.5	4165.2	4166.7	4168.8	4170.7	4172.9	4175.8	4178.0	4180.2
G4.0	4151.7	4152.0	4152.8	4154.6	4157.2	4159.3	4162.3	4165.2	4167.4	4169.9
G4.5	4139.3	4139.6	4140.7	4142.5	4145.1	4148.0	4151.3	4154.6	4157.2	4160.1
G5.0	4126.5	4126.8	4128.3	4130.5	4133.4	4136.7	4140.7	4143.6	4146.9	4149.8
G5.5	4114.4	4115.5	4117.0	4119.5	4122.8	4126.1	4130.1	4133.0	4136.3	4139.3
G6.0	4103.4	4104.5	4106.4	4108.9	4112.2	4115.5	4119.5	4122.1	4125.4	4127.6
G6.5	4091.7	4093.6	4095.4	4098.3	4102.0	4104.9	4108.2	4110.8	4113.3	4115.9
G7.0	4080.4	4082.6	4084.8	4087.7	4091.4	4094.3	4097.2	4099.4	4101.6	4104.2
G7.5	4069.1	4071.7	4073.8	4077.1	4080.8	4083.3	4085.9	4088.1	4089.9	4092.5
G8.0	4057.8	4060.7	4063.2	4066.5	4070.2	4072.7	4074.6	4076.4	4077.9	4080.4
G8.5	4046.8	4049.4	4052.3	4055.9	4059.6	4061.8	4063.2	4064.7	4066.2	4068.7
G9.0	4035.5	4038.4	4041.7	4045.3	4049.0	4050.8	4051.9	4052.7	4054.5	4057.0
G9.5	4024.1	4027.4	4030.7	4034.7	4038.4	4039.9	4040.2	4041.0	4042.4	4045.3
G10.0	4012.8	4016.5	4020.1	4024.1	4028.2	4028.9	4028.5	4028.9	4030.7	4033.7
G10.5	4001.5	4004.8	4008.1	4012.5	4016.5	4017.9	4017.2	4017.2	4019.0	4021.6
G11.0	3988.7	3991.6	3995.6	4000.4	4004.8	4006.6	4006.2	4006.2	4008.1	4009.5
G11.5	3975.2	3978.8	3982.9	3988.3	3993.5	3995.6	3995.3	3995.3	3997.1	3998.9
G12.0	3961.3	3965.7	3970.1	3976.3	3981.8	3984.3	3984.3	3984.7	3986.5	3988.0
G12.5	3947.4	3952.2	3957.6	3963.9	3970.1	3973.0	3973.4	3973.7	3975.6	3976.6
G13.0	3933.2	3939.0	3944.9	3951.8	3958.4	3962.0	3962.4	3963.1	3964.6	3965.3
G13.5	3918.5	3925.5	3932.1	3939.4	3947.1	3950.7	3951.4	3952.2	3954.0	3954.4
G14.0	3904.3	3912.0	3919.3	3927.3	3935.4	3939.7	3940.5	3941.6	3943.4	3943.0
G14.5	3889.7	3898.5	3906.5	3914.9	3923.7	3928.4	3929.5	3931.0	3932.8	3931.7
G15.0	3874.7	3884.9	3893.3	3902.8	3912.3	3917.5	3918.5	3920.4	3921.8	3920.4
G15.5	3859.4	3871.4	3881.6	3891.9	3901.4	3906.1	3907.6	3909.8	3910.9	3909.0
G16.0	3844.4	3860.1	3871.0	3881.3	3890.8	3894.8	3895.9	3898.1	3899.5	3897.7
G16.5	3832.3	3848.8	3860.1	3870.7	3879.8	3883.5	3884.6	3886.4	3886.8	3886.4
G17.0	3820.6	3837.4	3849.1	3860.5	3869.2	3872.1	3873.2	3874.3	3873.6	3872.9
G17.5	3808.9	3826.1	3838.5	3849.9	3858.6	3860.8	3861.9	3862.3	3860.8	3859.0
G18.0	3797.2	3815.1	3827.6	3839.3	3847.7	3849.1	3850.6	3850.2	3847.7	3845.1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 51)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G18.5	3785.5	3804.2	3816.6	3828.7	3837.1	3837.8	3839.3	3837.8	3834.5	3831.2
G19.0	3773.9	3793.2	3806.0	3818.4	3826.1	3826.5	3827.9	3825.4	3821.0	3817.3
G19.5	3762.2	3782.6	3795.0	3807.8	3815.5	3815.1	3816.2	3812.9	3807.8	3803.1
G20.0	3750.8	3771.7	3784.4	3797.6	3804.5	3803.4	3804.9	3800.2	3794.3	3788.5
G20.5	3739.1	3760.7	3769.1	3777.9	3784.4	3784.8	3789.6	3787.4	3780.8	3773.9
G21.0	3727.4	3741.7	3747.5	3757.0	3764.4	3765.1	3770.2	3769.5	3767.3	3758.9
G21.5	3708.1	3719.0	3726.3	3735.8	3744.3	3745.4	3750.5	3750.1	3749.4	3743.9
G22.0	3684.7	3696.4	3704.8	3714.7	3723.8	3725.6	3731.1	3730.4	3729.6	3727.4
G22.5	3661.3	3673.4	3683.6	3693.8	3703.7	3706.3	3711.7	3711.0	3710.3	3706.6
G23.0	3637.7	3650.6	3662.0	3672.6	3683.6	3686.5	3692.4	3691.6	3690.5	3686.2
G23.5	3614.2	3627.8	3640.6	3651.4	3663.5	3666.8	3673.0	3672.3	3670.8	3666.1
G24.0	3590.7	3604.7	3619.1	3630.3	3643.2	3647.1	3653.5	3652.6	3651.5	3646.0
G24.5	3566.9	3581.5	3597.4	3609.1	3623.0	3627.4	3634.0	3633.1	3631.7	3625.9
G25.0	3543.0	3558.3	3575.6	3587.9	3602.8	3607.7	3614.6	3613.7	3612.1	3605.5
G25.5	3519.1	3535.2	3551.8	3561.2	3574.4	3580.5	3592.0	3594.2	3592.6	3585.3
G26.0	3495.0	3509.8	3523.8	3533.4	3546.0	3551.9	3562.7	3569.9	3573.3	3565.1
G26.5	3469.9	3482.0	3495.9	3505.6	3517.6	3523.2	3533.4	3539.9	3551.7	3545.1
G27.0	3441.8	3454.3	3468.1	3477.8	3489.2	3494.6	3504.0	3509.9	3521.4	3525.0
G27.5	3413.6	3426.5	3440.3	3450.0	3460.8	3465.9	3474.6	3479.9	3490.6	3498.1
G28.0	3385.2	3398.9	3412.5	3422.2	3432.4	3437.3	3445.0	3449.9	3459.5	3465.8
G28.5	3357.1	3371.1	3384.9	3394.4	3404.0	3408.6	3415.5	3419.8	3428.3	3433.6
G29.0	3329.1	3343.4	3357.3	3366.6	3375.6	3380.0	3385.8	3389.7	3397.0	3401.5
G29.5	3301.2	3315.8	3329.7	3338.9	3347.2	3351.4	3356.1	3359.5	3365.7	3369.4
G30.0	3273.6	3288.1	3302.3	3311.2	3318.8	3322.7	3326.3	3329.4	3334.2	3337.4
G30.5	3246.1	3260.5	3274.0	3282.0	3289.8	3294.3	3296.9	3299.2	3302.7	3305.4
G31.0	3218.3	3231.9	3243.8	3252.5	3260.8	3265.9	3268.6	3269.5	3270.7	3273.3
G31.5	3190.6	3200.7	3213.4	3222.9	3231.8	3237.5	3240.5	3241.5	3238.7	3241.2
G32.0	3158.8	3169.6	3183.1	3193.4	3202.8	3209.1	3212.3	3213.5	3209.9	3209.2
G32.5	3126.4	3138.4	3152.7	3163.8	3173.8	3180.7	3184.2	3185.6	3181.7	3176.5
G33.0	3093.9	3107.2	3122.3	3134.3	3144.8	3152.3	3156.1	3157.4	3153.6	3147.8
G33.5	3061.4	3075.9	3091.9	3104.7	3115.8	3123.9	3128.1	3129.3	3125.6	3119.3
G34.0	3028.7	3044.7	3061.4	3075.2	3086.8	3095.4	3100.0	3101.3	3097.8	3091.1
G34.5	2995.8	3013.5	3031.0	3045.6	3057.8	3067.1	3072.0	3073.3	3069.9	3063.0
G35.0	2963.0	2982.3	3000.4	3016.0	3028.8	3038.6	3044.0	3045.4	3042.0	3035.1
G35.5	2930.1	2951.0	2970.4	2987.8	3000.4	3010.0	3015.8	3017.5	3014.2	3007.0
G36.0	2897.4	2920.2	2942.7	2960.1	2972.1	2981.2	2986.3	2989.4	2986.4	2979.1
G36.5	2864.7	2892.6	2915.2	2932.3	2943.7	2952.4	2956.8	2959.3	2958.6	2951.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 52)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	2835.1	2865.0	2887.6	2904.6	2915.4	2923.6	2927.3	2929.2	2928.8	2923.7
G37.5	2807.6	2837.3	2860.0	2876.8	2887.0	2894.8	2897.7	2899.0	2897.6	2896.3
G38.0	2780.3	2809.6	2832.4	2849.1	2858.7	2865.9	2868.1	2868.6	2866.5	2865.7
G38.5	2753.0	2782.0	2804.9	2821.3	2830.4	2837.0	2838.4	2838.2	2835.4	2833.1
G39.0	2725.7	2754.6	2777.4	2793.6	2802.0	2808.1	2808.7	2807.8	2804.3	2800.6
G39.5	2698.6	2727.2	2750.0	2765.8	2773.6	2779.2	2778.9	2777.4	2773.3	2768.1
G40.0	2671.4	2699.9	2722.7	2738.1	2745.3	2750.2	2749.2	2747.0	2742.3	2735.6
G40.5	2644.4	2672.8	2695.0	2709.0	2716.2	2721.8	2719.6	2716.5	2711.2	2703.2
G41.0	2617.4	2645.6	2664.7	2679.6	2687.2	2693.4	2691.5	2686.0	2680.2	2671.0
G41.5	2590.4	2615.0	2634.5	2650.1	2658.1	2665.0	2663.4	2658.1	2649.0	2639.0
G42.0	2561.5	2584.4	2604.1	2620.6	2629.1	2636.7	2635.4	2630.1	2619.3	2607.0
G42.5	2530.1	2553.6	2573.8	2591.1	2600.0	2608.4	2607.4	2602.2	2591.4	2575.3
G43.0	2498.6	2522.7	2543.4	2561.6	2571.0	2580.0	2579.5	2574.2	2563.7	2545.3
G43.5	2467.2	2491.8	2513.0	2532.1	2541.9	2551.7	2551.6	2546.3	2536.1	2517.9
G44.0	2435.7	2461.0	2482.6	2502.6	2512.9	2523.4	2523.8	2518.6	2508.5	2490.4
G44.5	2404.2	2430.1	2452.2	2473.1	2483.8	2495.1	2496.0	2490.9	2481.1	2462.9
G45.0	2372.6	2399.2	2421.7	2443.6	2454.8	2466.8	2468.1	2463.3	2453.8	2435.5
G45.5	2340.7	2368.3	2391.2	2412.9	2423.5	2435.5	2439.6	2435.7	2426.4	2408.2
G46.0	2308.7	2337.4	2360.7	2381.9	2392.2	2403.4	2406.9	2408.2	2399.1	2381.2
G46.5	2276.8	2307.1	2330.2	2350.9	2361.0	2371.3	2374.2	2375.2	2372.0	2354.2
G47.0	2245.6	2276.8	2299.7	2320.0	2329.7	2339.3	2341.5	2342.3	2342.1	2327.5
G47.5	2215.5	2246.7	2269.2	2289.0	2298.4	2307.2	2308.9	2309.2	2308.6	2300.4
G48.0	2185.5	2216.5	2238.8	2258.1	2267.1	2275.1	2276.2	2276.0	2275.0	2270.9
G48.5	2155.6	2186.3	2208.4	2227.2	2235.8	2243.0	2243.5	2242.8	2241.3	2236.7
G49.0	2126.0	2156.2	2178.0	2196.3	2204.6	2210.9	2210.9	2209.7	2207.6	2202.4
G49.5	2096.4	2126.2	2147.7	2165.4	2173.3	2178.8	2178.3	2176.5	2173.7	2168.2
G50.0	2066.9	2096.2	2117.4	2134.6	2142.0	2146.7	2145.6	2143.4	2139.7	2133.9
G50.5	2037.4	2066.3	2086.7	2102.5	2110.1	2115.1	2113.2	2110.3	2105.7	2099.5
G51.0	2008.0	2036.2	2053.8	2070.1	2078.2	2083.7	2082.3	2077.4	2071.8	2065.1
G51.5	1978.5	2003.1	2020.9	2037.6	2046.2	2052.3	2051.3	2046.8	2037.9	2030.7
G52.0	1946.9	1969.9	1988.1	2005.2	2014.3	2021.0	2020.4	2016.2	2005.8	1996.4
G52.5	1913.3	1936.8	1955.3	1972.8	1982.3	1989.6	1989.5	1985.6	1975.6	1962.2
G53.0	1879.8	1903.8	1922.4	1940.3	1950.4	1958.2	1958.6	1955.0	1945.4	1930.3
G53.5	1846.4	1870.7	1889.7	1907.9	1918.5	1926.9	1927.7	1924.5	1915.2	1900.4
G54.0	1813.2	1837.7	1856.9	1875.5	1886.5	1895.5	1896.9	1894.0	1885.2	1870.7
G54.5	1780.0	1804.6	1824.2	1843.0	1854.6	1864.1	1866.0	1863.5	1855.3	1841.0
G55.0	1746.9	1771.6	1791.5	1810.6	1822.7	1832.8	1835.1	1833.1	1825.4	1811.4

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 53)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G55.5	1713.8	1738.6	1759.2	1779.3	1791.3	1800.9	1804.1	1802.6	1795.4	1782.0
G56.0	1680.8	1706.1	1728.7	1748.2	1759.9	1769.0	1771.9	1771.9	1765.5	1752.6
G56.5	1647.8	1676.1	1698.2	1717.1	1728.6	1737.0	1739.7	1739.5	1735.7	1723.3
G57.0	1617.3	1646.1	1667.8	1686.1	1697.2	1705.1	1707.6	1707.1	1703.9	1694.1
G57.5	1588.0	1616.2	1637.4	1655.0	1665.9	1673.2	1675.5	1674.8	1671.2	1665.0
G58.0	1558.7	1586.3	1606.9	1624.0	1634.5	1641.2	1643.3	1642.5	1638.7	1633.0
G58.5	1529.5	1556.5	1576.6	1593.0	1603.1	1609.3	1611.3	1610.2	1606.2	1600.2
G59.0	1500.4	1526.7	1546.2	1562.0	1571.8	1577.4	1579.2	1578.0	1573.7	1567.5
G59.5	1471.2	1497.0	1515.8	1531.0	1540.4	1545.5	1547.1	1545.8	1541.2	1534.8
G60.0	1442.1	1467.3	1485.5	1500.0	1509.0	1513.6	1515.1	1513.6	1508.7	1502.2
G60.5	1413.1	1437.6	1454.7	1468.1	1477.2	1482.1	1483.3	1481.4	1476.3	1469.5
G61.0	1384.1	1407.2	1422.6	1436.0	1445.3	1450.6	1452.2	1449.7	1443.8	1436.9
G61.5	1355.2	1375.0	1390.5	1403.9	1413.5	1419.1	1421.2	1419.0	1411.2	1404.4
G62.0	1323.2	1342.8	1358.4	1371.8	1381.6	1387.6	1390.1	1388.3	1381.1	1371.9
G62.5	1291.2	1310.7	1326.3	1339.7	1349.8	1356.1	1359.1	1357.7	1351.2	1340.1
G63.0	1259.2	1278.6	1294.2	1307.5	1317.9	1324.6	1328.1	1327.1	1321.3	1310.9
G63.5	1227.3	1246.5	1262.1	1275.4	1286.1	1293.1	1297.1	1296.5	1291.5	1281.8
G64.0	1195.4	1214.3	1230.0	1243.3	1254.2	1261.6	1266.1	1266.1	1261.8	1252.7
G64.5	1163.5	1182.2	1197.9	1211.2	1222.4	1230.1	1235.1	1235.6	1232.1	1223.6
G65.0	1131.7	1150.1	1165.8	1179.1	1190.5	1198.6	1204.1	1205.2	1202.4	1194.6
G65.5	1099.9	1118.0	1135.6	1151.5	1163.5	1170.6	1174.2	1174.9	1172.7	1165.7
G66.0	1068.2	1089.1	1109.5	1124.9	1136.6	1143.4	1146.9	1146.0	1143.0	1136.8
G66.5	1038.6	1063.6	1083.4	1098.2	1109.6	1116.1	1119.5	1118.6	1114.0	1107.9
G67.0	1013.7	1038.1	1057.3	1071.6	1082.7	1088.9	1092.1	1091.2	1086.3	1079.1
G67.5	988.9	1012.6	1031.2	1045.0	1055.7	1061.7	1064.8	1063.7	1058.6	1051.5
G68.0	964.0	987.1	1005.2	1018.4	1028.8	1034.4	1037.4	1036.3	1031.0	1024.2
G68.5	939.3	961.7	979.1	991.8	1001.8	1007.2	1010.0	1008.8	1003.4	997.0
G69.0	914.6	936.3	953.1	965.3	974.9	980.0	982.7	981.4	975.8	969.8
G69.5	889.9	911.0	927.1	938.7	947.9	952.8	955.3	953.9	948.3	942.6
G70.0	865.2	885.6	901.1	912.1	921.0	925.6	927.9	926.3	920.8	915.5
G70.5	840.6	860.3	876.5	888.8	898.1	902.3	902.7	898.8	893.3	888.4
G71.0	816.1	836.8	853.5	865.9	875.3	879.6	880.2	875.1	865.8	861.3
G71.5	793.2	814.0	830.6	843.1	852.5	856.9	857.7	852.9	842.7	834.3
G72.0	770.8	791.3	807.7	820.2	829.7	834.2	835.3	830.7	820.9	810.1
G72.5	748.4	768.5	784.8	797.3	806.8	811.6	812.8	808.6	799.2	788.6
G73.0	726.0	745.8	761.9	774.5	784.0	788.9	790.4	786.4	777.4	767.2
G73.5	703.6	723.1	739.0	751.6	761.2	766.2	767.9	764.3	755.7	745.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 54)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	681.3	700.4	716.1	728.8	738.4	743.5	745.5	742.2	734.0	724.5
G74.5	659.0	677.7	693.2	705.9	715.6	720.8	723.0	720.1	712.3	703.1
G75.0	636.6	655.1	670.3	683.0	692.8	698.1	700.5	698.0	690.6	681.8
G75.5	614.3	632.5	648.0	660.8	670.3	675.4	677.9	676.0	668.9	660.5
G76.0	592.5	611.2	626.3	638.6	647.7	652.8	655.1	653.0	646.9	639.3
G76.5	571.8	589.9	604.5	616.4	625.2	630.1	632.2	630.1	624.1	617.6
G77.0	551.2	568.6	582.7	594.2	602.7	607.4	609.3	607.2	601.4	595.0
G77.5	530.6	547.3	561.0	572.0	580.1	584.7	586.5	584.2	578.6	572.4
G78.0	510.0	526.0	539.2	549.8	557.6	562.1	563.7	561.3	556.0	549.8
G78.5	489.4	504.7	517.5	527.7	535.1	539.4	540.8	538.4	533.2	527.2
G79.0	468.9	483.5	495.7	505.5	512.6	516.7	518.0	515.5	510.5	504.6
G79.5	448.4	462.2	474.0	483.3	490.1	494.0	495.2	492.5	487.9	482.0
G80.0	427.9	441.0	452.3	461.1	467.5	471.4	472.3	469.6	465.2	459.4
G80.5	407.4	419.5	430.0	438.5	444.8	448.6	449.7	446.9	442.6	436.9
G81.0	386.1	397.4	407.5	415.9	422.0	425.9	427.1	424.6	420.5	414.5
G81.5	364.5	375.3	385.1	393.2	399.2	403.2	404.5	402.3	398.5	393.0
G82.0	343.0	353.3	362.6	370.6	376.4	380.5	381.9	380.1	376.5	371.4
G82.5	321.5	331.2	340.1	347.9	353.7	357.7	359.3	357.8	354.6	350.0
G83.0	300.0	309.2	317.6	325.3	330.9	335.0	336.7	335.5	332.7	328.5
G83.5	278.5	287.1	295.1	302.6	308.1	312.2	314.2	313.3	310.7	307.0
G84.0	257.0	265.1	272.6	279.9	285.4	289.5	291.6	291.0	288.8	285.6
G84.5	235.5	243.1	250.1	257.3	262.6	266.8	269.0	268.8	266.9	264.2
G85.0	214.1	221.1	227.7	234.6	239.8	244.0	246.4	246.6	244.9	242.8
G85.5	192.8	199.4	205.6	212.3	217.2	221.4	223.8	224.1	222.9	221.3
G86.0	172.0	177.8	183.6	189.9	194.7	198.8	201.1	201.6	200.7	199.4
G86.5	151.1	156.2	161.6	167.6	172.1	176.1	178.5	179.1	178.5	177.5
G87.0	130.2	134.7	139.7	145.3	149.5	153.5	155.8	156.6	156.3	155.6
G87.5	109.3	113.1	117.7	122.9	127.0	130.8	133.1	134.0	134.1	133.7
G88.0	88.5	91.6	95.7	100.6	104.4	108.2	110.5	111.5	111.8	111.9
G88.5	67.6	70.0	73.7	78.2	81.8	85.5	87.8	89.0	89.6	90.0
G89.0	46.8	48.5	51.8	55.9	59.3	62.9	65.2	66.5	67.4	68.1
G89.5	25.9	26.9	29.8	33.5	36.7	40.2	42.5	44.0	45.2	46.2
G90.0	5.6	6.0	8.7	12.4	15.7	19.5	22.0	23.8	25.6	27.0
G90.5	14.4	15.1	19.8	26.6	32.3	39.1	43.5	46.6	49.6	51.9
G91.0	18.6	19.3	23.9	30.5	36.0	42.7	46.9	49.8	52.6	54.7
G91.5	22.8	23.5	27.9	34.4	39.7	46.2	50.2	53.0	55.6	57.5
G92.0	27.0	27.7	31.9	38.3	43.5	49.8	53.6	56.2	58.6	60.2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 55)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G92.5	31.1	31.9	35.9	42.2	47.2	53.3	57.0	59.4	61.5	63.0
G93.0	35.3	36.1	39.9	46.1	50.9	56.8	60.3	62.6	64.5	65.7
G93.5	39.5	40.3	44.0	50.0	54.6	60.4	63.7	65.8	67.5	68.5
G94.0	43.7	44.5	48.0	54.0	58.3	63.9	67.1	69.0	70.5	71.2
G94.5	47.9	48.7	52.0	57.9	62.0	67.5	70.5	72.2	73.5	74.0
G95.0	52.1	53.0	56.1	61.8	65.8	71.0	73.8	75.4	76.5	76.7
G95.5	56.4	57.3	60.4	65.9	69.7	74.7	77.3	78.7	79.5	79.4
G96.0	60.6	61.6	64.7	70.0	73.7	78.4	80.7	81.9	82.5	82.1
G96.5	64.9	65.9	69.0	74.1	77.6	82.1	84.2	85.1	85.5	84.8
G97.0	69.2	70.2	73.3	78.2	81.6	85.7	87.6	88.3	88.5	87.6
G97.5	73.5	74.5	77.6	82.3	85.5	89.4	91.1	91.6	91.5	90.3
G98.0	77.7	78.8	81.9	86.3	89.5	93.1	94.5	94.8	94.5	93.0
G98.5	82.0	83.1	86.2	90.4	93.4	96.8	98.0	98.0	97.5	95.8
G99.0	86.3	87.4	90.5	94.5	97.4	100.4	101.4	101.3	100.5	98.5
G99.5	90.5	91.7	94.8	98.6	101.3	104.1	104.9	104.5	103.5	101.4
G100.0	94.7	96.0	99.0	102.7	105.3	107.8	108.4	107.8	106.7	104.4
G100.5	98.8	100.1	103.1	106.7	109.1	111.5	111.8	111.2	109.8	107.3
G101.0	102.9	104.3	107.2	110.6	112.9	115.1	115.3	114.5	113.0	110.3
G101.5	107.0	108.5	111.2	114.6	116.7	118.7	118.8	117.8	116.2	113.3
G102.0	111.2	112.7	115.3	118.5	120.5	122.4	122.3	121.2	119.4	116.2
G102.5	115.3	116.8	119.4	122.5	124.3	126.0	125.8	124.5	122.5	119.2
G103.0	119.4	121.0	123.4	126.5	128.1	129.7	129.3	127.9	125.7	122.2
G103.5	123.6	125.2	127.5	130.4	131.9	133.3	132.8	131.2	128.9	125.2
G104.0	127.7	129.4	131.6	134.4	135.7	137.0	136.3	134.6	132.1	127.9
G104.5	132.0	133.5	135.6	138.3	139.5	140.6	139.8	138.0	135.1	130.6
G105.0	136.4	137.9	139.8	142.3	143.3	144.3	143.2	141.1	138.1	133.3
G105.5	140.8	142.3	144.0	146.3	147.2	147.9	146.6	144.3	141.0	136.0
G106.0	145.2	146.6	148.3	150.4	151.1	151.5	150.0	147.5	144.0	138.7
G106.5	149.6	151.0	152.6	154.4	154.9	155.1	153.3	150.6	146.9	141.4
G107.0	153.9	155.3	156.8	158.5	158.8	158.7	156.7	153.8	149.9	144.2
G107.5	158.3	159.7	161.1	162.5	162.6	162.3	160.1	157.0	152.9	146.9
G108.0	162.7	164.1	165.3	166.6	166.5	165.9	163.5	160.2	155.9	149.7
G108.5	167.1	168.4	169.6	170.6	170.4	169.4	166.9	163.4	158.9	153.9
G109.0	171.9	172.8	173.8	174.6	174.2	173.1	170.3	166.6	162.6	159.6
G109.5	178.1	177.7	178.1	178.7	178.1	176.7	173.7	170.6	168.5	165.4
G110.0	184.3	184.0	183.5	183.1	181.9	180.7	178.7	176.6	174.4	171.1
G110.5	190.6	190.4	189.9	189.5	188.3	187.0	184.9	182.7	180.4	176.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 56)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	196.8	196.8	196.3	195.9	194.7	193.3	191.1	188.8	186.3	182.7
G111.5	203.0	203.1	202.8	202.3	201.1	199.6	197.3	194.9	192.3	188.5
G112.0	209.3	209.5	209.2	208.7	207.5	206.0	203.6	201.0	198.2	194.4
G112.5	215.5	215.9	215.6	215.2	213.9	212.3	209.8	207.1	204.2	200.2
G113.0	221.8	222.2	222.0	221.6	220.3	218.6	216.0	213.2	210.2	206.4
G113.5	228.1	228.6	228.4	228.0	226.7	224.9	222.3	219.3	216.2	214.0
G114.0	236.1	235.0	234.8	234.4	233.1	231.3	228.5	225.4	223.5	221.7
G114.5	244.9	242.7	241.2	240.8	239.5	237.6	234.7	232.6	231.5	229.4
G115.0	253.7	251.6	249.3	247.7	245.8	244.3	242.5	240.9	239.5	237.1
G115.5	262.6	260.5	258.2	256.6	254.7	253.0	251.0	249.1	247.5	244.8
G116.0	271.4	269.4	267.2	265.5	263.5	261.6	259.5	257.4	255.5	252.5
G116.5	280.3	278.3	276.1	274.4	272.3	270.3	268.0	265.7	263.6	260.3
G117.0	289.2	287.2	285.0	283.4	281.1	279.0	276.5	274.0	271.6	268.1
G117.5	298.0	296.1	294.0	292.3	289.9	287.7	285.1	282.3	279.7	276.0
G118.0	306.9	305.0	302.9	301.2	298.7	296.3	293.6	290.7	287.8	284.5
G118.5	315.8	314.0	311.9	310.1	307.6	305.0	302.1	299.0	296.0	293.2
G119.0	324.1	322.9	320.8	319.0	316.4	313.7	310.7	307.4	304.8	301.9
G119.5	332.5	331.6	329.8	327.9	325.2	322.4	319.2	316.1	313.7	310.7
G120.0	340.8	340.1	338.5	336.9	334.0	331.1	328.1	325.0	322.6	319.5
G120.5	349.2	348.6	347.2	345.7	342.9	340.1	337.1	333.9	331.5	328.3
G121.0	357.6	357.2	355.9	354.5	351.8	349.1	346.1	342.8	340.5	337.1
G121.5	366.0	365.8	364.6	363.4	360.8	358.1	355.1	351.8	349.4	346.0
G122.0	374.4	374.4	373.3	372.2	369.7	367.1	364.0	360.7	358.3	354.9
G122.5	382.8	382.9	382.1	381.1	378.6	376.1	373.0	369.6	367.2	363.5
G123.0	391.3	391.5	390.8	389.9	387.5	385.1	382.0	378.6	376.1	371.3
G123.5	400.0	400.1	399.5	398.7	396.4	394.1	391.0	387.5	384.8	379.2
G124.0	409.2	408.8	408.2	407.6	405.3	403.0	400.0	396.5	392.9	387.0
G124.5	418.4	417.8	417.0	416.4	414.2	412.0	409.0	404.9	400.9	395.0
G125.0	427.6	426.9	426.0	425.3	423.1	420.9	417.5	413.2	409.1	402.9
G125.5	436.9	436.1	435.0	434.3	431.9	429.6	426.1	421.5	417.2	410.9
G126.0	446.1	445.2	444.0	443.2	440.8	438.2	434.6	429.8	425.4	418.9
G126.5	455.3	454.3	453.1	452.2	449.6	446.9	443.1	438.1	433.6	426.9
G127.0	464.5	463.4	462.1	461.2	458.4	455.5	451.6	446.5	441.8	434.9
G127.5	473.7	472.5	471.2	470.1	467.2	464.2	460.1	454.8	450.0	443.6
G128.0	482.8	481.6	480.2	479.1	476.0	472.8	468.7	463.2	458.3	452.9
G128.5	491.6	490.7	489.2	488.0	484.8	481.5	477.2	471.6	467.0	462.3
G129.0	500.0	499.8	498.3	497.0	493.6	490.2	485.8	480.0	476.2	471.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 57)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G129.5	508.5	508.4	507.3	505.9	502.4	498.8	494.3	489.1	485.5	481.0
G130.0	516.9	517.0	516.0	514.8	511.2	507.6	503.3	498.4	494.7	490.4
G130.5	525.4	525.6	524.7	523.6	520.1	516.6	512.4	507.7	504.0	499.7
G131.0	533.9	534.2	533.4	532.5	529.1	525.7	521.4	516.9	513.2	509.2
G131.5	542.4	542.8	542.1	541.3	538.0	534.7	530.5	526.2	522.5	518.6
G132.0	550.9	551.4	550.8	550.1	546.9	543.7	539.6	535.5	531.7	528.1
G132.5	559.5	560.0	559.5	558.9	555.8	552.7	548.6	544.8	541.0	536.3
G133.0	568.0	568.7	568.2	567.7	564.7	561.8	557.6	554.1	550.3	543.9
G133.5	576.3	577.3	577.0	576.6	573.7	570.8	566.7	563.5	558.5	551.4
G134.0	584.5	585.9	585.7	585.4	582.6	579.8	575.7	572.8	565.9	558.9
G134.5	592.7	593.8	594.4	594.3	591.5	588.8	584.8	580.1	573.3	566.5
G135.0	600.9	601.7	602.2	602.8	600.4	597.4	592.3	587.4	580.7	574.0
G135.5	609.0	609.6	609.9	610.3	607.8	604.7	599.6	594.7	588.1	581.6
G136.0	617.2	617.4	617.6	617.8	615.2	612.0	607.0	602.0	595.5	589.2
G136.5	625.3	625.3	625.3	625.3	622.5	619.4	614.3	609.3	602.9	596.7
G137.0	633.5	633.1	632.9	632.8	629.9	626.7	621.7	616.6	610.3	604.3
G137.5	641.6	641.0	640.6	640.2	637.3	634.0	629.0	624.0	617.7	612.6
G138.0	649.7	648.8	648.3	647.7	644.6	641.3	636.3	631.3	625.2	621.5
G138.5	657.4	656.6	655.9	655.2	652.0	648.7	643.6	638.6	633.2	630.3
G139.0	664.7	664.4	663.6	662.7	659.4	656.0	650.9	645.9	641.8	639.1
G139.5	672.0	671.7	671.3	670.1	666.8	663.4	658.2	654.2	650.2	647.9
G140.0	679.3	678.9	678.6	677.6	674.1	670.8	666.1	662.5	658.7	656.6
G140.5	686.6	686.2	685.9	684.9	681.6	678.5	674.0	670.7	667.2	665.3
G141.0	693.9	693.4	693.1	692.3	689.1	686.1	681.9	679.0	675.6	674.0
G141.5	701.2	700.7	700.4	699.6	696.6	693.8	689.9	687.3	684.1	682.7
G142.0	708.4	707.9	707.7	707.0	704.2	701.5	697.8	695.5	692.5	691.3
G142.5	715.7	715.2	714.9	714.4	711.7	709.1	705.8	703.7	700.9	699.6
G143.0	723.0	722.5	722.2	721.7	719.2	716.8	713.7	711.9	709.4	707.1
G143.5	730.6	729.7	729.5	729.1	726.7	724.4	721.7	720.1	717.4	714.6
G144.0	738.6	737.0	736.7	736.4	734.2	732.0	729.7	728.2	724.8	722.1
G144.5	746.6	744.8	744.0	743.8	741.7	739.7	737.7	735.5	732.2	729.6
G145.0	754.7	752.6	751.6	751.2	749.2	747.2	745.1	742.8	739.6	737.1
G145.5	762.6	760.5	759.2	758.6	756.5	754.6	752.4	750.1	747.0	744.6
G146.0	770.6	768.3	766.9	766.1	763.9	761.9	759.7	757.4	754.4	752.1
G146.5	778.6	776.1	774.5	773.5	771.2	769.2	767.0	764.8	761.8	759.7
G147.0	786.5	783.9	782.1	781.0	778.6	776.6	774.3	772.1	769.2	767.3
G147.5	794.4	791.8	789.7	788.4	786.0	783.9	781.6	779.5	776.6	774.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 58)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	802.3	799.5	797.3	795.8	793.3	791.3	788.9	786.8	784.0	783.6
G148.5	810.1	807.3	804.9	803.2	800.7	798.6	796.2	794.2	791.5	792.3
G149.0	817.3	815.0	812.5	810.7	808.0	805.9	803.5	801.5	800.0	800.8
G149.5	824.6	822.3	820.1	818.1	815.4	813.3	810.8	809.4	808.3	809.4
G150.0	831.8	829.5	827.4	825.4	822.7	820.7	818.6	817.5	816.7	817.9
G150.5	839.0	836.8	834.7	832.8	830.3	828.3	826.6	825.6	825.2	826.5
G151.0	846.3	844.1	842.0	840.2	837.8	835.9	834.5	833.6	833.5	834.9
G151.5	853.5	851.3	849.2	847.5	845.3	843.6	842.4	841.7	841.9	843.3
G152.0	860.8	858.6	856.5	854.9	852.8	851.2	850.3	849.7	850.3	851.8
G152.5	868.0	865.8	863.8	862.3	860.3	858.8	858.3	857.7	858.7	860.1
G153.0	875.3	873.0	871.0	869.7	867.9	866.4	866.2	865.7	867.0	867.0
G153.5	882.5	880.3	878.4	877.1	875.4	874.0	874.1	873.8	875.2	872.1
G154.0	888.4	887.6	885.6	884.6	882.9	881.6	881.9	881.8	880.7	877.2
G154.5	893.9	893.7	892.9	892.0	890.4	889.2	889.8	888.0	885.6	882.3
G155.0	899.5	899.0	898.7	899.0	897.9	896.3	895.5	892.8	890.5	887.3
G155.5	905.0	904.2	903.9	903.9	902.7	901.1	900.3	897.7	895.4	892.4
G156.0	910.5	909.4	909.0	908.8	907.5	905.9	905.0	902.5	900.3	897.4
G156.5	915.9	914.6	914.2	913.7	912.3	910.8	909.8	907.3	905.2	902.4
G157.0	921.2	919.7	919.3	918.6	917.1	915.6	914.5	912.1	910.1	907.5
G157.5	926.5	924.9	924.4	923.4	921.9	920.4	919.3	917.0	915.0	912.6
G158.0	931.9	930.1	929.5	928.3	926.7	925.2	924.0	921.8	919.9	917.7
G158.5	937.1	935.3	934.5	933.2	931.5	930.0	928.8	926.6	924.8	921.7
G159.0	941.4	940.5	939.6	938.1	936.3	934.8	933.6	931.4	929.1	925.2
G159.5	943.8	944.8	944.6	942.9	941.0	939.6	938.4	935.7	932.3	928.7
G160.0	946.3	947.2	948.1	947.4	945.8	944.0	942.0	938.7	935.5	932.2
G160.5	948.6	949.6	950.4	949.8	948.3	946.6	944.8	941.6	938.6	935.7
G161.0	951.1	952.0	952.8	952.2	950.7	949.1	947.5	944.6	941.7	939.1
G161.5	953.5	954.3	955.1	954.5	953.1	951.5	950.2	947.5	944.8	942.3
G162.0	955.9	956.7	957.4	956.9	955.6	954.0	952.8	950.5	947.9	945.7
G162.5	958.3	959.0	959.8	959.3	958.1	956.5	955.5	953.4	950.9	948.9
G163.0	960.7	961.4	962.1	961.7	960.5	959.0	958.1	956.3	953.9	952.2
G163.5	963.1	963.8	964.4	964.1	963.0	961.5	960.7	959.2	957.0	955.3
G164.0	965.5	966.2	966.8	966.4	965.4	964.0	963.2	962.1	960.0	957.9
G164.5	968.1	968.6	969.2	968.9	967.8	966.5	965.7	965.0	962.5	960.3
G165.0	970.9	971.2	971.6	971.2	970.3	968.9	968.1	967.1	965.0	962.8
G165.5	973.7	973.9	974.0	973.5	972.5	971.2	970.3	969.3	967.3	965.3
G166.0	976.4	976.5	976.5	975.8	974.7	973.5	972.6	971.6	969.7	967.8

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 59)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G166.5	979.1	979.1	978.9	978.1	976.9	975.7	974.9	973.9	972.0	970.3
G167.0	981.8	981.7	981.3	980.3	979.1	978.0	977.2	976.2	974.5	972.7
G167.5	984.5	984.3	983.7	982.6	981.4	980.3	979.5	978.6	976.9	975.2
G168.0	987.2	986.8	986.1	984.8	983.5	982.5	981.8	980.9	979.3	977.7
G168.5	989.9	989.3	988.5	987.0	985.7	984.7	984.2	983.3	981.7	980.2
G169.0	992.4	991.7	990.7	989.3	987.9	987.0	986.5	985.6	984.1	982.6
G169.5	994.9	994.1	993.0	991.5	990.2	989.2	988.7	987.9	986.7	985.7
G170.0	997.2	996.4	995.2	993.7	992.4	991.5	991.0	990.5	989.7	988.8
G170.5	999.5	998.7	997.5	996.1	994.9	994.0	993.6	993.2	992.7	991.9
G171.0	1001.8	1000.9	999.8	998.6	997.3	996.5	996.1	995.8	995.5	995.0
G171.5	1004.0	1003.2	1002.1	1000.9	999.8	999.0	998.6	998.4	998.4	997.9
G172.0	1006.3	1005.6	1004.5	1003.4	1002.3	1001.5	1001.1	1001.0	1001.0	1000.9
G172.5	1008.6	1007.9	1006.9	1005.8	1004.8	1004.0	1003.6	1003.5	1003.6	1003.7
G173.0	1010.9	1010.2	1009.2	1008.2	1007.2	1006.5	1006.1	1006.0	1006.2	1006.6
G173.5	1013.2	1012.5	1011.7	1010.6	1009.7	1009.0	1008.6	1008.6	1008.8	1009.1
G174.0	1015.6	1014.8	1014.0	1013.1	1012.2	1011.6	1011.1	1011.1	1011.3	1011.7
G174.5	1017.9	1017.0	1016.4	1015.4	1014.7	1014.1	1013.7	1013.6	1013.8	1014.2
G175.0	1020.1	1019.3	1018.7	1017.9	1017.1	1016.6	1016.2	1016.0	1016.2	1016.4
G175.5	1022.1	1021.5	1020.7	1019.9	1019.3	1018.8	1018.5	1018.4	1018.5	1018.7
G176.0	1024.2	1023.6	1022.7	1022.1	1021.5	1021.0	1020.7	1020.7	1020.7	1020.9
G176.5	1026.2	1025.5	1024.8	1024.2	1023.7	1023.3	1023.0	1023.0	1023.0	1023.2
G177.0	1028.2	1027.5	1026.8	1026.3	1025.8	1025.5	1025.3	1025.3	1025.3	1025.4
G177.5	1030.0	1029.4	1028.9	1028.4	1028.1	1027.8	1027.6	1027.5	1027.5	1027.7
G178.0	1031.8	1031.3	1030.9	1030.5	1030.2	1030.1	1029.9	1029.8	1029.8	1030.0
G178.5	1033.6	1033.2	1032.9	1032.6	1032.4	1032.3	1032.1	1032.1	1032.1	1032.2
G179.0	1035.4	1035.2	1034.9	1034.7	1034.6	1034.5	1034.4	1034.4	1034.4	1034.5
G179.5	1037.1	1037.0	1036.9	1036.9	1036.8	1036.7	1036.7	1036.6	1036.7	1036.7
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 60)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4	4251.4
G0.5	4241.6	4242.3	4243.0	4243.8	4244.5	4245.2	4246.3	4247.0	4248.1	4249.2
G1.0	4232.1	4233.5	4234.6	4236.1	4237.9	4239.4	4241.2	4243.0	4244.9	4247.0
G1.5	4222.9	4224.8	4226.9	4228.4	4230.2	4232.4	4234.3	4236.4	4239.0	4241.6
G2.0	4213.8	4215.3	4217.1	4219.3	4221.5	4224.0	4226.6	4229.5	4232.8	4236.1
G2.5	4203.2	4205.0	4207.2	4210.1	4212.7	4215.6	4218.9	4222.2	4225.5	4229.5
G3.0	4192.6	4195.2	4198.1	4200.6	4203.6	4206.5	4210.1	4213.8	4218.2	4222.6
G3.5	4182.7	4185.7	4187.8	4190.8	4194.1	4197.7	4201.7	4206.5	4211.6	4217.1
G4.0	4173.2	4175.1	4177.6	4180.9	4184.6	4188.9	4194.1	4199.5	4205.4	4211.6
G4.5	4162.3	4164.8	4167.8	4171.4	4175.4	4180.5	4186.0	4192.2	4199.2	4206.5
G5.0	4151.7	4154.6	4157.9	4161.9	4166.7	4172.1	4178.7	4185.7	4193.3	4201.4
G5.5	4141.4	4144.4	4147.7	4152.0	4157.5	4164.1	4171.4	4179.1	4186.8	4195.2
G6.0	4130.5	4133.8	4137.8	4142.9	4149.1	4156.1	4163.4	4171.0	4179.4	4188.6
G6.5	4118.8	4122.8	4127.6	4133.4	4140.3	4147.3	4155.0	4163.4	4171.8	4180.5
G7.0	4107.1	4111.5	4117.3	4124.3	4131.2	4138.5	4146.6	4154.2	4162.6	4171.8
G7.5	4095.8	4100.2	4106.7	4114.0	4122.1	4129.8	4136.7	4144.7	4153.5	4161.9
G8.0	4084.1	4089.2	4095.8	4103.1	4112.2	4119.5	4127.2	4134.5	4142.2	4150.9
G8.5	4072.7	4077.9	4084.4	4092.5	4100.5	4110.0	4116.2	4123.2	4131.2	4139.6
G9.0	4061.1	4066.2	4072.7	4080.1	4088.8	4098.0	4105.3	4111.8	4119.2	4127.9
G9.5	4049.4	4054.5	4060.7	4067.6	4075.7	4084.8	4093.6	4099.4	4107.1	4116.2
G10.0	4037.7	4042.1	4047.5	4054.5	4061.8	4070.9	4080.8	4087.4	4095.0	4104.5
G10.5	4025.2	4029.6	4034.4	4040.2	4047.9	4055.9	4066.5	4074.6	4083.0	4092.8
G11.0	4012.5	4016.1	4020.9	4026.0	4032.6	4041.0	4051.6	4062.2	4070.6	4080.8
G11.5	3999.7	4002.6	4006.2	4011.0	4017.2	4025.6	4036.6	4049.4	4057.8	4068.0
G12.0	3988.7	3988.7	3991.3	3995.6	4001.5	4009.9	4021.2	4035.5	4044.6	4054.1
G12.5	3976.6	3975.9	3976.3	3979.9	3985.8	3994.2	4005.5	4020.1	4031.1	4039.9
G13.0	3965.0	3963.1	3960.6	3963.9	3969.7	3978.1	3989.4	4004.1	4016.5	4023.4
G13.5	3953.3	3950.7	3947.8	3947.8	3952.9	3961.7	3972.6	3987.2	4000.8	4007.3
G14.0	3941.6	3938.6	3935.0	3931.3	3936.1	3944.1	3955.1	3969.0	3984.7	3989.8
G14.5	3929.5	3926.2	3921.8	3917.5	3918.9	3926.2	3936.1	3949.6	3966.1	3972.3
G15.0	3917.8	3913.4	3908.7	3903.6	3900.6	3907.2	3916.4	3929.1	3946.0	3955.1
G15.5	3906.1	3901.4	3895.5	3889.3	3883.5	3887.1	3895.9	3908.3	3926.2	3937.9
G16.0	3894.4	3889.0	3882.0	3875.1	3867.4	3866.7	3875.1	3888.2	3906.9	3920.4
G16.5	3882.7	3876.2	3868.5	3860.1	3851.0	3845.5	3854.2	3867.8	3886.8	3902.8
G17.0	3870.7	3863.7	3855.0	3845.5	3834.5	3824.6	3833.4	3846.9	3866.7	3884.2
G17.5	3857.2	3851.3	3841.1	3830.1	3818.1	3806.7	3812.2	3826.1	3845.5	3865.9
G18.0	3842.5	3838.5	3827.2	3815.1	3801.6	3789.6	3790.7	3804.9	3824.6	3846.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 61)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G18.5	3827.6	3822.4	3813.3	3800.2	3785.2	3772.0	3769.1	3783.0	3802.4	3827.6
G19.0	3811.9	3805.6	3799.1	3784.4	3768.4	3754.5	3747.2	3760.7	3780.1	3805.3
G19.5	3795.8	3788.5	3783.4	3769.1	3751.6	3736.9	3725.6	3737.3	3755.9	3781.5
G20.0	3779.7	3770.9	3765.1	3753.8	3734.8	3719.0	3706.3	3713.2	3731.1	3756.7
G20.5	3763.3	3753.8	3746.8	3737.3	3717.6	3701.1	3686.2	3687.6	3705.9	3731.8
G21.0	3746.4	3736.2	3727.1	3719.0	3700.4	3683.2	3666.1	3662.0	3680.7	3707.0
G21.5	3729.6	3718.3	3707.3	3698.2	3683.6	3664.6	3644.9	3636.5	3655.5	3682.9
G22.0	3712.5	3700.0	3687.6	3677.0	3666.4	3646.4	3624.0	3611.2	3630.5	3658.0
G22.5	3695.3	3681.8	3666.8	3655.5	3649.6	3627.4	3603.2	3585.9	3605.3	3632.6
G23.0	3676.7	3663.5	3646.1	3634.5	3629.2	3608.1	3582.4	3563.3	3578.5	3606.1
G23.5	3656.2	3644.0	3625.2	3613.3	3607.4	3588.8	3561.6	3541.1	3551.6	3578.1
G24.0	3635.4	3623.9	3604.4	3592.2	3584.8	3568.5	3540.9	3518.0	3522.6	3549.7
G24.5	3614.7	3601.8	3583.6	3571.0	3560.9	3548.2	3520.2	3494.9	3493.6	3520.2
G25.0	3593.9	3580.0	3562.8	3549.1	3536.8	3528.2	3499.0	3470.6	3463.3	3490.6
G25.5	3573.1	3557.9	3541.9	3527.0	3511.9	3503.6	3478.1	3446.6	3432.8	3460.9
G26.0	3552.5	3535.9	3519.8	3504.3	3486.7	3478.7	3456.2	3421.4	3403.1	3431.4
G26.5	3532.1	3514.1	3497.8	3480.0	3461.7	3453.7	3434.1	3396.2	3374.0	3403.4
G27.0	3511.5	3492.4	3475.8	3455.5	3437.3	3428.5	3411.7	3371.6	3345.6	3375.3
G27.5	3490.9	3470.6	3453.2	3430.9	3413.0	3402.1	3388.3	3347.0	3319.5	3346.7
G28.0	3470.6	3448.8	3430.8	3406.8	3388.5	3374.6	3365.2	3322.9	3295.0	3317.9
G28.5	3445.6	3427.1	3408.7	3382.8	3363.1	3347.0	3337.1	3299.4	3269.4	3287.4
G29.0	3412.7	3405.5	3386.2	3358.8	3337.6	3317.6	3306.9	3275.9	3243.8	3256.7
G29.5	3378.8	3384.1	3363.4	3335.3	3311.0	3288.2	3277.8	3252.5	3217.2	3224.7
G30.0	3344.9	3354.1	3341.1	3311.8	3284.2	3259.0	3249.5	3229.3	3190.6	3192.3
G30.5	3311.0	3320.5	3318.9	3288.2	3257.9	3230.2	3221.3	3204.8	3163.0	3160.0
G31.0	3277.2	3287.1	3295.7	3264.6	3231.2	3201.7	3193.2	3180.3	3135.6	3127.8
G31.5	3243.3	3253.5	3268.0	3241.2	3204.4	3174.3	3164.9	3155.3	3108.5	3095.9
G32.0	3209.4	3219.9	3231.7	3218.2	3178.0	3147.1	3135.3	3130.1	3081.3	3064.2
G32.5	3175.7	3186.1	3195.9	3194.3	3152.1	3119.9	3105.3	3103.2	3054.5	3031.9
G33.0	3142.0	3151.3	3160.3	3170.8	3126.1	3092.9	3074.9	3071.0	3027.8	2999.1
G33.5	3108.5	3116.1	3124.9	3145.1	3100.2	3066.3	3043.7	3038.9	3000.9	2965.5
G34.0	3078.5	3080.8	3089.6	3107.0	3075.3	3039.3	3012.5	3007.3	2973.9	2931.0
G34.5	3050.4	3045.2	3054.3	3068.6	3050.5	3012.2	2981.2	2975.7	2946.7	2898.4
G35.0	3022.4	3009.7	3018.9	3030.3	3025.7	2985.4	2950.1	2944.1	2918.9	2867.9
G35.5	2994.5	2978.4	2983.5	2991.9	3001.3	2958.1	2919.0	2912.2	2891.0	2838.0
G36.0	2966.4	2949.6	2947.1	2953.7	2976.3	2931.1	2888.0	2879.8	2862.5	2809.3
G36.5	2938.3	2920.9	2910.1	2915.9	2939.2	2904.3	2859.6	2846.8	2834.2	2780.6

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 62)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	2910.4	2892.4	2873.0	2878.8	2901.1	2877.4	2830.9	2813.5	2805.9	2751.8
G37.5	2882.8	2864.1	2843.0	2842.2	2863.2	2850.8	2802.5	2779.6	2777.4	2723.1
G38.0	2855.4	2835.9	2812.9	2805.8	2825.0	2824.3	2773.8	2745.8	2750.5	2693.4
G38.5	2827.7	2807.7	2783.0	2769.3	2786.5	2798.0	2745.0	2713.1	2719.1	2663.9
G39.0	2799.7	2779.6	2753.5	2732.3	2748.2	2771.9	2716.5	2680.8	2686.4	2634.1
G39.5	2766.7	2751.6	2724.4	2699.2	2709.7	2735.8	2687.9	2648.8	2653.3	2604.2
G40.0	2733.6	2723.9	2695.5	2669.7	2671.3	2697.0	2659.5	2616.8	2619.7	2574.6
G40.5	2700.5	2696.4	2666.7	2640.1	2633.0	2657.9	2631.6	2584.5	2585.3	2545.2
G41.0	2666.8	2663.0	2637.9	2610.7	2594.9	2618.5	2604.1	2553.0	2551.0	2516.2
G41.5	2633.1	2629.0	2609.6	2581.6	2556.9	2579.2	2576.5	2523.5	2517.0	2487.5
G42.0	2599.6	2594.9	2581.6	2552.5	2520.1	2539.7	2550.0	2494.1	2483.1	2458.9
G42.5	2566.2	2560.8	2552.8	2523.6	2490.1	2500.2	2523.8	2464.8	2449.8	2430.5
G43.0	2532.9	2526.4	2518.2	2495.0	2460.2	2460.9	2497.6	2436.0	2416.5	2401.9
G43.5	2499.8	2491.5	2483.7	2466.5	2430.6	2422.2	2459.0	2407.8	2382.7	2373.2
G44.0	2466.9	2456.6	2449.2	2438.2	2401.2	2383.9	2420.3	2379.7	2348.6	2344.5
G44.5	2438.4	2421.8	2414.7	2410.1	2371.8	2346.0	2380.8	2352.0	2314.5	2316.1
G45.0	2411.0	2387.0	2380.1	2377.9	2342.7	2308.1	2341.3	2324.5	2280.5	2287.8
G45.5	2383.8	2352.6	2345.2	2342.2	2313.9	2275.5	2302.1	2296.9	2246.6	2259.6
G46.0	2356.5	2322.8	2310.5	2306.7	2285.3	2246.2	2263.2	2269.3	2213.2	2231.5
G46.5	2329.3	2295.6	2275.9	2271.3	2257.0	2216.7	2224.5	2241.9	2179.8	2197.6
G47.0	2302.2	2268.4	2241.4	2235.9	2228.9	2187.5	2186.2	2214.0	2148.7	2163.7
G47.5	2275.3	2241.3	2206.9	2200.5	2200.2	2158.6	2147.9	2186.3	2120.3	2130.0
G48.0	2248.6	2214.4	2178.0	2165.1	2164.1	2130.0	2109.6	2154.5	2092.1	2096.2
G48.5	2221.9	2187.7	2150.9	2129.8	2128.1	2101.6	2070.9	2115.4	2064.0	2062.1
G49.0	2195.3	2161.2	2124.0	2094.6	2092.5	2073.6	2032.1	2076.8	2035.9	2027.8
G49.5	2162.4	2134.8	2097.1	2059.5	2056.9	2045.8	2000.9	2038.6	2007.6	1994.0
G50.0	2127.8	2108.6	2070.5	2026.5	2021.4	2018.4	1972.1	2000.5	1979.6	1960.6
G50.5	2093.1	2082.3	2044.2	1999.7	1986.2	1991.1	1943.5	1962.7	1951.6	1927.5
G51.0	2058.4	2050.3	2018.1	1973.0	1951.1	1958.3	1915.4	1925.1	1923.8	1894.9
G51.5	2023.7	2015.2	1992.0	1946.6	1916.2	1922.5	1887.6	1887.4	1896.5	1862.1
G52.0	1988.7	1980.2	1966.1	1920.5	1881.5	1886.7	1860.1	1849.4	1869.3	1829.1
G52.5	1953.7	1945.1	1940.4	1894.6	1846.9	1850.9	1832.9	1811.4	1842.7	1796.0
G53.0	1918.8	1910.0	1905.9	1868.8	1820.0	1815.4	1805.9	1773.4	1816.6	1762.6
G53.5	1884.0	1875.1	1870.5	1843.4	1794.1	1780.2	1779.2	1735.6	1790.8	1729.2
G54.0	1849.3	1840.3	1835.2	1818.4	1768.2	1745.4	1752.7	1702.1	1759.5	1696.6
G54.5	1819.9	1805.7	1800.0	1793.2	1742.7	1710.8	1726.0	1674.8	1722.6	1664.1
G55.0	1790.8	1771.2	1764.8	1762.2	1717.6	1676.5	1690.8	1647.7	1685.4	1636.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 63)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G55.5	1761.7	1736.7	1729.8	1726.4	1692.5	1642.3	1655.8	1621.1	1648.1	1610.4
G56.0	1732.8	1708.0	1694.8	1690.8	1667.5	1614.5	1621.0	1594.7	1610.9	1584.2
G56.5	1703.9	1679.5	1660.0	1655.5	1642.7	1589.5	1586.1	1568.6	1573.9	1558.1
G57.0	1675.2	1651.1	1625.4	1620.5	1618.3	1564.6	1551.5	1542.7	1537.2	1532.2
G57.5	1646.5	1622.8	1593.9	1585.8	1588.5	1540.1	1517.1	1517.2	1501.4	1506.3
G58.0	1617.9	1594.6	1566.1	1551.3	1553.1	1515.8	1482.9	1492.0	1465.8	1480.7
G58.5	1589.5	1566.5	1538.3	1517.1	1517.9	1491.7	1449.1	1467.2	1430.4	1455.2
G59.0	1559.1	1538.6	1510.8	1483.2	1483.2	1467.9	1415.5	1440.6	1395.2	1430.0
G59.5	1526.3	1510.9	1483.4	1451.9	1449.1	1444.3	1387.6	1406.5	1362.6	1405.3
G60.0	1493.6	1483.4	1456.2	1425.1	1415.3	1421.0	1363.9	1372.4	1337.1	1380.7
G60.5	1461.0	1452.5	1429.1	1398.4	1381.8	1390.3	1340.5	1338.6	1311.8	1356.6
G61.0	1428.5	1419.9	1402.1	1371.7	1348.4	1356.2	1317.5	1305.1	1287.0	1332.3
G61.5	1395.9	1387.4	1375.4	1345.3	1315.0	1322.3	1294.8	1271.8	1262.5	1297.2
G62.0	1363.3	1354.9	1346.5	1319.2	1286.8	1288.7	1272.2	1238.9	1238.3	1262.2
G62.5	1330.9	1322.6	1314.3	1293.4	1261.1	1255.3	1250.2	1206.3	1214.7	1227.2
G63.0	1298.5	1290.3	1282.3	1267.8	1235.7	1222.1	1228.5	1173.8	1191.4	1192.4
G63.5	1266.7	1258.2	1250.2	1242.2	1210.5	1189.0	1205.8	1146.2	1168.5	1157.8
G64.0	1238.3	1226.1	1218.2	1212.5	1185.5	1156.1	1172.9	1124.0	1145.3	1123.7
G64.5	1210.1	1194.2	1186.3	1180.9	1160.9	1126.7	1139.9	1102.3	1112.6	1090.0
G65.0	1181.9	1165.1	1154.6	1149.4	1136.6	1102.4	1107.1	1081.0	1080.3	1056.6
G65.5	1153.9	1137.8	1123.1	1118.0	1112.4	1078.3	1074.3	1060.0	1048.2	1023.6
G66.0	1125.9	1110.6	1091.6	1086.7	1085.2	1054.6	1041.6	1039.3	1016.3	993.7
G66.5	1098.0	1083.5	1064.0	1055.5	1054.5	1031.1	1009.1	1019.1	984.8	971.3
G67.0	1070.3	1056.6	1037.9	1024.5	1024.0	1007.9	976.8	999.2	953.4	949.2
G67.5	1042.5	1029.7	1012.0	993.7	993.6	985.0	949.6	969.3	922.3	927.5
G68.0	1014.9	1003.0	986.2	965.5	963.3	962.3	927.1	937.3	895.2	906.2
G68.5	987.7	976.4	960.6	940.8	933.3	934.1	904.8	905.5	875.5	885.4
G69.0	960.5	950.0	935.1	916.3	903.4	904.4	882.8	874.0	856.2	865.0
G69.5	933.4	923.3	909.7	891.9	873.7	874.9	861.2	842.8	837.3	845.0
G70.0	906.3	896.5	884.5	867.6	848.5	845.8	839.8	812.0	818.8	818.7
G70.5	879.3	869.8	858.9	843.3	825.2	816.7	818.7	782.0	800.6	787.7
G71.0	852.4	843.1	832.5	819.2	802.1	787.8	793.1	761.3	782.8	757.0
G71.5	825.5	816.5	806.2	795.3	779.2	759.1	764.3	741.0	755.0	726.9
G72.0	798.7	789.8	780.1	770.7	756.5	734.7	735.7	720.9	724.3	697.1
G72.5	771.9	763.2	754.0	745.2	733.9	712.8	707.4	701.2	693.7	667.4
G73.0	750.9	736.8	728.1	719.9	711.5	691.1	679.3	681.9	663.3	641.2
G73.5	730.1	711.5	702.2	694.7	688.3	669.7	651.4	662.9	633.1	624.4

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 64)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	709.2	691.2	676.5	669.7	663.2	648.6	625.2	635.4	603.3	608.0
G74.5	688.4	670.9	651.9	644.7	638.2	627.6	605.0	607.7	584.7	592.1
G75.0	667.7	650.7	632.2	619.8	613.4	606.9	585.0	580.3	566.7	576.7
G75.5	646.9	630.5	612.6	594.9	588.7	582.7	565.3	553.0	549.2	561.4
G76.0	626.2	610.4	593.0	575.1	564.0	558.4	545.9	525.8	531.8	530.5
G76.5	605.5	590.4	573.5	556.0	539.4	534.2	526.7	502.4	514.8	500.0
G77.0	584.7	570.4	554.1	537.1	517.0	510.2	506.5	484.1	488.6	470.1
G77.5	562.3	550.4	534.6	518.2	498.7	486.2	482.9	466.1	461.9	440.5
G78.0	540.0	528.8	515.3	499.5	480.5	462.4	459.4	448.4	435.4	418.1
G78.5	517.6	506.8	495.5	480.8	462.5	442.3	436.0	430.9	409.0	402.9
G79.0	495.3	484.8	474.0	462.2	444.5	424.9	412.8	411.9	386.0	388.2
G79.5	473.0	462.8	452.5	442.5	426.6	407.6	389.7	388.7	369.7	374.0
G80.0	450.7	440.9	431.0	421.3	408.9	390.5	370.8	365.7	353.8	353.2
G80.5	428.4	419.0	409.5	400.2	389.5	373.5	354.4	342.9	338.1	327.0
G81.0	406.2	397.2	388.1	379.1	368.7	356.7	338.2	320.3	321.9	301.1
G81.5	384.4	375.4	366.7	358.1	347.9	338.2	322.1	301.3	299.2	275.5
G82.0	363.5	354.2	345.3	337.1	327.3	317.9	306.2	286.1	276.7	261.9
G82.5	342.5	333.9	324.6	316.1	306.7	297.7	289.3	271.1	254.4	248.8
G83.0	321.6	313.6	304.9	295.6	286.2	277.6	269.6	256.2	233.8	236.1
G83.5	300.8	293.4	285.3	276.6	265.7	257.5	250.0	241.5	220.0	216.4
G84.0	279.9	273.1	265.7	257.6	247.3	237.6	230.4	222.6	206.5	194.7
G84.5	259.1	252.9	246.2	238.7	229.1	219.0	211.0	203.5	193.1	173.2
G85.0	238.3	232.7	226.7	219.8	211.0	201.7	191.8	184.4	177.2	158.9
G85.5	217.5	212.5	207.2	201.0	192.9	184.3	175.3	165.4	158.5	147.1
G86.0	196.3	192.2	187.7	182.1	174.9	167.1	158.8	148.3	139.9	135.4
G86.5	174.9	171.4	167.7	163.3	156.9	149.9	142.4	132.8	121.4	117.8
G87.0	153.4	150.5	147.4	143.5	138.4	132.7	126.1	117.4	106.6	99.9
G87.5	132.0	129.7	127.1	123.8	119.3	114.6	109.8	102.1	92.4	83.1
G88.0	110.6	108.9	106.9	104.1	100.2	96.2	92.0	86.4	78.2	70.0
G88.5	89.3	88.0	86.6	84.4	81.2	77.8	74.3	69.3	63.2	57.0
G89.0	67.9	67.2	66.4	64.7	62.2	59.5	56.6	52.3	46.9	42.7
G89.5	46.5	46.4	46.1	45.0	43.1	41.1	39.0	35.3	30.7	27.4
G90.0	27.9	28.5	28.8	28.1	26.8	25.4	23.7	20.3	16.0	13.5
G90.5	53.3	54.1	54.3	52.8	50.1	47.1	43.7	37.3	29.2	23.9
G91.0	55.8	56.3	56.2	54.4	51.5	48.1	44.2	37.6	29.2	23.2
G91.5	58.3	58.5	58.2	56.1	52.8	49.1	44.8	37.9	29.2	22.4
G92.0	60.8	60.8	60.1	57.8	54.2	50.1	45.4	38.3	28.7	21.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 65)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G92.5	63.3	63.0	62.1	59.5	55.6	51.1	46.0	38.0	27.9	20.2
G93.0	65.8	65.2	64.0	61.2	57.0	52.0	46.1	37.6	27.1	19.6
G93.5	68.3	67.5	66.0	62.9	58.2	52.6	46.3	37.2	26.4	19.3
G94.0	70.9	69.7	67.9	64.3	59.2	53.3	46.4	36.8	26.7	18.9
G94.5	73.4	71.9	69.6	65.8	60.3	53.9	46.6	36.9	27.0	17.8
G95.0	75.8	74.0	71.4	67.2	61.4	54.6	46.8	37.6	27.4	16.8
G95.5	78.2	76.1	73.2	68.6	62.4	55.3	47.7	38.3	27.2	16.4
G96.0	80.7	78.3	75.1	70.1	63.6	56.3	48.7	39.0	26.5	18.1
G96.5	83.1	80.4	76.9	71.6	64.7	57.7	49.7	39.7	25.8	19.8
G97.0	85.5	82.6	78.7	73.1	66.4	59.0	50.7	39.4	25.2	21.6
G97.5	88.0	84.8	80.6	75.0	68.2	60.4	51.8	39.1	27.1	23.7
G98.0	90.5	86.9	82.6	77.0	69.9	61.8	52.2	39.0	29.6	25.9
G98.5	92.9	89.3	84.9	79.0	71.7	63.3	52.5	38.8	32.2	28.2
G99.0	95.6	91.8	87.1	81.0	73.4	64.3	52.8	40.2	34.8	32.3
G99.5	98.3	94.3	89.3	83.1	75.2	65.1	53.1	43.2	37.6	36.6
G100.0	101.1	96.8	91.6	85.1	76.7	65.8	53.5	46.2	40.5	41.0
G100.5	103.8	99.3	93.9	87.2	77.8	66.6	55.0	49.3	43.5	44.5
G101.0	106.6	101.9	96.2	89.0	79.0	67.5	58.3	52.4	46.6	46.9
G101.5	109.4	104.4	98.5	90.5	80.2	68.3	61.7	55.7	50.9	49.5
G102.0	112.2	107.0	100.4	92.0	81.4	70.4	65.1	59.2	55.9	52.2
G102.5	115.0	109.4	102.2	93.5	82.7	74.1	68.6	62.7	61.0	56.3
G103.0	117.8	111.6	104.0	95.1	83.9	77.9	72.1	66.3	66.2	61.7
G103.5	120.2	113.7	105.9	96.6	87.1	81.7	76.0	69.9	71.3	67.3
G104.0	122.6	115.9	107.8	98.3	91.2	85.6	80.0	74.7	74.6	73.0
G104.5	125.1	118.1	109.7	100.3	95.3	89.5	84.0	80.3	78.0	78.8
G105.0	127.5	120.3	111.6	104.8	99.5	93.5	88.2	85.9	81.4	81.8
G105.5	129.9	122.5	113.5	109.3	103.7	98.0	92.4	91.6	84.9	85.0
G106.0	132.4	124.7	117.9	113.9	108.0	102.6	96.6	97.4	88.6	88.2
G106.5	134.9	126.9	122.8	118.4	112.3	107.2	102.2	103.1	94.6	91.6
G107.0	137.4	131.5	127.7	123.0	117.1	111.9	108.3	107.0	100.8	95.1
G107.5	139.9	136.7	132.6	127.7	122.3	116.6	114.4	111.0	107.1	100.7
G108.0	145.4	141.9	137.5	132.3	127.4	121.5	120.5	115.1	113.4	107.1
G108.5	151.0	147.2	142.5	137.5	132.7	126.9	126.7	119.3	119.8	113.6
G109.0	156.5	152.5	147.5	143.2	138.0	133.4	133.1	123.6	125.7	120.3
G109.5	162.0	157.7	152.6	149.0	143.4	140.0	138.7	127.9	129.7	127.1
G110.0	167.6	163.1	158.4	154.8	148.8	146.7	143.2	134.5	133.9	134.0
G110.5	173.2	168.4	164.7	160.6	154.7	153.4	147.8	141.2	138.2	139.9

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 66)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	178.7	174.0	171.0	166.6	161.7	160.2	152.6	148.0	142.6	144.3
G111.5	184.3	180.8	177.4	172.5	168.8	167.0	157.4	154.9	147.1	148.9
G112.0	190.0	187.7	183.8	178.6	176.0	173.5	162.3	161.9	151.8	153.7
G112.5	197.2	194.5	190.3	185.5	183.2	178.6	167.3	168.9	158.2	158.5
G113.0	204.5	201.4	196.8	193.0	190.5	183.9	173.4	175.7	165.7	163.6
G113.5	211.8	208.4	203.4	200.6	197.8	189.2	180.7	180.7	173.4	168.8
G114.0	219.1	215.3	210.4	208.2	205.3	194.5	188.1	185.8	181.1	174.1
G114.5	226.5	222.4	218.4	215.9	211.8	200.0	195.5	191.0	189.0	181.4
G115.0	233.9	229.4	226.4	223.7	217.5	205.6	203.1	196.4	197.1	189.5
G115.5	241.3	237.0	234.5	231.4	223.4	211.2	210.8	201.9	205.2	197.9
G116.0	248.8	245.3	242.6	239.3	229.3	218.2	218.5	207.6	213.5	206.4
G116.5	256.2	253.6	250.8	246.6	235.4	226.2	226.4	213.4	219.5	215.1
G117.0	264.6	262.0	258.9	252.9	241.4	234.3	232.6	220.7	225.4	224.0
G117.5	273.1	270.4	267.1	259.3	247.6	242.5	238.7	229.4	231.4	233.0
G118.0	281.7	278.8	275.4	265.7	253.9	250.7	244.9	238.2	237.6	242.2
G118.5	290.3	287.3	282.8	272.2	261.0	259.0	251.2	247.1	244.0	251.5
G119.0	298.9	295.8	289.6	278.8	269.5	267.3	257.7	256.2	250.5	261.0
G119.5	307.6	304.4	296.5	285.4	278.2	275.8	264.3	265.3	257.2	267.7
G120.0	316.3	312.5	303.4	292.1	286.8	283.7	271.0	274.7	264.0	274.3
G120.5	325.0	319.7	310.4	298.9	295.5	290.6	277.9	284.2	270.9	281.0
G121.0	333.8	326.9	317.4	307.0	304.3	297.6	286.0	293.8	280.1	287.9
G121.5	341.9	334.2	324.5	315.8	313.1	304.7	295.8	301.5	290.2	295.0
G122.0	349.5	341.6	331.7	324.9	322.0	311.9	305.6	308.6	300.3	302.1
G122.5	357.0	349.0	338.9	334.0	331.0	319.2	315.6	316.0	310.7	309.5
G123.0	364.6	356.4	347.2	343.1	339.2	326.7	325.7	323.5	321.1	317.0
G123.5	372.3	363.9	356.3	352.4	346.6	334.3	335.9	331.1	331.8	324.7
G124.0	380.0	371.5	365.5	361.7	354.1	342.0	346.1	338.9	342.6	332.6
G124.5	387.8	379.1	374.8	370.9	361.7	350.5	356.4	346.8	353.5	340.6
G125.0	395.6	388.3	384.0	380.3	369.4	361.0	366.8	354.9	364.6	348.7
G125.5	403.5	397.6	393.4	388.8	377.1	371.6	377.4	363.2	375.8	357.2
G126.0	411.3	406.9	402.7	396.6	385.0	382.1	385.5	371.5	387.3	367.3
G126.5	420.6	416.2	412.1	404.4	392.9	392.7	393.6	381.7	397.2	377.5
G127.0	429.9	425.6	421.6	412.2	400.9	403.2	401.9	393.0	405.4	387.9
G127.5	439.2	435.0	430.9	420.1	409.1	413.9	410.3	404.4	413.7	398.3
G128.0	448.6	444.4	438.8	428.1	419.6	424.5	418.7	415.8	422.0	408.9
G128.5	457.9	453.8	446.6	436.1	430.2	435.3	427.3	427.3	430.5	419.6
G129.0	467.3	463.3	454.5	444.1	440.9	446.0	436.0	439.0	439.0	430.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 67)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G129.5	476.7	472.1	462.4	452.2	451.6	455.9	444.8	450.8	447.5	441.2
G130.0	486.2	479.9	470.3	460.4	462.3	464.3	453.6	462.7	456.2	452.0
G130.5	495.7	487.7	478.2	470.2	473.0	472.6	462.5	474.7	464.9	462.8
G131.0	504.7	495.5	486.2	480.5	483.7	481.1	472.0	486.8	473.7	473.6
G131.5	512.4	503.3	494.2	490.9	494.4	489.7	483.6	498.9	482.6	484.4
G132.0	520.0	511.1	502.1	501.2	505.0	498.4	495.2	511.0	491.6	495.2
G132.5	527.7	519.0	510.6	511.6	515.6	507.1	506.8	520.8	500.7	506.0
G133.0	535.3	526.8	520.6	522.0	524.2	515.9	518.5	529.0	509.9	516.8
G133.5	543.0	534.7	530.5	532.3	532.5	524.7	530.2	537.4	520.0	527.6
G134.0	550.7	542.6	540.5	542.6	540.9	533.7	541.9	545.8	530.7	538.5
G134.5	558.4	551.3	550.5	552.9	549.4	542.6	553.6	554.2	541.4	547.4
G135.0	566.1	560.9	560.4	563.1	557.9	552.5	565.3	562.7	551.9	556.3
G135.5	573.8	570.5	570.3	572.4	566.4	564.0	577.0	571.2	562.4	565.1
G136.0	581.8	580.1	580.3	580.6	575.0	575.2	588.7	579.8	572.7	573.9
G136.5	591.1	589.7	590.3	588.8	583.6	586.5	600.4	588.3	582.8	582.6
G137.0	600.3	599.3	600.2	597.0	592.2	597.7	612.0	597.0	593.0	591.2
G137.5	609.5	608.8	610.1	605.3	600.9	608.8	619.9	605.6	603.1	599.9
G138.0	618.8	618.3	618.4	613.6	609.7	619.9	627.7	614.1	613.2	608.5
G138.5	628.0	627.8	626.5	621.9	620.2	631.0	635.6	622.7	623.0	617.1
G139.0	637.2	637.3	634.6	630.2	631.0	642.0	643.4	631.3	632.9	625.6
G139.5	646.5	646.7	642.6	638.5	641.6	653.1	651.2	640.4	642.6	634.1
G140.0	655.6	654.5	650.6	646.9	652.1	664.2	659.0	649.7	652.2	642.5
G140.5	664.7	662.3	658.7	655.2	662.6	675.2	666.8	659.1	661.8	650.9
G141.0	673.9	670.1	666.8	664.4	673.1	685.4	674.6	668.2	671.2	659.1
G141.5	681.7	678.0	674.9	674.7	683.5	692.4	682.4	677.3	680.5	667.4
G142.0	689.3	685.8	683.0	685.0	694.0	699.4	690.1	686.2	689.4	675.5
G142.5	697.0	693.6	691.1	695.3	704.4	706.5	697.9	695.0	696.9	683.7
G143.0	704.6	701.5	699.3	705.5	714.7	713.6	705.7	703.7	704.3	691.7
G143.5	712.3	709.3	709.2	715.7	725.0	720.6	713.6	712.3	711.6	699.7
G144.0	720.0	717.2	719.0	725.7	735.4	727.7	721.3	720.8	718.8	707.5
G144.5	727.6	725.1	728.8	735.6	742.5	734.8	729.5	729.2	726.0	715.4
G145.0	735.2	733.5	738.4	745.6	749.3	741.9	737.3	737.5	733.1	723.1
G145.5	742.8	743.0	747.9	755.6	756.0	749.0	744.9	745.6	740.3	730.8
G146.0	750.5	752.4	757.4	765.6	762.6	756.1	752.4	753.4	747.3	738.9
G146.5	758.7	761.8	766.9	775.6	769.4	763.2	760.1	761.2	754.2	747.4
G147.0	767.5	771.1	776.3	782.4	775.9	770.2	767.6	768.8	760.9	755.8
G147.5	776.4	780.4	785.8	788.5	782.5	777.1	775.1	776.4	767.5	764.0

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 68)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	785.3	789.5	795.2	794.7	789.1	784.3	782.4	783.0	774.1	772.1
G148.5	794.0	798.6	804.8	800.8	795.7	791.5	789.8	789.1	780.5	779.9
G149.0	802.9	807.6	812.0	806.8	802.2	798.6	797.0	795.2	787.0	787.5
G149.5	811.8	816.5	818.0	813.0	808.8	805.3	804.2	801.1	793.4	795.1
G150.0	820.6	825.4	823.7	819.0	815.5	812.0	811.3	807.1	799.8	802.5
G150.5	829.4	833.2	829.5	825.1	822.1	818.6	818.1	813.1	806.2	810.0
G151.0	838.4	838.7	835.3	831.1	828.4	825.3	824.9	819.1	812.4	817.4
G151.5	847.1	844.1	841.1	837.2	834.4	832.0	831.6	824.9	818.6	824.6
G152.0	853.7	849.6	846.8	843.3	840.3	838.3	837.8	830.6	824.8	831.7
G152.5	858.9	855.1	852.5	849.3	846.1	844.7	843.2	836.2	830.9	838.7
G153.0	864.2	860.5	858.2	855.2	851.8	850.8	848.6	841.8	837.6	845.7
G153.5	869.4	865.9	863.7	860.8	857.5	856.6	853.7	847.3	844.4	852.4
G154.0	874.6	871.4	869.3	866.5	863.2	862.5	858.8	852.9	851.0	859.1
G154.5	879.8	876.9	875.0	871.6	868.9	868.2	863.8	858.4	857.5	865.5
G155.0	885.0	882.3	879.8	876.7	874.5	873.7	868.6	863.9	864.1	871.9
G155.5	890.3	887.8	884.5	881.8	879.9	878.3	873.4	869.3	870.6	878.3
G156.0	895.3	893.3	889.1	886.6	885.3	882.8	878.1	874.5	877.0	884.7
G156.5	900.5	897.9	893.8	891.4	890.4	887.4	882.8	879.6	883.5	890.8
G157.0	905.7	902.3	898.5	896.2	895.4	891.7	887.4	884.6	889.2	896.8
G157.5	910.1	906.4	903.0	900.9	900.2	895.9	892.0	889.6	895.1	902.4
G158.0	913.9	910.6	907.7	905.6	903.9	900.1	896.5	895.1	900.4	907.9
G158.5	917.7	914.7	912.1	910.3	907.7	904.1	901.0	900.5	905.8	913.1
G159.0	921.4	918.7	916.5	914.9	911.5	908.2	905.5	905.9	911.1	918.2
G159.5	925.2	922.6	920.8	919.1	915.2	912.2	909.8	911.2	916.3	923.2
G160.0	929.0	926.5	924.9	922.7	918.9	916.2	914.0	916.6	921.4	928.2
G160.5	932.7	930.4	929.0	926.0	922.6	920.1	918.2	921.5	926.5	933.1
G161.0	936.4	934.3	932.5	929.4	926.3	923.9	922.9	926.5	931.4	937.8
G161.5	940.1	938.1	935.6	932.8	930.0	927.7	927.7	931.3	936.1	942.2
G162.0	943.6	941.7	938.7	936.1	933.6	931.4	932.3	935.8	940.8	946.3
G162.5	947.1	944.6	941.8	939.3	937.1	935.1	936.8	940.4	945.2	950.3
G163.0	950.3	947.5	944.9	942.6	940.7	938.9	941.2	944.8	949.5	954.1
G163.5	952.9	950.4	947.9	945.7	944.0	943.5	945.7	949.1	953.7	957.8
G164.0	955.6	953.2	950.9	948.9	947.4	947.9	950.0	953.4	957.8	961.4
G164.5	958.2	956.0	953.9	952.1	950.7	952.0	954.2	957.6	961.9	965.0
G165.0	960.8	958.8	956.9	955.3	954.5	955.9	958.4	961.6	966.1	968.5
G165.5	963.4	961.6	959.9	958.5	958.5	959.9	962.3	965.5	969.8	972.0
G166.0	966.1	964.4	962.7	961.6	962.3	963.9	966.2	969.4	973.2	975.3

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 69)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G166.5	968.7	967.1	965.6	965.2	966.1	967.8	970.1	973.2	976.3	978.5
G167.0	971.2	969.8	968.5	968.8	969.8	971.5	973.9	976.9	979.5	981.6
G167.5	973.8	972.5	972.0	972.3	973.5	975.2	977.6	980.5	982.7	984.7
G168.0	976.5	975.4	975.4	975.9	976.9	978.7	981.0	984.1	985.9	987.8
G168.5	979.0	978.7	978.8	979.4	980.4	982.1	984.4	987.2	988.9	990.9
G169.0	982.1	982.0	982.2	982.8	983.9	985.5	987.7	990.0	991.7	993.8
G169.5	985.2	985.2	985.4	986.1	987.3	988.8	991.0	992.7	994.5	996.6
G170.0	988.3	988.3	988.7	989.4	990.5	992.1	994.2	995.5	997.2	999.2
G170.5	991.4	991.4	991.9	992.6	993.8	995.3	997.0	998.2	999.8	1001.8
G171.0	994.6	994.5	995.0	995.7	997.0	998.5	999.7	1000.9	1002.3	1004.2
G171.5	997.7	997.6	998.0	998.8	1000.0	1001.5	1002.3	1003.5	1004.9	1006.7
G172.0	1000.9	1000.7	1001.0	1001.8	1003.0	1003.9	1004.9	1006.0	1007.4	1009.1
G172.5	1003.8	1003.9	1004.2	1004.9	1005.7	1006.4	1007.4	1008.6	1010.0	1011.5
G173.0	1006.7	1007.1	1007.3	1007.8	1008.2	1008.9	1009.9	1011.0	1012.3	1013.9
G173.5	1009.6	1010.0	1010.5	1010.5	1010.7	1011.4	1012.2	1013.4	1014.7	1016.2
G174.0	1012.4	1012.7	1013.0	1013.1	1013.4	1013.9	1014.6	1015.6	1016.9	1018.4
G174.5	1014.6	1015.1	1015.3	1015.6	1015.9	1016.4	1017.0	1018.0	1019.1	1020.4
G175.0	1016.8	1017.3	1017.6	1018.0	1018.4	1018.9	1019.6	1020.4	1021.3	1022.6
G175.5	1019.0	1019.4	1020.0	1020.4	1020.8	1021.3	1021.9	1022.7	1023.6	1024.7
G176.0	1021.3	1021.6	1022.1	1022.7	1023.3	1023.8	1024.4	1025.0	1025.8	1026.8
G176.5	1023.5	1023.9	1024.4	1024.8	1025.4	1026.1	1026.8	1027.5	1028.2	1029.0
G177.0	1025.7	1026.1	1026.6	1027.0	1027.5	1028.1	1028.8	1029.5	1030.3	1031.2
G177.5	1027.9	1028.2	1028.7	1029.1	1029.7	1030.2	1030.8	1031.4	1032.1	1032.9
G178.0	1030.1	1030.3	1030.6	1031.1	1031.5	1032.0	1032.6	1033.2	1033.8	1034.5
G178.5	1032.3	1032.5	1032.7	1033.0	1033.3	1033.7	1034.1	1034.6	1035.1	1035.6
G179.0	1034.6	1034.6	1034.8	1035.0	1035.2	1035.4	1035.7	1036.0	1036.3	1036.6
G179.5	1036.7	1036.8	1036.9	1037.0	1037.1	1037.2	1037.3	1037.4	1037.6	1037.8
G180.0	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7	1035.7

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 70)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G0.0	4251.4	4251.4	4251.4							
G0.5	4250.0	4251.1	4252.2							
G1.0	4248.9	4251.1	4252.9							
G1.5	4244.1	4247.0	4249.6							
G2.0	4239.4	4243.0	4246.7							
G2.5	4233.5	4237.5	4242.3							
G3.0	4227.3	4232.4	4237.5							
G3.5	4222.9	4228.8	4235.0							
G4.0	4218.2	4225.1	4232.4							
G4.5	4214.2	4221.8	4229.9							
G5.0	4209.8	4218.5	4227.7							
G5.5	4203.9	4213.4	4222.9							
G6.0	4198.1	4207.9	4218.5							
G6.5	4190.0	4200.3	4211.2							
G7.0	4181.6	4192.2	4203.6							
G7.5	4171.4	4182.0	4193.7							
G8.0	4160.8	4171.8	4183.8							
G8.5	4149.5	4160.8	4173.6							
G9.0	4138.5	4150.2	4163.4							
G9.5	4127.2	4139.6	4153.9							
G10.0	4116.2	4129.4	4144.0							
G10.5	4104.5	4118.1	4133.4							
G11.0	4092.8	4106.7	4122.8							
G11.5	4079.3	4092.8	4108.6							
G12.0	4065.4	4079.0	4094.7							
G12.5	4049.7	4061.8	4077.1							
G13.0	4032.9	4044.6	4059.6							
G13.5	4015.7	4028.2	4043.9							
G14.0	3998.9	4011.7	4028.2							
G14.5	3981.8	3995.3	4012.5							
G15.0	3965.0	3978.8	3996.4							
G15.5	3947.4	3961.3	3978.8							
G16.0	3929.9	3943.4	3961.3							
G16.5	3911.6	3924.8	3942.3							
G17.0	3893.0	3905.8	3923.7							
G17.5	3873.2	3885.3	3902.1							
G18.0	3853.1	3864.5	3880.5							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 71)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G18.5	3832.3	3842.2	3858.3							
G19.0	3810.8	3819.9	3836.0							
G19.5	3788.5	3798.0	3814.4							
G20.0	3766.2	3776.0	3793.2							
G20.5	3743.5	3753.8	3770.6							
G21.0	3721.6	3731.1	3747.9							
G21.5	3699.3	3707.0	3722.3							
G22.0	3675.9	3682.9	3697.1							
G22.5	3652.3	3656.9	3670.8							
G23.0	3627.1	3631.2	3644.2							
G23.5	3601.7	3604.2	3616.4							
G24.0	3575.3	3577.0	3588.6							
G24.5	3548.7	3550.1	3562.6							
G25.0	3521.3	3523.3	3536.7							
G25.5	3494.1	3497.5	3511.6							
G26.0	3468.3	3471.9	3486.5							
G26.5	3442.7	3445.9	3459.2							
G27.0	3416.7	3419.7	3431.9							
G27.5	3389.5	3392.1	3402.8							
G28.0	3360.1	3364.0	3373.6							
G28.5	3330.7	3334.6	3342.5							
G29.0	3299.6	3304.9	3311.4							
G29.5	3268.5	3274.9	3281.7							
G30.0	3236.0	3244.9	3252.1							
G30.5	3203.6	3215.5	3222.8							
G31.0	3172.1	3186.3	3193.6							
G31.5	3140.7	3156.9	3162.8							
G32.0	3109.3	3127.3	3132.1							
G32.5	3077.8	3096.7	3099.3							
G33.0	3044.9	3065.6	3066.5							
G33.5	3011.8	3033.6	3033.0							
G34.0	2977.5	3001.2	2999.4							
G34.5	2942.9	2968.9	2967.7							
G35.0	2908.7	2936.7	2935.9							
G35.5	2874.6	2905.2	2903.5							
G36.0	2841.2	2874.2	2871.2							
G36.5	2808.0	2842.7	2837.6							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 72)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G37.0	2774.1	2810.9	2804.0							
G37.5	2739.9	2778.6	2770.1							
G38.0	2705.1	2745.9	2736.3							
G38.5	2670.1	2713.1	2702.2							
G39.0	2635.2	2680.2	2668.0							
G39.5	2600.4	2647.6	2635.2							
G40.0	2565.8	2615.1	2602.3							
G40.5	2531.5	2583.2	2570.5							
G41.0	2497.3	2551.6	2538.8							
G41.5	2463.1	2520.2	2507.1							
G42.0	2429.1	2489.0	2475.4							
G42.5	2395.3	2457.9	2441.8							
G43.0	2361.3	2426.8	2408.2							
G43.5	2327.0	2395.1	2373.6							
G44.0	2292.4	2362.9	2339.0							
G44.5	2257.6	2330.4	2305.9							
G45.0	2222.9	2297.7	2272.8							
G45.5	2189.3	2263.9	2240.3							
G46.0	2159.4	2230.1	2207.8							
G46.5	2129.5	2196.3	2176.9							
G47.0	2099.8	2162.7	2146.0							
G47.5	2070.7	2129.7	2114.9							
G48.0	2041.7	2097.3	2083.8							
G48.5	2013.2	2064.9	2051.4							
G49.0	1984.7	2032.6	2018.8							
G49.5	1956.1	1999.9	1987.4							
G50.0	1927.6	1966.7	1956.0							
G50.5	1899.3	1933.8	1925.3							
G51.0	1871.1	1901.2	1894.6							
G51.5	1843.0	1868.8	1863.9							
G52.0	1815.1	1836.7	1833.3							
G52.5	1787.3	1804.7	1802.5							
G53.0	1759.6	1772.9	1771.6							
G53.5	1732.4	1741.1	1741.2							
G54.0	1705.5	1709.3	1710.8							
G54.5	1678.8	1677.6	1680.4							
G55.0	1652.4	1645.8	1650.0							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 73)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G55.5	1626.1	1614.1	1619.6							
G56.0	1599.9	1582.3	1589.2							
G56.5	1573.7	1550.8	1560.7							
G57.0	1547.5	1519.8	1532.1							
G57.5	1515.8	1489.1	1504.1							
G58.0	1483.7	1459.0	1476.1							
G58.5	1451.8	1428.8	1447.1							
G59.0	1420.7	1398.3	1418.0							
G59.5	1389.6	1367.7	1389.0							
G60.0	1358.3	1337.0	1359.9							
G60.5	1326.9	1306.4	1331.6							
G61.0	1295.4	1276.4	1303.3							
G61.5	1263.9	1246.5	1275.2							
G62.0	1233.1	1216.7	1247.1							
G62.5	1202.5	1187.1	1220.2							
G63.0	1172.2	1157.7	1193.3							
G63.5	1142.1	1128.3	1166.2							
G64.0	1111.7	1101.6	1139.1							
G64.5	1081.2	1076.7	1111.4							
G65.0	1057.4	1051.9	1083.6							
G65.5	1033.8	1027.2	1056.3							
G66.0	1010.6	1002.9	1029.0							
G66.5	987.9	978.8	1002.6							
G67.0	965.4	955.2	976.2							
G67.5	943.5	931.7	950.5							
G68.0	921.9	909.0	924.8							
G68.5	900.8	886.3	898.7							
G69.0	880.0	864.0	872.7							
G69.5	859.7	842.0	847.3							
G70.0	829.2	820.3	821.8							
G70.5	797.0	798.8	796.7							
G71.0	765.3	777.6	771.6							
G71.5	733.5	756.8	746.6							
G72.0	702.0	736.0	721.6							
G72.5	670.4	707.5	697.4							
G73.0	639.0	678.7	673.2							
G73.5	613.7	649.6	649.2							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 74)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	595.6	620.3	625.2							
G74.5	577.9	590.9	601.0							
G75.0	560.8	561.8	576.7							
G75.5	544.3	533.3	551.1							
G76.0	528.6	504.8	525.6							
G76.5	500.5	476.7	500.4							
G77.0	470.4	458.9	475.2							
G77.5	440.7	442.8	451.9							
G78.0	411.9	427.2	428.6							
G78.5	389.6	412.8	405.1							
G79.0	377.6	398.8	381.6							
G79.5	366.4	383.2	358.6							
G80.0	355.9	354.1	335.6							
G80.5	333.1	325.2	314.7							
G81.0	305.1	296.3	293.7							
G81.5	277.0	270.8	274.6							
G82.0	258.6	261.9	255.4							
G82.5	247.5	253.7	237.1							
G83.0	237.0	242.9	218.7							
G83.5	213.5	214.6	201.0							
G84.0	187.9	185.9	183.3							
G84.5	169.2	178.4	166.3							
G85.0	159.0	176.2	149.3							
G85.5	146.1	144.9	133.3							
G86.0	124.3	122.4	117.3							
G86.5	105.3	119.8	103.0							
G87.0	95.8	89.1	88.7							
G87.5	83.7	79.4	74.3							
G88.0	65.9	61.0	59.8							
G88.5	51.3	49.1	47.6							
G89.0	39.9	34.4	35.3							
G89.5	26.3	23.9	26.4							
G90.0	13.3	11.9	19.5							
G90.5	22.4	18.4	44.0							
G91.0	20.6	14.3	39.7							
G91.5	18.7	11.0	37.7							
G92.0	17.0	8.2	35.7							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 75)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G92.5	15.6	7.7	35.7							
G93.0	13.8	7.9	35.8							
G93.5	12.0	9.5	36.3							
G94.0	11.9	9.3	36.9							
G94.5	12.5	10.6	38.1							
G95.0	13.3	12.8	39.2							
G95.5	14.3	13.2	40.3							
G96.0	16.3	14.0	41.5							
G96.5	19.1	17.4	42.8							
G97.0	21.9	21.0	44.1							
G97.5	22.9	22.4	45.5							
G98.0	24.1	23.6	46.9							
G98.5	26.6	24.9	48.3							
G99.0	30.9	28.9	49.6							
G99.5	35.4	33.7	51.8							
G100.0	39.2	38.7	54.1							
G100.5	41.2	43.9	57.4							
G101.0	43.3	46.7	60.8							
G101.5	45.6	49.3	64.6							
G102.0	49.9	51.9	68.4							
G102.5	55.4	54.7	72.6							
G103.0	61.0	57.6	76.7							
G103.5	66.7	60.9	81.6							
G104.0	72.0	66.0	86.5							
G104.5	75.1	71.3	92.3							
G105.0	78.2	76.7	98.0							
G105.5	81.5	82.1	103.4							
G106.0	85.0	87.7	108.7							
G106.5	88.6	93.3	113.5							
G107.0	93.8	99.1	118.2							
G107.5	100.3	104.9	123.2							
G108.0	107.0	110.8	128.2							
G108.5	113.8	115.3	133.3							
G109.0	120.8	119.8	138.5							
G109.5	127.9	124.4	144.0							
G110.0	135.1	129.3	149.5							
G110.5	142.0	134.2	155.4							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 76)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	146.5	139.3	161.2							
G111.5	151.2	144.4	167.2							
G112.0	156.0	149.7	173.3							
G112.5	160.9	155.0	179.4							
G113.0	166.0	160.5	185.5							
G113.5	171.2	166.0	191.8							
G114.0	176.4	171.7	198.0							
G114.5	181.9	177.5	204.5							
G115.0	187.4	183.4	211.0							
G115.5	193.1	189.5	217.8							
G116.0	200.7	195.6	224.5							
G116.5	208.4	202.3	231.6							
G117.0	216.2	210.0	238.6							
G117.5	224.2	217.8	245.9							
G118.0	232.3	225.7	253.2							
G118.5	240.5	233.7	260.8							
G119.0	249.1	241.9	268.5							
G119.5	257.6	250.2	276.6							
G120.0	266.5	258.7	284.6							
G120.5	275.3	267.3	292.7							
G121.0	284.4	276.2	300.8							
G121.5	293.6	285.1	309.2							
G122.0	302.9	294.3	317.5							
G122.5	312.2	303.5	326.4							
G123.0	321.5	313.0	335.2							
G123.5	329.3	322.5	344.3							
G124.0	337.3	332.1	353.4							
G124.5	345.4	341.8	362.5							
G125.0	353.7	351.6	371.5							
G125.5	362.0	361.6	380.8							
G126.0	370.5	371.7	390.1							
G126.5	379.1	381.9	399.8							
G127.0	387.8	392.2	409.5							
G127.5	396.6	402.7	419.6							
G128.0	405.6	413.3	429.6							
G128.5	414.6	424.0	439.9							
G129.0	423.7	434.7	450.1							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 77)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G129.5	433.0	445.5	460.4							
G130.0	442.3	456.3	470.8							
G130.5	451.7	467.2	481.0							
G131.0	461.2	478.1	491.3							
G131.5	470.6	489.0	501.7							
G132.0	480.1	499.8	512.1							
G132.5	489.5	510.6	522.5							
G133.0	499.0	521.5	532.9							
G133.5	508.6	532.5	543.2							
G134.0	518.2	543.4	553.5							
G134.5	527.8	554.2	563.8							
G135.0	538.6	564.7	574.2							
G135.5	549.4	574.5	584.6							
G136.0	560.1	584.3	595.1							
G136.5	570.7	593.9	605.2							
G137.0	581.3	603.5	615.3							
G137.5	591.8	613.1	625.1							
G138.0	602.2	622.6	634.8							
G138.5	612.4	632.0	644.5							
G139.0	622.6	641.4	654.3							
G139.5	632.6	650.6	663.5							
G140.0	642.6	659.8	672.8							
G140.5	652.5	668.9	681.5							
G141.0	662.2	677.8	690.2							
G141.5	671.8	686.6	699.3							
G142.0	681.2	695.3	708.3							
G142.5	690.5	703.8	717.5							
G143.0	699.8	712.4	726.7							
G143.5	708.9	720.8	735.3							
G144.0	717.9	729.2	743.9							
G144.5	726.9	737.4	752.2							
G145.0	735.7	745.6	760.4							
G145.5	744.4	753.6	768.4							
G146.0	752.9	761.7	776.4							
G146.5	761.3	769.4	784.2							
G147.0	769.4	777.2	792.0							
G147.5	777.6	784.8	799.5							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 78)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	785.3	792.2	807.0							
G148.5	792.9	799.4	814.1							
G149.0	800.3	806.4	821.3							
G149.5	807.6	813.1	828.4							
G150.0	815.0	819.8	835.5							
G150.5	822.3	826.6	842.7							
G151.0	829.4	833.3	849.8							
G151.5	836.5	839.9	856.6							
G152.0	843.4	846.5	863.2							
G152.5	850.3	852.9	869.1							
G153.0	857.0	859.3	875.1							
G153.5	863.4	865.5	881.2							
G154.0	869.2	871.6	887.3							
G154.5	875.0	877.5	893.4							
G155.0	880.6	883.4	899.5							
G155.5	886.3	889.1	905.5							
G156.0	892.1	894.7	911.5							
G156.5	897.8	900.4	917.0							
G157.0	903.2	906.1	922.6							
G157.5	908.5	911.5	927.5							
G158.0	913.5	916.9	932.4							
G158.5	918.3	921.9	937.1							
G159.0	922.9	926.8	941.8							
G159.5	927.5	931.3	946.3							
G160.0	931.9	935.8	950.8							
G160.5	936.3	940.1	955.2							
G161.0	940.6	944.3	959.7							
G161.5	944.8	948.4	963.6							
G162.0	948.8	952.5	967.3							
G162.5	952.9	956.5	970.5							
G163.0	956.8	960.4	973.7							
G163.5	960.6	964.2	977.3							
G164.0	964.3	968.0	980.9							
G164.5	967.8	971.4	984.6							
G165.0	971.2	974.9	988.3							
G165.5	974.7	978.1	991.3							
G166.0	978.0	981.4	994.4							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector:

Candlepower Table (Continue 79)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G166.5	981.2	984.5	997.3							
G167.0	984.3	987.6	1000.3							
G167.5	987.3	990.4	1003.2							
G168.0	990.2	993.3	1006.1							
G168.5	993.3	996.1	1008.4							
G169.0	996.1	999.0	1010.7							
G169.5	999.0	1001.8	1012.6							
G170.0	1001.7	1004.6	1014.5							
G170.5	1004.0	1006.8	1016.0							
G171.0	1006.4	1009.0	1017.6							
G171.5	1008.8	1011.1	1019.3							
G172.0	1011.1	1013.4	1021.0							
G172.5	1013.4	1015.5	1022.4							
G173.0	1015.6	1017.7	1023.8							
G173.5	1017.9	1019.8	1025.4							
G174.0	1020.0	1021.9	1027.0							
G174.5	1022.0	1023.6	1028.7							
G175.0	1023.9	1025.5	1030.2							
G175.5	1025.8	1027.2	1031.2							
G176.0	1027.8	1029.0	1032.0							
G176.5	1030.0	1031.1	1032.9							
G177.0	1032.1	1033.2	1033.6							
G177.5	1033.7	1034.6	1033.8							
G178.0	1035.2	1036.0	1034.0							
G178.5	1036.1	1036.6	1034.6							
G179.0	1037.0	1037.4	1035.0							
G179.5	1038.0	1038.2	1035.3							
G180.0	1035.7	1035.7	1035.7							

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°):0.0-180.0:0.5
Test Device:
Distance:
Humidity:
Inspector: